

# Aggregate Optimization Chart

**PLANT #:** **P-101**

Sample Date: 2/15/21 Concrete Grade: **P1M**  
 Dates Test Represents: 2/16/2021 through 2/22/2021

Contractor: \_\_\_\_\_

MDOT No.: \_\_\_\_\_

Agg. Class	Pit #	Source	Weight (SSD)	ft <sup>3</sup>	Specific Gravity	% Contribution
CA	71-47	Presque Isle	970	5.93	2.62	31.6
IA	71-47	Presque Isle	900	5.50	2.62	29.3
2NS	75-051	Mid-Michigan	1200	7.23	2.66	39.1
<b>Total Wt</b>			<b>3070</b>	<b>18.67</b>		<b>100.0</b>

<---- Verify this number is 100%



**Superior Materials, LLC**  
 30701 W. 10 Mile Rd.  
 Suite 500  
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	98.4	100.0	100.0	99.5	0.5	0.5
1"	45.8	100.0	100.0	82.9	16.6	17.1
3/4"	14.9	98.1	100.0	72.6	10.3	27.4
1/2"	2.8	79.2	100.0	63.2	9.4	36.8
3/8"	2.1	55.0	100.0	55.9	7.3	44.1
#4	1.8	8.8	98.3	41.6	14.3	58.4
#8	1.7	2.4	83.6	33.9	7.7	66.1
#16	1.6	2.1	68.5	27.9	6.0	72.1
#30	1.6	2.0	50.8	20.9	6.9	79.1
#50	1.5	2.0	23.8	10.4	10.6	89.6
#100	1.4	1.9	3.6	2.4	8.0	97.6
LBW	1.2	1.7	0.4	1.0	1.4	99.0

\*Maximum % Retained must be above the 3/8" sieve.  
 \*Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation  Batch Plant Gradations  Aggregate Supplier Gradations


**Coarseness Factor:** **67**      **Workability Factor:** **34**

Initial Production Sample (IPS)

**Coarseness Factor:** **66**

**Workability Factor:** **35**

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	99.6	0.4	0.4
1"	84.3	15.3	15.7
3/4"	74.8	9.6	25.2
1/2"	64.3	10.4	35.7
3/8"	56.8	7.5	43.2
#4	43.0	13.8	57.0
#8	34.9	8.1	65.1
#16	26.4	8.5	73.6
#30	19.9	6.5	80.1
#50	10.4	9.5	89.6
#100	3.4	7.0	96.6
LBW	1.2	2.2	98.8

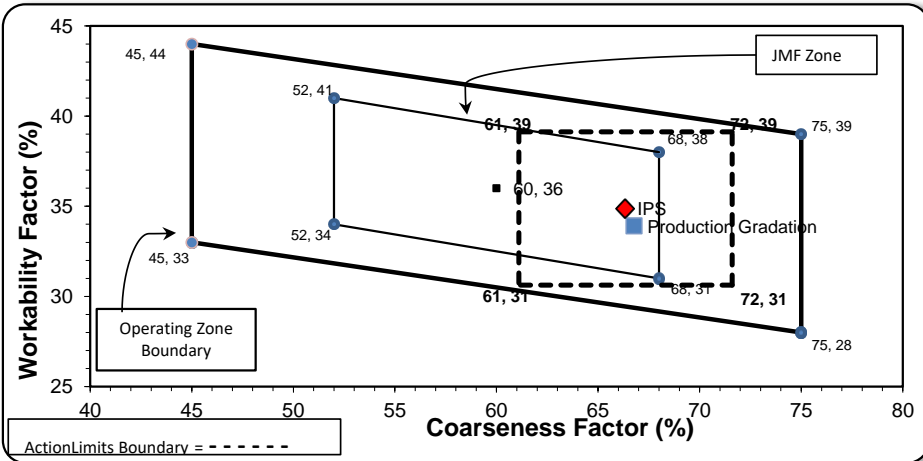

PREPARED BY:  
 SM, LLC Technical Service

Approved By:

# Aggregate Optimization Chart

**PLANT #:** **P-32**

Sample Date: 2/15/21

Concrete Grade: **P1M**

Contractor: \_\_\_\_\_

Dates Test Represents: 2/16/2021 through 2/22/2021

MDOT No.: \_\_\_\_\_

Agg. Class	Pit #	Source	Weight (SSD)	ft <sup>3</sup>	Specific Gravity	% Contribution
CA	71-47	Presque Isle	780	4.77	2.62	25.4
IA	71-47	Presque Isle	1040	6.36	2.62	33.9
2NS	95-013	Smelter Bay	1250	7.56	2.65	40.7
<b>Total Wt</b>			<b>3070</b>	<b>18.69</b>		<b>100.0</b>

<----- Verify this number is 100%




**Superior Materials, LLC**  
 30701 W. 10 Mile Rd.  
 Suite 500  
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	97.0	100.0	100.0	99.2	0.8	0.8
1"	44.2	100.0	100.0	85.8	13.4	14.2
3/4"	14.1	96.9	100.0	77.1	8.7	22.9
1/2"	4.3	71.5	100.0	66.0	11.1	34.0
3/8"	1.7	39.3	100.0	54.5	11.6	45.5
#4	1.6	4.8	96.7	41.4	13.1	58.6
#8	1.6	2.5	84.7	35.7	5.7	64.3
#16	1.5	2.3	71.2	30.2	5.6	69.8
#30	1.5	2.2	50.1	21.5	8.6	78.5
#50	1.4	2.0	19.0	8.8	12.8	91.2
#100	1.3	1.9	4.5	2.8	6.0	97.2
LBW	0.9	1.2	1.3	1.2	1.6	98.8

\*Maximum % Retained must be above the 3/8" sieve.  
 \*Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation  Batch Plant Gradations  Aggregate Supplier Gradations

<b>Coarseness Factor:</b>	<b>71</b>	<b>Workability Factor:</b>	<b>36</b>
---------------------------	-----------	----------------------------	-----------

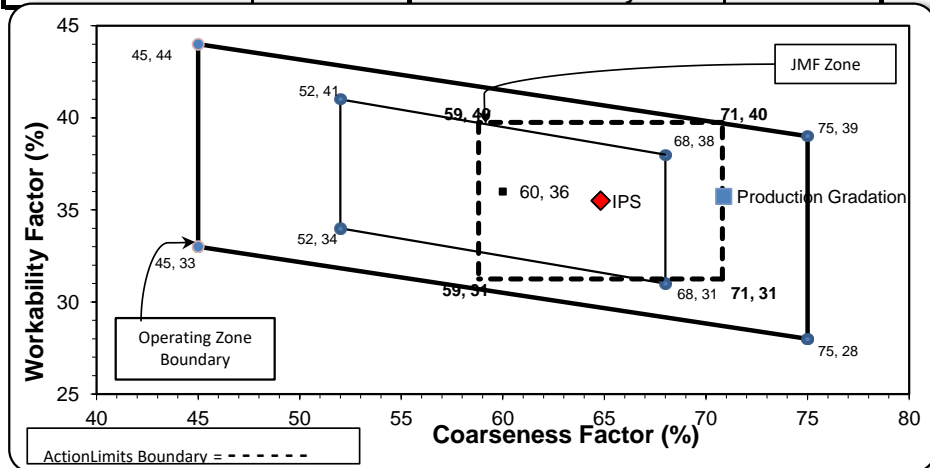

Initial Production Sample (IPS)

<b>Coarseness Factor:</b>	<b>65</b>		
<b>Workability Factor:</b>	<b>36</b>		
Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	99.0	0.6	0.6
1"	84.0	15.3	16.0
3/4"	73.5	10.5	26.5
1/2"	65.2	8.2	34.8
3/8"	58.2	7.1	41.8
#4	44.1	14.1	55.9
#8	35.5	8.6	64.5
#16	29.1	6.4	70.9
#30	21.9	7.3	78.1
#50	9.6	12.2	90.4
#100	2.6	7.1	97.4
LBW	1.0	1.6	99.0

PREPARED BY:  
 SM, LLC Technical Service

Approved By:

# Aggregate Optimization Chart

**PLANT #:** **P-36**

Sample Date: 2/15/21

Concrete Grade: **P1M**

Contractor: \_\_\_\_\_

Dates Test Represents: 2/16/2021 through 2/22/2021

MDOT No.: \_\_\_\_\_

Agg. Class	Pit #	Source	Weight (SSD)	ft <sup>3</sup>	Specific Gravity	% Contribution
CA	71-47	Presque Isle	800	4.89	2.62	26.1
IA	71-47	Presque Isle	1070	6.54	2.62	34.9
2NS	63-92	Grange Hall	1200	7.26	2.65	39.1
<b>Total Wt</b>			<b>3070</b>	<b>18.70</b>		<b>100.0</b>

<----- Verify this number is 100%




**Superior Materials, LLC**  
 30701 W. 10 Mile Rd.  
 Suite 500  
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	97.0	100.0	100.0	99.2	0.8	0.8
1"	44.2	100.0	100.0	85.5	13.8	14.5
3/4"	14.1	96.9	100.0	76.5	8.9	23.5
1/2"	4.3	71.5	100.0	65.1	11.4	34.9
3/8"	1.7	39.3	100.0	53.2	11.9	46.8
#4	1.6	4.8	97.5	40.2	13.0	59.8
#8	1.6	2.5	85.3	34.6	5.6	65.4
#16	1.5	2.3	70.6	28.8	5.8	71.2
#30	1.5	2.2	49.2	20.4	8.4	79.6
#50	1.4	2.0	19.6	8.7	11.7	91.3
#100	1.3	1.9	2.3	1.9	6.8	98.1
LBW	0.9	1.2	0.5	0.8	1.1	99.2

\*Maximum % Retained must be above the 3/8" sieve.  
 \*Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation  Batch Plant Gradations  Aggregate Supplier Gradations

**Coarseness Factor:** **72**      **Workability Factor:** **35**

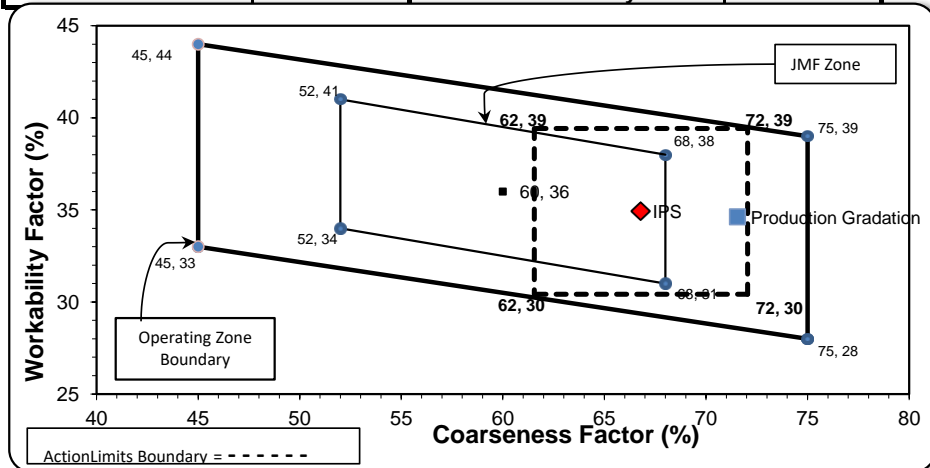

Initial Production Sample (IPS)

**Coarseness Factor:** **67**  
**Workability Factor:** **35**

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	85.0	15.0	15.0
3/4"	72.1	12.9	27.9
1/2"	64.5	7.6	35.5
3/8"	56.5	8.0	43.5
#4	42.7	13.8	57.3
#8	34.9	7.8	65.1
#16	29.0	5.9	71.0
#30	21.0	8.0	79.0
#50	8.2	12.8	91.8
#100	1.6	6.5	98.4
LBW	0.7	0.9	99.3

PREPARED BY:  
 SM, LLC Technical Service

Approved By:

# Aggregate Optimization Chart

**PLANT #:** **P-39**

Sample Date: 2/15/21

Concrete Grade: **P1M**

Contractor: \_\_\_\_\_

Dates Test Represents: 2/16/2021 through 2/22/2021

MDOT No.: \_\_\_\_\_

Agg. Class	Pit #	Source	Weight (SSD)	ft <sup>3</sup>	Specific Gravity	% Contribution
CA	71-47	Presque Isle	970	5.93	2.62	31.6
IA	71-47	Presque Isle	900	5.50	2.62	29.3
2NS	63-92	Grange Hall	1200	7.26	2.65	39.1
<b>Total Wt</b>			<b>3070</b>	<b>18.70</b>		<b>100.0</b>

<----- Verify this number is 100%




**Superior Materials, LLC**  
 30701 W. 10 Mile Rd.  
 Suite 500  
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	98.4	100.0	100.0	99.5	0.5	0.5
1"	45.8	100.0	100.0	82.9	16.6	17.1
3/4"	14.9	98.1	100.0	72.6	10.3	27.4
1/2"	2.8	79.2	100.0	63.2	9.4	36.8
3/8"	2.1	55.0	100.0	55.9	7.3	44.1
#4	1.8	8.8	97.5	41.3	14.6	58.7
#8	1.7	2.4	85.3	34.6	6.7	65.4
#16	1.6	2.1	70.6	28.7	5.9	71.3
#30	1.6	2.0	49.2	20.3	8.4	79.7
#50	1.5	2.0	19.6	8.7	11.6	91.3
#100	1.4	1.9	2.3	1.9	6.8	98.1
LBW	1.2	1.7	0.5	1.1	0.8	98.9

\*Maximum % Retained must be above the 3/8" sieve.  
 \*Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation  Batch Plant Gradations  Aggregate Supplier Gradations

<b>Coarseness Factor:</b>	<b>67</b>	<b>Workability Factor:</b>	<b>35</b>
---------------------------	-----------	----------------------------	-----------

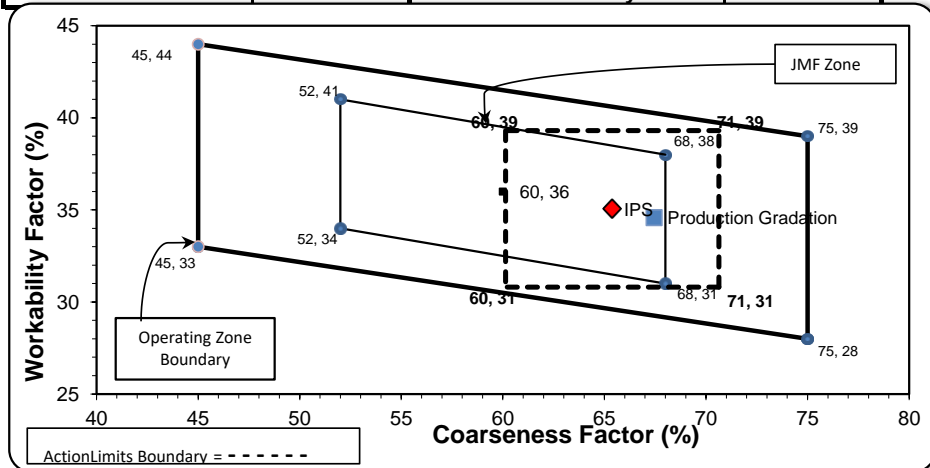

Initial Production Sample (IPS)

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	99.6	0.4	0.4
1"	83.9	15.7	16.1
3/4"	74.1	9.8	25.9
1/2"	64.3	9.7	35.7
3/8"	57.5	6.8	42.5
#4	44.5	13.1	55.5
#8	35.1	9.4	64.9
#16	27.9	7.2	72.1
#30	21.7	6.2	78.3
#50	12.6	9.1	87.4
#100	3.5	9.1	96.5
LBW	1.2	2.4	98.8

PREPARED BY:  
 SM, LLC Technical Service

Approved By:

# Aggregate Optimization Chart

**PLANT #:** **P-02**

Sample Date: 2/15/21 Concrete Grade: **P1M**  
 Dates Test Represents: 2/16/2021 through 2/22/2021

Contractor: \_\_\_\_\_

MDOT No.: \_\_\_\_\_

Agg. Class	Pit #	Source	Weight (SSD)	ft <sup>3</sup>	Specific Gravity	% Contribution
CA	71-47	Presque Isle	800	4.89	2.62	26.1
IA	71-47	Presque Isle	1020	6.24	2.62	33.2
2NS	63-115	Ray Rd	1250	7.56	2.65	40.7
<b>Total Wt</b>			<b>3070</b>	<b>18.69</b>		<b>100.0</b>

<----- Verify this number is 100%




**Superior Materials, LLC**  
 30701 W. 10 Mile Rd.  
 Suite 500  
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	97.0	100.0	100.0	99.2	0.8	0.8
1"	44.2	100.0	100.0	85.5	13.8	14.5
3/4"	14.1	96.9	100.0	76.6	8.9	23.4
1/2"	4.3	71.5	100.0	65.6	11.0	34.4
3/8"	1.7	39.3	100.0	54.2	11.4	45.8
#4	1.6	4.8	97.5	41.7	12.5	58.3
#8	1.6	2.5	82.6	34.9	6.8	65.1
#16	1.5	2.3	67.6	28.7	6.2	71.3
#30	1.5	2.2	51.4	22.1	6.6	77.9
#50	1.4	2.0	24.7	11.1	11.0	88.9
#100	1.3	1.9	3.5	2.4	8.7	97.6
LBW	0.9	1.2	0.5	0.8	1.6	99.2

\*Maximum % Retained must be above the 3/8" sieve.  
 \*Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation  Batch Plant Gradations  Aggregate Supplier Gradations

<b>Coarseness Factor:</b>	<b>70</b>	<b>Workability Factor:</b>	<b>35</b>
---------------------------	-----------	----------------------------	-----------

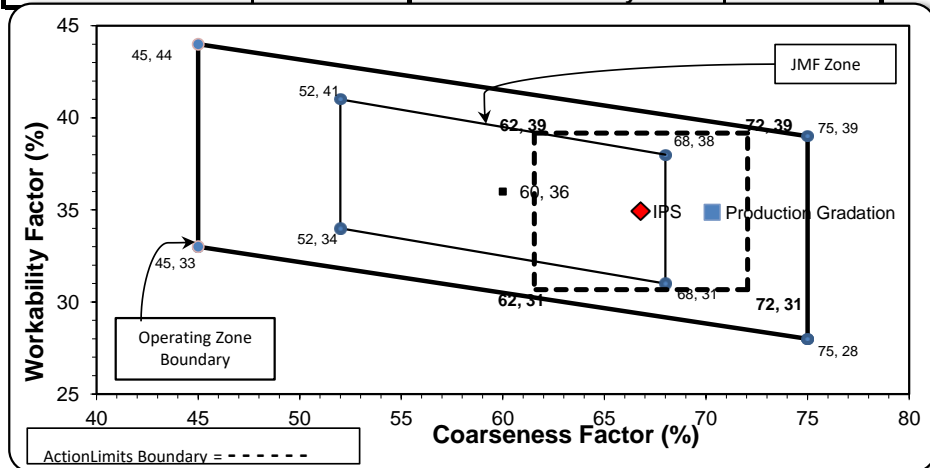

Initial Production Sample (IPS)

<b>Coarseness Factor:</b>	<b>67</b>		
<b>Workability Factor:</b>	<b>35</b>		
Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	85.0	15.0	15.0
3/4"	72.3	12.7	27.7
1/2"	64.5	7.8	35.5
3/8"	56.5	8.0	43.5
#4	42.7	13.8	57.3
#8	34.9	7.8	65.1
#16	29.0	5.9	71.0
#30	21.0	8.0	79.0
#50	8.2	12.8	91.8
#100	1.6	6.5	98.4
LBW	0.7	0.9	99.3

PREPARED BY:  
 SM, LLC Technical Service

Approved By: