

Aggregate Optimization Chart

Production Gradation Report

PLANT #: **P-32**


Contractor: _____

Sample Date: 11/30/20

Concrete Grade: **DM**

Dates Test Represents: 12/1/2020 through 12/7/2020

MDOT No.: _____



Superior Materials, LLC
30701 W. 10 Mile Rd.
Suite 500
Farmington Hills, MI 48336

Aggr. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	Contribution %	
6AA	71-47	Presque Isle	1605	9.82	2.62	55.2	
26A	71-47	Presque Isle	150	0.92	2.62	5.2	
2NS	95-013	Smelter Bay	1150	6.95	2.65	39.6	
Total Wt						2905	100.0


Sieve	6AA	26A	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	99.3	100.0	100.0	99.6	0.4	0.4
3/4"	86.2	100.0	100.0	92.4	7.2	7.6
1/2"	43.5	100.0	100.0	68.8	23.6	31.2
3/8"	22.0	79.7	100.0	55.9	12.9	44.1
#4	3.0	19.4	96.7	40.9	14.9	59.1
#8	2.2	8.8	82.0	34.1	6.8	65.9
#16	2.1	5.1	65.7	27.4	6.7	72.6
#30	2.0	3.9	44.6	19.0	8.5	81.0
#50	2.0	3.1	21.0	9.6	9.4	90.4
#100	1.9	2.5	5.7	3.4	6.1	96.6
LBW	1.7	1.8	1.5	1.6	1.8	98.4

*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max.
 nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max.
 nom. max., #100 and #200 sieves.
 *% Retained must be at least 8% for the 1" sieve when
 a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations

Coarseness Factor: **67** Workability Factor: **34** Adjusted WF: **36.6**

Initial Production Sample (IPS)
 Coarseness Factor: **62** Workability Factor: **36**

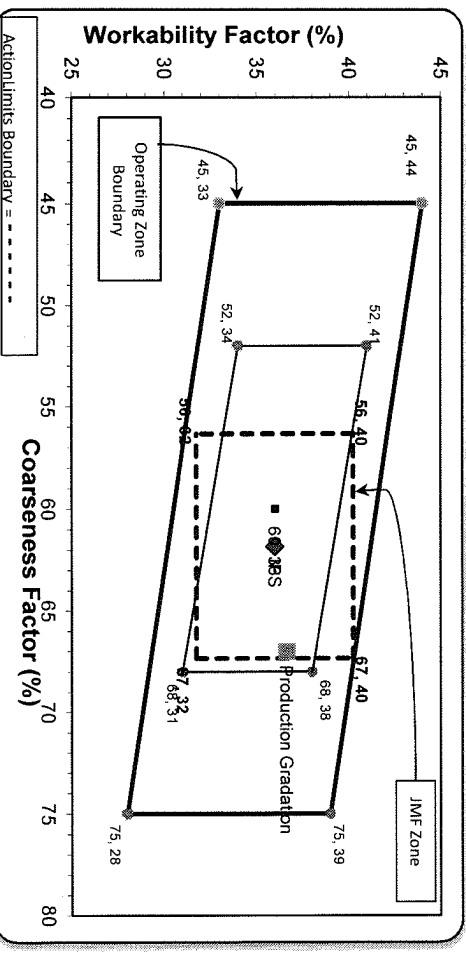

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	100.0	0.0	0.0
3/4"	95.0	5.0	5.0
1/2"	72.3	22.8	27.7
3/8"	60.4	11.8	39.6
#4	42.6	17.8	57.4
#8	36.0	6.6	64.0
#16	29.5	6.5	70.5
#30	20.3	9.2	79.7
#50	9.5	10.8	90.5
#100	3.4	6.1	96.6
LBW	1.3	2.1	98.7

PREPARED BY:
SM, LLC Technical Service

Approved By: _____

Edw. C. Levy Co.

Plant 958-JMT

Product 1054-6AA LS PI

Name/Title Doug Storey / QC Technician

Period: 11/29/2020 - 12/05/2020

Report Date 12/04/2020

Procedure	Sieve/Test	Result	Unit	6AA LS PI Spec
	2" (50mm)	100.0	%	
	1 1/2" (37.5mm)	100.0	%	100-100
	1" (25mm)	99.3	%	95-100
	3/4" (19mm)	86.2	%	
	1/2" (12.5mm)	43.5	%	30-60
	3/8" (9.5mm)	22.0	%	
	#4 (4.75mm)	3.0	%	0-8
	#8 (2.36mm)	2.2	%	
	#16 (1.18mm)	2.1	%	
	#30 (.6mm)	2.0	%	
	#50 (.3mm)	2.0	%	
	#100 (.15mm)	1.9	%	
	#200 (75µm)	1.7	%	
	Wash Loss (#200/75um)	1.5	%	0-2
	Total Moisture	3.2	%	

Edw. C. Levy Co.

Plant 958-JMT

Product 1067-26A Mod LS

Name/Title Doug Storey / QC Technician

Period: 11/29/2020 - 12/05/2020

Report Date 12/04/2020

Procedure	Sieve/Test	Result	Unit	26A Mod LS Spec
	2" (50mm)	100.0	%	
	1 1/2" (37.5mm)	100.0	%	
	1" (25mm)	100.0	%	
	3/4" (19mm)	100.0	%	100-100
	1/2" (12.5mm)	100.0	%	95-100
	3/8" (9.5mm)	79.7	%	60-95
	#4 (4.75mm)	19.4	%	5-30
	#8 (2.36mm)	8.8	%	0-12
	#16 (1.18mm)	5.1	%	
	#30 (.6mm)	3.9	%	
	#50 (.3mm)	3.1	%	
	#100 (.15mm)	2.5	%	
	#200 (75µm)	2.0	%	
	Wash Loss (#200/75um)	1.8	%	0-3
	Total Moisture	5.0	%	

Edw. C. Levy Co.

Plant 958-JMT

Product 1022-2NS GR - Smelter Bay

Name/Title Doug Storey / QC Technician

Period: 11/29/2020 - 12/05/2020

Report Date 12/04/2020

Procedure	Sieve/Test	Result	Unit	2NS GR Spec
	3/8" (9.5mm)	100.0	%	100-100
	#4 (4.75mm)	96.7	%	95-100
	#8 (2.36mm)	82.0	%	65-95
	#16 (1.18mm)	65.7	%	35-75
	#30 (.6mm)	44.6	%	20-55
	#50 (.3mm)	21.0	%	10-30
	#100 (.15mm)	5.7	%	0-10
	#200 (75µm)	2.0	%	
	FM	2.84		2.6-3
	Wash Loss (#200/75um)	1.5	%	0-3
	Total Moisture	5.1	%	