

# Aggregate Optimization Chart

**PLANT #:** **P-32**

Sample Date: 2/3/20

Concrete Grade: **P1M**

Contractor: \_\_\_\_\_

Dates Test Represents: 2/4/2020 through 2/10/2020

MDOT No.: \_\_\_\_\_

Agg. Class	Pit #	Source	Weight (SSD)	ft <sup>3</sup>	Specific Gravity	% Contribution
CA	71-47	Presque Isle	900	5.50	2.62	29.3
IA	71-47	Presque Isle	900	5.50	2.62	29.3
2NS	63-115	Ray Rd	1270	7.68	2.65	41.4
<b>Total Wt</b>			<b>3070</b>	<b>18.69</b>		<b>100.0</b>

<----- Verify this number is 100%




**Superior Materials, LLC**  
 30701 W. 10 Mile Rd.  
 Suite 500  
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	37.7	100.0	100.0	81.7	18.3	18.3
3/4"	10.8	98.2	100.0	73.3	8.4	26.7
1/2"	3.5	74.8	100.0	64.3	9.0	35.7
3/8"	2.6	46.6	100.0	55.8	8.5	44.2
#4	2.3	10.2	96.1	43.4	12.4	56.6
#8	2.0	5.0	78.8	34.7	8.8	65.3
#16	1.9	4.3	62.2	27.5	7.1	72.5
#30	1.9	3.7	46.9	21.0	6.5	79.0
#50	1.8	3.5	25.0	11.9	9.1	88.1
#100	1.7	3.2	5.5	3.7	8.2	96.3
LBW	1.2	2.5	1.2	1.6	2.1	98.4

\*Maximum % Retained must be above the 3/8" sieve.  
 \*Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation  Batch Plant Gradations  Aggregate Supplier Gradations

<b>Coarseness Factor:</b>	<b>68</b>	<b>Workability Factor:</b>	<b>35</b>
---------------------------	-----------	----------------------------	-----------

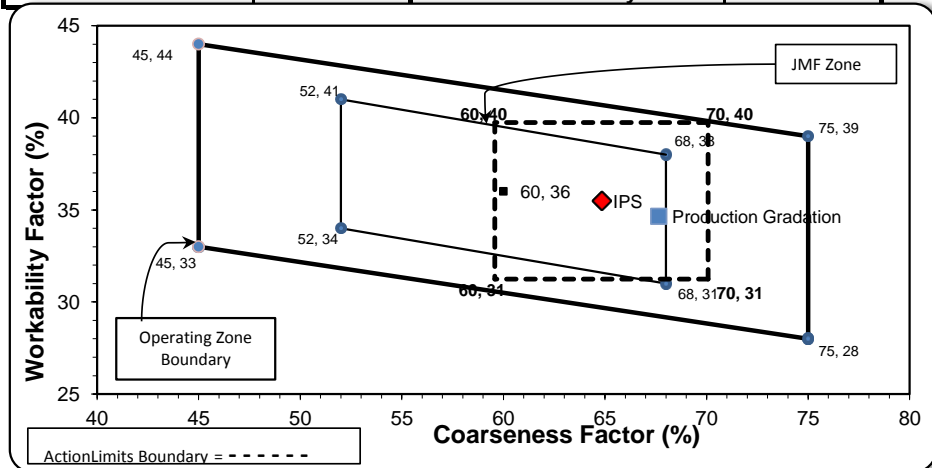

Initial Production Sample (IPS)

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	99.4	0.6	0.6
1"	84.0	15.3	16.0
3/4"	73.5	10.5	26.5
1/2"	65.2	8.2	34.8
3/8"	58.2	7.1	41.8
#4	44.1	14.1	55.9
#8	35.5	8.6	64.5
#16	29.1	6.4	70.9
#30	21.9	7.3	78.1
#50	9.6	12.2	90.4
#100	2.6	7.1	97.4
LBW	1.0	1.6	99.0

PREPARED BY:  
 SM, LLC Technical Service

Approved By:

# Aggregate Optimization Chart

**PLANT #:** **P-36**

Sample Date: 2/3/20

Concrete Grade: **P1M**

Contractor: \_\_\_\_\_

Dates Test Represents: 2/4/2020 through 2/10/2020

MDOT No.: \_\_\_\_\_

Agg. Class	Pit #	Source	Weight (SSD)	ft <sup>3</sup>	Specific Gravity	% Contribution
CA	71-47	Presque Isle	850	5.20	2.62	27.7
IA	71-47	Presque Isle	1020	6.24	2.62	33.2
2NS	63-92	Grange Hall	1200	7.26	2.65	39.1
<b>Total Wt</b>			<b>3070</b>	<b>18.70</b>		<b>100.0</b>

<----- Verify this number is 100%




**Superior Materials, LLC**  
 30701 W. 10 Mile Rd.  
 Suite 500  
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	37.7	100.0	100.0	82.8	17.2	17.2
3/4"	10.8	98.2	100.0	74.7	8.0	25.3
1/2"	3.5	74.8	100.0	64.9	9.8	35.1
3/8"	2.6	46.6	100.0	55.3	9.6	44.7
#4	2.3	10.2	97.5	42.1	13.2	57.9
#8	2.0	5.0	85.3	35.6	6.6	64.4
#16	1.9	4.3	70.3	29.4	6.1	70.6
#30	1.9	3.7	50.7	21.6	7.9	78.4
#50	1.8	3.5	19.6	9.3	12.3	90.7
#100	1.7	3.2	2.7	2.6	6.7	97.4
LBW	1.2	2.5	0.3	1.3	1.3	98.7

\*Maximum % Retained must be above the 3/8" sieve.  
 \*Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation  Batch Plant Gradations  Aggregate Supplier Gradations

<b>Coarseness Factor:</b>	<b>69</b>	<b>Workability Factor:</b>	<b>36</b>
---------------------------	-----------	----------------------------	-----------

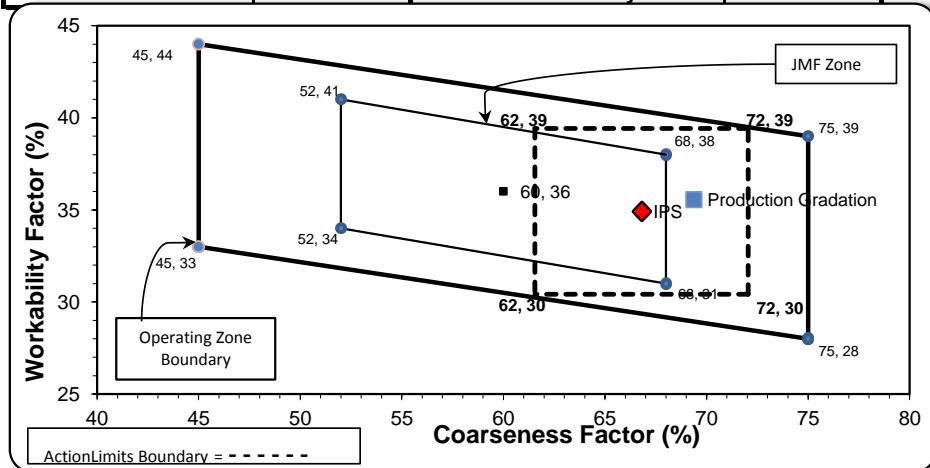

Initial Production Sample (IPS)

<b>Coarseness Factor:</b>	<b>67</b>		
<b>Workability Factor:</b>	<b>35</b>		
Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	85.0	15.0	15.0
3/4"	72.1	12.9	27.9
1/2"	64.5	7.6	35.5
3/8"	56.5	8.0	43.5
#4	42.7	13.8	57.3
#8	34.9	7.8	65.1
#16	29.0	5.9	71.0
#30	21.0	8.0	79.0
#50	8.2	12.8	91.8
#100	1.6	6.5	98.4
LBW	0.7	0.9	99.3

PREPARED BY:  
 SM, LLC Technical Service

Approved By:

# Aggregate Optimization Chart

**PLANT #:** **P-39**

Sample Date: 2/3/20

Concrete Grade: **P1M**

Contractor: \_\_\_\_\_

Dates Test Represents: 2/4/2020 through 2/10/2020

MDOT No.: \_\_\_\_\_

Agg. Class	Pit #	Source	Weight (SSD)	ft <sup>3</sup>	Specific Gravity	% Contribution
CA	71-47	Presque Isle	1000	6.12	2.62	32.6
IA	71-47	Presque Isle	850	5.20	2.62	27.7
2NS	63-92	Grange Hall	1220	7.38	2.65	39.7
<b>Total Wt</b>			<b>3070</b>	<b>18.69</b>		<b>100.0</b>

<----- Verify this number is 100%




**Superior Materials, LLC**  
 30701 W. 10 Mile Rd.  
 Suite 500  
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	45.7	100.0	100.0	82.3	17.7	17.7
3/4"	15.5	98.4	100.0	72.0	10.3	28.0
1/2"	3.8	81.3	100.0	63.5	8.5	36.5
3/8"	2.5	56.5	100.0	56.2	7.3	43.8
#4	1.9	8.1	97.5	41.6	14.6	58.4
#8	1.7	4.6	85.3	35.7	5.9	64.3
#16	1.5	3.3	70.3	29.3	6.4	70.7
#30	1.4	2.8	50.7	21.4	8.0	78.6
#50	1.4	2.5	19.6	8.9	12.4	91.1
#100	1.3	2.3	2.7	2.1	6.8	97.9
LBW	1.1	2.0	0.3	1.0	1.1	99.0

\*Maximum % Retained must be above the 3/8" sieve.  
 \*Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation  Batch Plant Gradations  Aggregate Supplier Gradations

<b>Coarseness Factor:</b>	<b>68</b>	<b>Workability Factor:</b>	<b>36</b>
---------------------------	-----------	----------------------------	-----------

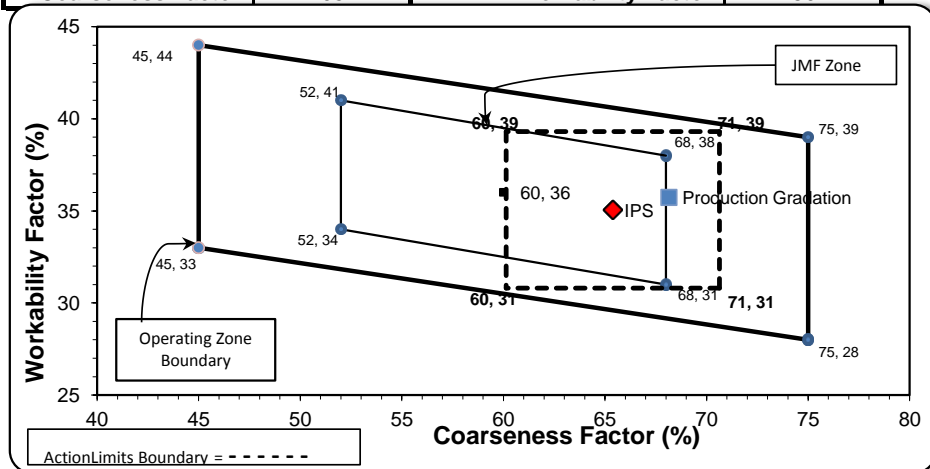

Initial Production Sample (IPS)

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	99.6	0.4	0.4
1"	83.9	15.7	16.1
3/4"	74.1	9.8	25.9
1/2"	64.3	9.7	35.7
3/8"	57.5	6.8	42.5
#4	44.5	13.1	55.5
#8	35.1	9.4	64.9
#16	27.9	7.2	72.1
#30	21.7	6.2	78.3
#50	12.6	9.1	87.4
#100	3.5	9.1	96.5
LBW	1.2	2.4	98.8

PREPARED BY:  
 SM, LLC Technical Service

Approved By:

# Aggregate Optimization Chart

**PLANT #:** P-02

Sample Date: 2/3/20

Concrete Grade: P1M

Contractor: \_\_\_\_\_

Dates Test Represents: 2/4/2020 through 2/10/2020

MDOT No.: \_\_\_\_\_

Agg. Class	Pit #	Source	Weight (SSD)	ft <sup>3</sup>	Specific Gravity	% Contribution
CA	71-47	Presque Isle	870	5.32	2.62	28.3
IA	71-47	Presque Isle	950	5.81	2.62	30.9
2NS	63-115	Ray Rd	1250	7.56	2.65	40.7
<b>Total Wt</b>			<b>3070</b>	<b>18.69</b>		<b>100.0</b>

<----- Verify this number is 100%




**Superior Materials, LLC**  
 30701 W. 10 Mile Rd.  
 Suite 500  
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	37.7	100.0	100.0	82.3	17.7	17.7
3/4"	10.8	98.2	100.0	74.2	8.2	25.8
1/2"	3.5	74.8	100.0	64.9	9.3	35.1
3/8"	2.6	46.6	100.0	55.9	9.0	44.1
#4	2.3	10.2	96.1	42.9	12.9	57.1
#8	2.0	5.0	78.8	34.2	8.7	65.8
#16	1.9	4.3	62.2	27.2	7.0	72.8
#30	1.9	3.7	46.9	20.8	6.4	79.2
#50	1.8	3.5	25.0	11.8	9.0	88.2
#100	1.7	3.2	5.5	3.7	8.1	96.3
LBW	1.2	2.5	1.2	1.6	2.1	98.4

\*Maximum % Retained must be above the 3/8" sieve.  
 \*Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation  Batch Plant Gradations  Aggregate Supplier Gradations

<b>Coarseness Factor:</b>	<b>67</b>	<b>Workability Factor:</b>	<b>34</b>
---------------------------	-----------	----------------------------	-----------

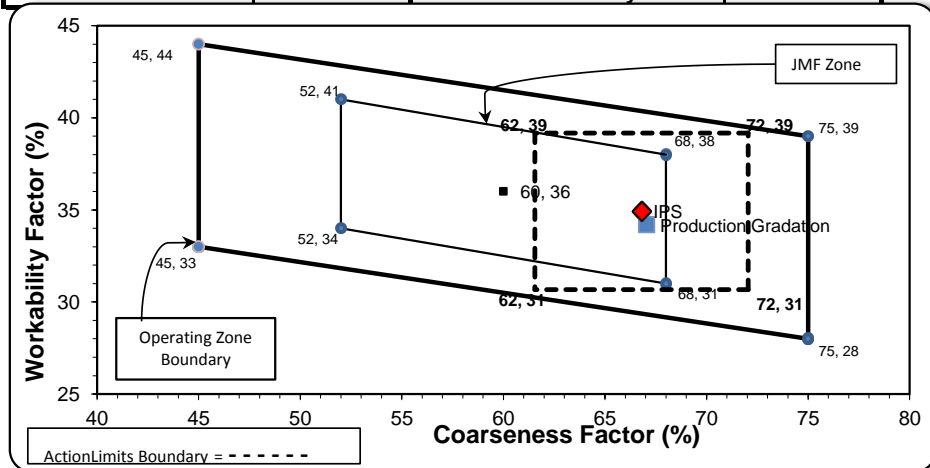

Initial Production Sample (IPS)

<b>Coarseness Factor:</b>		<b>67</b>	
<b>Workability Factor:</b>		<b>35</b>	
Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	85.0	15.0	15.0
3/4"	72.3	12.7	27.7
1/2"	64.5	7.8	35.5
3/8"	56.5	8.0	43.5
#4	42.7	13.8	57.3
#8	34.9	7.8	65.1
#16	29.0	5.9	71.0
#30	21.0	8.0	79.0
#50	8.2	12.8	91.8
#100	1.6	6.5	98.4
LBW	0.7	0.9	99.3

PREPARED BY:  
 SM, LLC Technical Service

Approved By: