

Aggregate Optimization Chart

PLANT #: **P-101**

Sample Date: 6/20/22

Concrete Grade: **P1M, 3500HP**

Dates Test Represents: 6/21/2022 through 6/27/2022

Contractor: _____

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
CA	71-47	Presque Isle	1070	6.54	2.62	34.9
IA	71-47	Presque Isle	800	4.89	2.62	26.1
2NS	75-051	Mid Michigan	1200	7.23	2.66	39.1
Total Wt			3070	18.67		100.0

<---- Verify this number is 100%



Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	96.8	100.0	100.0	98.9	1.1	1.1
1"	47.2	100.0	100.0	81.6	17.3	18.4
3/4"	11.9	98.4	100.0	68.9	12.7	31.1
1/2"	3.0	83.2	100.0	61.8	7.1	38.2
3/8"	2.3	63.4	100.0	56.4	5.4	43.6
#4	1.9	18.1	98.8	44.0	12.4	56.0
#8	1.7	4.4	83.4	34.3	9.7	65.7
#16	1.7	2.9	66.9	27.5	6.8	72.5
#30	1.6	2.5	49.8	20.7	6.8	79.3
#50	1.6	2.4	24.3	10.7	10.0	89.3
#100	1.4	2.2	6.5	3.6	7.1	96.4
LBW	1.3	2.0	0.9	1.3	2.3	98.7

*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.


Production Gradation Batch Plant Gradations Aggregate Supplier Gradations

Coarseness Factor:	66	Workability Factor:	34
---------------------------	-----------	----------------------------	-----------

Initial Production Sample (IPS)

Coarseness Factor:	66
Workability Factor:	35

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	99.6	0.4	0.4
1"	84.3	15.3	15.7
3/4"	74.8	9.6	25.2
1/2"	64.3	10.4	35.7
3/8"	56.8	7.5	43.2
#4	43.0	13.8	57.0
#8	34.9	8.1	65.1
#16	26.4	8.5	73.6
#30	19.9	6.5	80.1
#50	10.4	9.5	89.6
#100	3.4	7.0	96.6
LBW	1.2	2.2	98.8

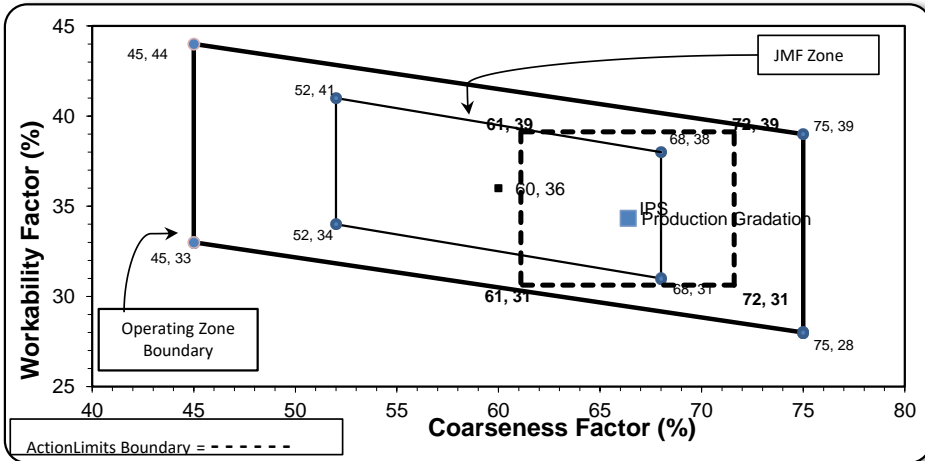

PREPARED BY:
 SM, LLC Technical Service

Approved By:

Aggregate Optimization Chart

PLANT #: **P-102**

Sample Date: 6/20/22

Concrete Grade: **P1M, 3500HP**

Dates Test Represents: 6/21/2022 through 6/27/2022

Contractor: _____

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
CA	58-003	Stoneco	1370	8.16	2.69	43.9
IA	58-003	Stoneco	550	3.28	2.69	17.6
2NS	81-019	Pleasant Lake	1200	7.26	2.65	38.5
Total Wt			3120	18.70		100.0

<----- Verify this number is 100%




Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	66.3	100.0	100.0	85.2	14.8	14.8
3/4"	38.7	100.0	100.0	73.1	12.1	26.9
1/2"	17.4	95.0	100.0	62.8	10.2	37.2
3/8"	11.7	78.5	100.0	57.4	5.4	42.6
#4	3.0	24.4	99.4	43.8	13.6	56.2
#8	1.8	6.1	81.4	33.2	10.7	66.8
#16	1.2	3.0	63.2	25.4	7.8	74.6
#30	1.1	2.0	45.3	18.3	7.1	81.7
#50	1.0	1.8	22.7	9.5	8.8	90.5
#100	1.0	1.6	7.3	3.5	6.0	96.5
LBW	1.1	1.7	1.4	1.3	2.2	98.7

*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations

Coarseness Factor: **64** **Workability Factor:** **33**

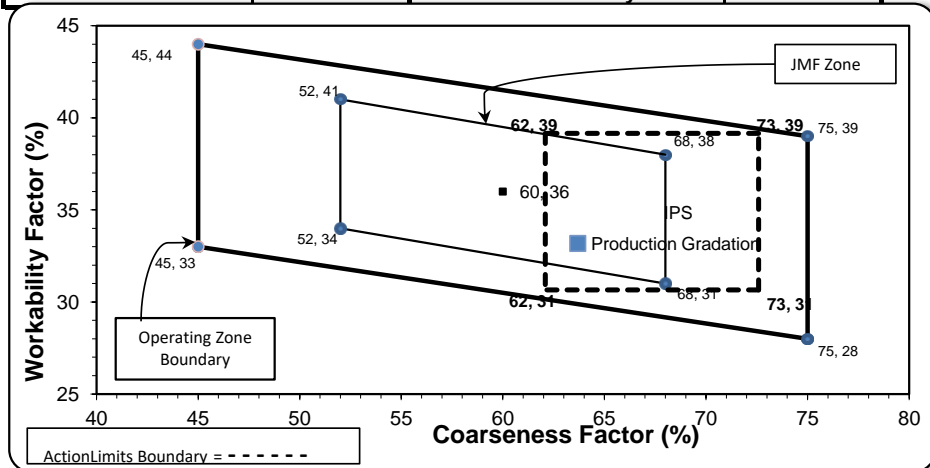

Initial Production Sample (IPS)

Coarseness Factor: **67**
Workability Factor: **35**

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	85.5	14.5	14.5
3/4"	73.4	12.1	26.6
1/2"	61.0	12.4	39.0
3/8"	56.2	4.8	43.8
#4	43.1	13.1	56.9
#8	34.9	8.2	65.1
#16	29.4	5.5	70.6
#30	21.6	7.8	78.4
#50	8.1	13.4	91.9
#100	2.2	5.9	97.8
LBW	1.4	0.8	98.6

PREPARED BY:
 SM, LLC Technical Service

Approved By:

Aggregate Optimization Chart

PLANT #: **P-103**

Sample Date: 6/20/22

Concrete Grade: **P1M, 3500HP**

Dates Test Represents: 6/21/2022 through 6/27/2022

Contractor: _____

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
CA	58-003	Stoneco	1370	8.16	2.69	43.9
IA	58-003	Stoneco	550	3.28	2.69	17.6
2NS	81-019	Pleasant Lake	1200	7.26	2.65	38.5
Total Wt			3120	18.70		100.0

<----- Verify this number is 100%




Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	66.3	100.0	100.0	85.2	14.8	14.8
3/4"	38.7	100.0	100.0	73.1	12.1	26.9
1/2"	17.4	95.0	100.0	62.8	10.2	37.2
3/8"	11.7	78.5	100.0	57.4	5.4	42.6
#4	3.0	24.4	99.4	43.8	13.6	56.2
#8	1.8	6.1	81.4	33.2	10.7	66.8
#16	1.2	3.0	63.2	25.4	7.8	74.6
#30	1.1	2.0	45.3	18.3	7.1	81.7
#50	1.0	1.8	22.7	9.5	8.8	90.5
#100	1.0	1.6	7.3	3.5	6.0	96.5
LBW	1.1	1.7	1.4	1.3	2.2	98.7

*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations

Coarseness Factor: **64** **Workability Factor:** **33**

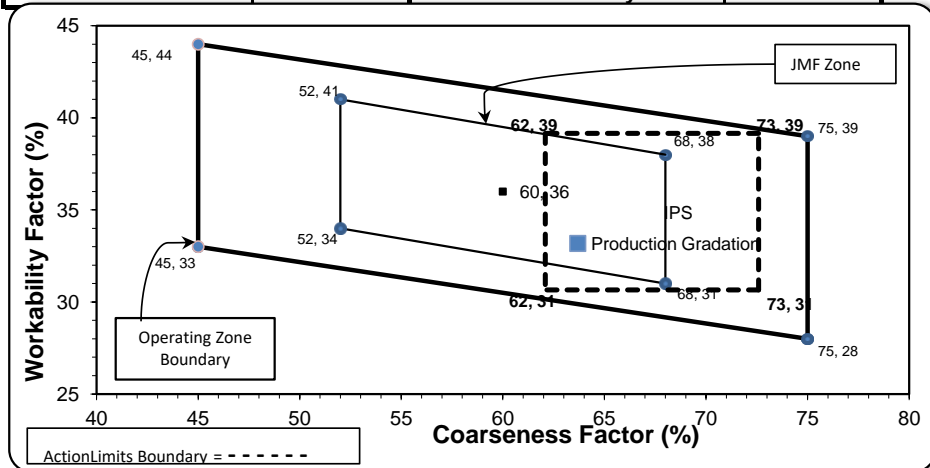

Initial Production Sample (IPS)

Coarseness Factor: **67**
Workability Factor: **35**

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	85.5	14.5	14.5
3/4"	73.4	12.1	26.6
1/2"	61.0	12.4	39.0
3/8"	56.2	4.8	43.8
#4	43.1	13.1	56.9
#8	34.9	8.2	65.1
#16	29.4	5.5	70.6
#30	21.6	7.8	78.4
#50	8.1	13.4	91.9
#100	2.2	5.9	97.8
LBW	1.4	0.8	98.6

PREPARED BY:
 SM, LLC Technical Service

Approved BY:

Aggregate Optimization Chart

PLANT #: **P-12**

Sample Date: 6/20/22

Concrete Grade: **P1M, 3500HP**

Dates Test Represents: 6/21/2022 through 6/27/2022

Contractor: _____

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
CA	71-47	Presque Isle	900	5.50	2.62	29.3
IA	71-47	Presque Isle	920	5.63	2.62	30.0
2NS	63-115	Ray Rd	1250	7.56	2.65	40.7
Total Wt			3070	18.69		100.0

<----- Verify this number is 100%




Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	98.5	100.0	100.0	99.6	0.4	0.4
1"	42.9	100.0	100.0	83.3	16.3	16.7
3/4"	10.4	97.8	100.0	73.1	10.2	26.9
1/2"	1.9	68.2	100.0	61.7	11.4	38.3
3/8"	1.5	40.2	100.0	53.2	8.5	46.8
#4	1.5	4.3	97.3	41.3	11.9	58.7
#8	1.5	1.7	82.0	34.3	7.0	65.7
#16	1.4	1.6	65.0	27.4	7.0	72.6
#30	1.4	1.6	47.9	20.4	7.0	79.6
#50	1.4	1.5	25.0	11.0	9.4	89.0
#100	1.3	1.4	5.3	3.0	8.1	97.0
LBW	1.1	1.0	0.9	1.0	2.0	99.0

*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations

Coarseness Factor:	71	Workability Factor:	34
---------------------------	-----------	----------------------------	-----------

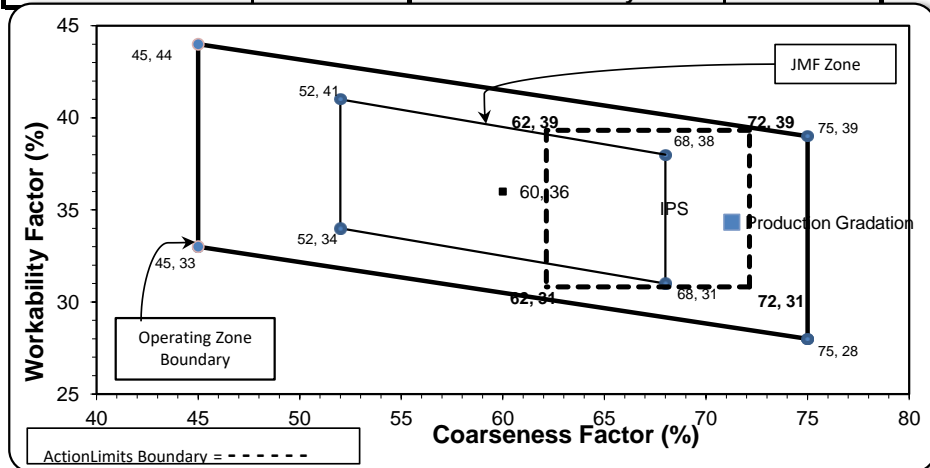

Initial Production Sample (IPS)

Coarseness Factor:	67
Workability Factor:	35

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	99.6	0.4	0.4
1"	83.9	15.7	16.1
3/4"	74.0	9.8	26.0
1/2"	63.7	10.3	36.3
3/8"	56.4	7.3	43.6
#4	43.0	13.4	57.0
#8	35.1	7.9	64.9
#16	29.0	6.1	71.0
#30	20.9	8.0	79.1
#50	8.1	12.8	91.9
#100	1.6	6.5	98.4
LBW	0.9	0.8	99.1

PREPARED BY:
 SM, LLC Technical Service

Approved By:

Aggregate Optimization Chart

PLANT #: **P-32**

Sample Date: 6/20/22

Concrete Grade: **P1M, 3500HP**

Dates Test Represents: 6/21/2022 through 6/27/2022

Contractor: _____

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
CA	71-47	Presque Isle	850	5.20	2.62	27.7
IA	71-47	Presque Isle	970	5.93	2.62	31.6
2NS	95-013	Smelter Bay	1250	7.56	2.65	40.7
Total Wt			3070	18.69		100.0

<----- Verify this number is 100%




Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	98.5	100.0	100.0	99.6	0.4	0.4
1"	42.9	100.0	100.0	84.2	15.4	15.8
3/4"	10.4	97.8	100.0	74.5	9.7	25.5
1/2"	1.9	68.2	100.0	62.8	11.7	37.2
3/8"	1.5	40.2	100.0	53.8	9.0	46.2
#4	1.5	4.3	95.5	40.7	13.2	59.3
#8	1.5	1.7	82.9	34.7	6.0	65.3
#16	1.4	1.6	68.2	28.7	6.0	71.3
#30	1.4	1.6	48.9	20.8	7.9	79.2
#50	1.4	1.5	23.6	10.5	10.3	89.5
#100	1.3	1.4	6.4	3.4	7.1	96.6
LBW	1.1	1.0	0.6	0.9	2.5	99.1

*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations

Coarseness Factor: **71** **Workability Factor:** **35**

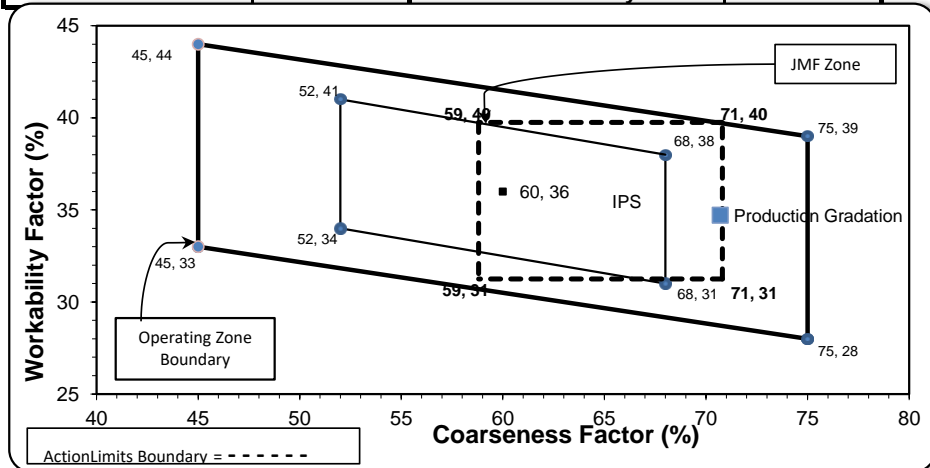

Initial Production Sample (IPS)

Coarseness Factor: **65**
Workability Factor: **36**

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	99.0	0.6	0.6
1"	84.0	15.3	16.0
3/4"	73.5	10.5	26.5
1/2"	65.2	8.2	34.8
3/8"	58.2	7.1	41.8
#4	44.1	14.1	55.9
#8	35.5	8.6	64.5
#16	29.1	6.4	70.9
#30	21.9	7.3	78.1
#50	9.6	12.2	90.4
#100	2.6	7.1	97.4
LBW	1.0	1.6	99.0

PREPARED BY:
 SM, LLC Technical Service

Approved By:

Aggregate Optimization Chart

PLANT #: **P-35**

Sample Date: 6/20/22

Concrete Grade: **P1M, 3500HP**

Dates Test Represents: 6/21/2022 through 6/27/2022

Contractor: _____

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
CA	58-003	Stoneco	1370	8.16	2.69	43.9
IA	58-003	Stoneco	550	3.28	2.69	17.6
2NS	81-019	Pleasant Lake	1200	7.26	2.65	38.5
Total Wt			3120	18.70		100.0

<----- Verify this number is 100%




Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	66.3	100.0	100.0	85.2	14.8	14.8
3/4"	38.7	100.0	100.0	73.1	12.1	26.9
1/2"	17.4	95.0	100.0	62.8	10.2	37.2
3/8"	11.7	78.5	100.0	57.4	5.4	42.6
#4	3.0	24.4	99.4	43.8	13.6	56.2
#8	1.8	6.1	81.4	33.2	10.7	66.8
#16	1.2	3.0	63.2	25.4	7.8	74.6
#30	1.1	2.0	45.3	18.3	7.1	81.7
#50	1.0	1.8	22.7	9.5	8.8	90.5
#100	1.0	1.6	7.3	3.5	6.0	96.5
LBW	1.1	1.7	1.4	1.3	2.2	98.7

*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations

Coarseness Factor: **64** **Workability Factor:** **33**

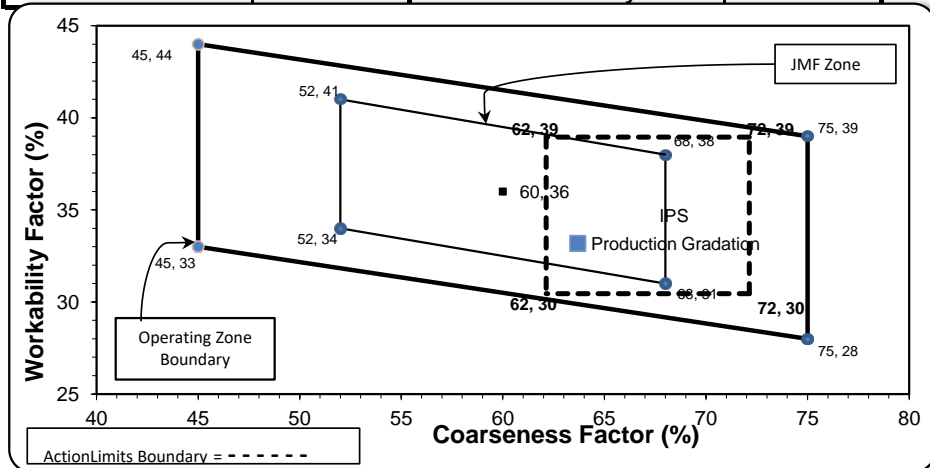

Initial Production Sample (IPS)

Coarseness Factor: **67**
Workability Factor: **35**

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	86.9	13.1	13.1
3/4"	76.1	10.8	23.9
1/2"	63.7	12.4	36.3
3/8"	56.2	7.5	43.8
#4	43.2	13.0	56.8
#8	34.7	8.5	65.3
#16	27.5	7.2	72.5
#30	20.6	7.0	79.4
#50	9.0	11.6	91.0
#100	2.1	6.9	97.9
LBW	1.0	1.1	99.0

PREPARED BY:
 SM, LLC Technical Service

Approved By:

Aggregate Optimization Chart

PLANT #: **P-36**

Sample Date: 6/20/22

Concrete Grade: **P1M, 3500HP**

Dates Test Represents: 6/21/2022 through 6/27/2022

Contractor: _____

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
CA	71-47	Presque Isle	900	5.50	2.62	29.3
IA	71-47	Presque Isle	970	5.93	2.62	31.6
2NS	63-92	Grange Hall	1200	7.26	2.65	39.1
Total Wt			3070	18.70		100.0

<----- Verify this number is 100%




Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	98.5	100.0	100.0	99.6	0.4	0.4
1"	42.9	100.0	100.0	83.3	16.3	16.7
3/4"	10.4	97.8	100.0	73.0	10.2	27.0
1/2"	1.9	68.2	100.0	61.2	11.8	38.8
3/8"	1.5	40.2	100.0	52.2	9.0	47.8
#4	1.5	4.3	97.2	39.8	12.4	60.2
#8	1.5	1.7	82.0	33.0	6.8	67.0
#16	1.4	1.6	67.0	27.1	5.9	72.9
#30	1.4	1.6	50.1	20.5	6.6	79.5
#50	1.4	1.5	24.6	10.5	10.0	89.5
#100	1.3	1.4	2.7	1.9	8.6	98.1
LBW	1.1	1.0	0.0	0.6	1.2	99.4

*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations

Coarseness Factor:	71	Workability Factor:	33
---------------------------	-----------	----------------------------	-----------

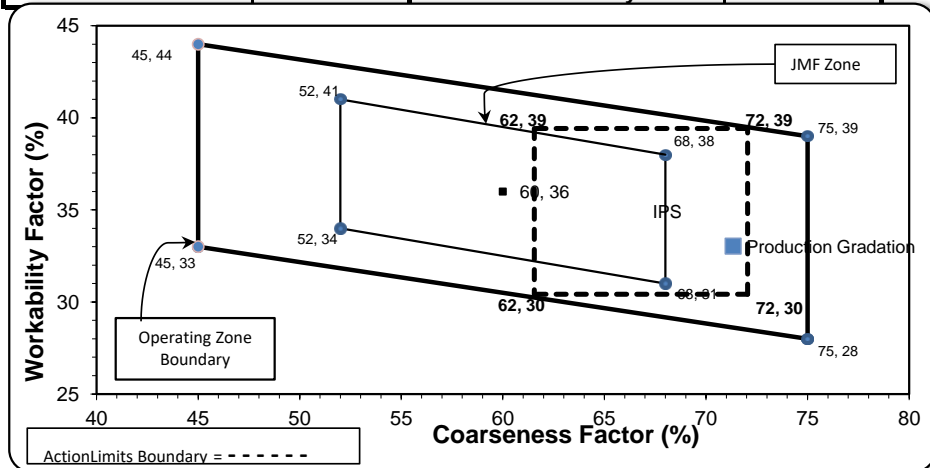

Initial Production Sample (IPS)

Coarseness Factor:	67		
Workability Factor:	35		
Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	85.0	15.0	15.0
3/4"	72.1	12.9	27.9
1/2"	64.5	7.6	35.5
3/8"	56.5	8.0	43.5
#4	42.7	13.8	57.3
#8	34.9	7.8	65.1
#16	29.0	5.9	71.0
#30	21.0	8.0	79.0
#50	8.2	12.8	91.8
#100	1.6	6.5	98.4
LBW	0.7	0.9	99.3

PREPARED BY:
 SM, LLC Technical Service

Approved By:

Aggregate Optimization Chart

PLANT #: **P-39**

Sample Date: 6/20/22

Concrete Grade: **P1M, 3500HP**

Dates Test Represents: 6/21/2022 through 6/27/2022

Contractor: _____

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
CA	71-47	Presque Isle	1020	6.24	2.62	33.2
IA	71-47	Presque Isle	800	4.89	2.62	26.1
2NS	44-051	Krake Willis Rd	1250	7.56	2.65	40.7
Total Wt			3070	18.69		100.0

<----- Verify this number is 100%




Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	96.8	100.0	100.0	98.9	1.1	1.1
1"	47.2	100.0	100.0	82.5	16.5	17.5
3/4"	11.9	98.4	100.0	70.3	12.1	29.7
1/2"	3.0	83.2	100.0	63.4	6.9	36.6
3/8"	2.3	63.4	100.0	58.0	5.4	42.0
#4	1.9	18.1	96.3	44.6	13.4	55.4
#8	1.7	4.4	80.1	34.3	10.2	65.7
#16	1.7	2.9	63.8	27.3	7.0	72.7
#30	1.6	2.5	45.8	19.8	7.5	80.2
#50	1.6	2.4	21.2	9.8	10.0	90.2
#100	1.4	2.2	7.0	3.9	5.9	96.1
LBW	1.3	2.0	1.4	1.5	2.4	98.5

*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations

Coarseness Factor: **64** **Workability Factor:** **34**

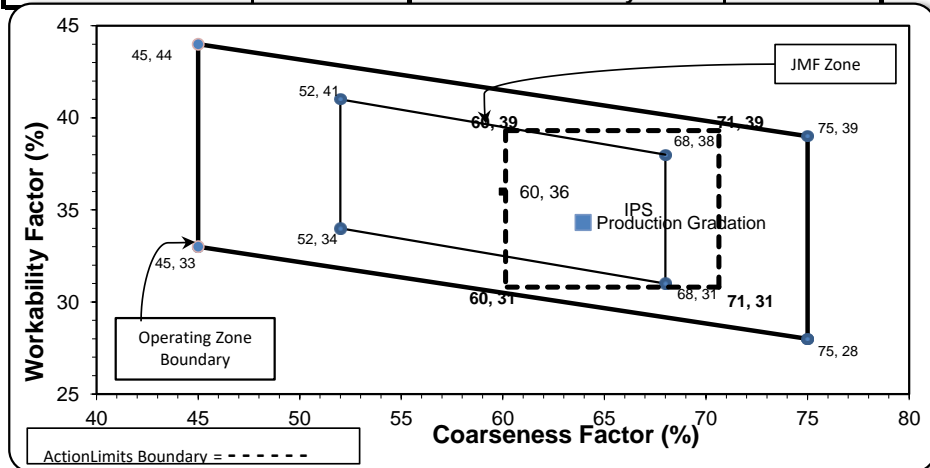

Initial Production Sample (IPS)

Coarseness Factor: **65**
Workability Factor: **35**

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	99.6	0.4	0.4
1"	83.9	15.7	16.1
3/4"	74.1	9.8	25.9
1/2"	64.3	9.7	35.7
3/8"	57.5	6.8	42.5
#4	44.5	13.1	55.5
#8	35.1	9.4	64.9
#16	27.9	7.2	72.1
#30	21.7	6.2	78.3
#50	12.6	9.1	87.4
#100	3.5	9.1	96.5
LBW	1.2	2.4	98.8

PREPARED BY:
 SM, LLC Technical Service

Approved By:

Aggregate Optimization Chart

PLANT #: **P-02**

Sample Date: 6/20/22

Concrete Grade: **P1M, 3500HP**

Dates Test Represents: 6/21/2022 through 6/27/2022

Contractor: _____

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
CA	71-47	Presque Isle	900	5.50	2.62	29.3
IA	71-47	Presque Isle	920	5.63	2.62	30.0
2NS	63-115	Ray Rd	1250	7.56	2.65	40.7
Total Wt			3070	18.69		100.0

<----- Verify this number is 100%




Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	98.5	100.0	100.0	99.6	0.4	0.4
1"	42.9	100.0	100.0	83.3	16.3	16.7
3/4"	10.4	97.8	100.0	73.1	10.2	26.9
1/2"	1.9	68.2	100.0	61.7	11.4	38.3
3/8"	1.5	40.2	100.0	53.2	8.5	46.8
#4	1.5	4.3	97.3	41.3	11.9	58.7
#8	1.5	1.7	82.0	34.3	7.0	65.7
#16	1.4	1.6	65.0	27.4	7.0	72.6
#30	1.4	1.6	47.9	20.4	7.0	79.6
#50	1.4	1.5	25.0	11.0	9.4	89.0
#100	1.3	1.4	5.3	3.0	8.1	97.0
LBW	1.1	1.0	0.9	1.0	2.0	99.0

*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations

Coarseness Factor:	71	Workability Factor:	34
---------------------------	-----------	----------------------------	-----------

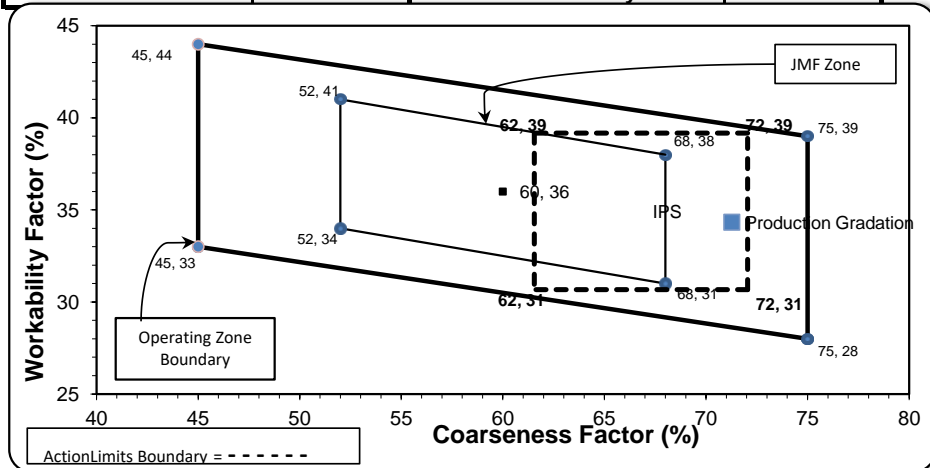

Initial Production Sample (IPS)

Coarseness Factor:	67
Workability Factor:	35

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	85.0	15.0	15.0
3/4"	72.3	12.7	27.7
1/2"	64.5	7.8	35.5
3/8"	56.5	8.0	43.5
#4	42.7	13.8	57.3
#8	34.9	7.8	65.1
#16	29.0	5.9	71.0
#30	21.0	8.0	79.0
#50	8.2	12.8	91.8
#100	1.6	6.5	98.4
LBW	0.7	0.9	99.3

PREPARED BY:
 SM, LLC Technical Service

Approved By: