

Aggregate Optimization Chart

PLANT #: **P-101**

Sample Date: 7/11/22

Concrete Grade: **S2M, 3500HP**

Dates Test Represents: 7/12/2022 through 7/18/2022

Contractor: _____

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
6AA	71-47	Presque Isle	1625	9.94	2.62	53.2
26A	71-47	Presque Isle	200	1.22	2.62	6.5
2NS	75-051	Mid Michigan	1230	7.41	2.66	40.3
Total Wt			3055	18.57		100.0

<---- Verify this number is 100%



Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Sieve	6AA	26A	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	96.4	100.0	100.0	98.1	1.9	1.9
3/4"	84.0	100.0	100.0	91.5	6.6	8.5
1/2"	43.3	98.7	100.0	69.8	21.7	30.2
3/8"	28.2	88.6	100.0	61.1	8.7	38.9
#4	5.8	22.2	98.9	44.4	16.7	55.6
#8	2.2	5.0	83.2	35.0	9.4	65.0
#16	1.7	3.2	66.7	28.0	7.0	72.0
#30	1.6	2.8	51.0	21.6	6.4	78.4
#50	1.5	2.4	26.9	11.8	9.8	88.2
#100	1.4	2.2	7.0	3.7	8.1	96.3
LBW	1.3	2.0	0.8	1.1	2.6	98.9


*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations

Coarseness Factor:	60	Workability Factor:	35
---------------------------	-----------	----------------------------	-----------

Initial Production Sample (IPS)

Coarseness Factor:	64		
Workability Factor:	35		
Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	100.0	0.0	0.0
3/4"	93.9	6.1	6.1
1/2"	71.4	22.5	28.6
3/8"	59.0	12.4	41.0
#4	45.1	13.9	54.9
#8	35.5	9.6	64.5
#16	28.3	7.2	71.7
#30	21.3	6.9	78.7
#50	11.0	10.3	89.0
#100	3.4	7.6	96.6
LBW	1.1	2.3	98.9

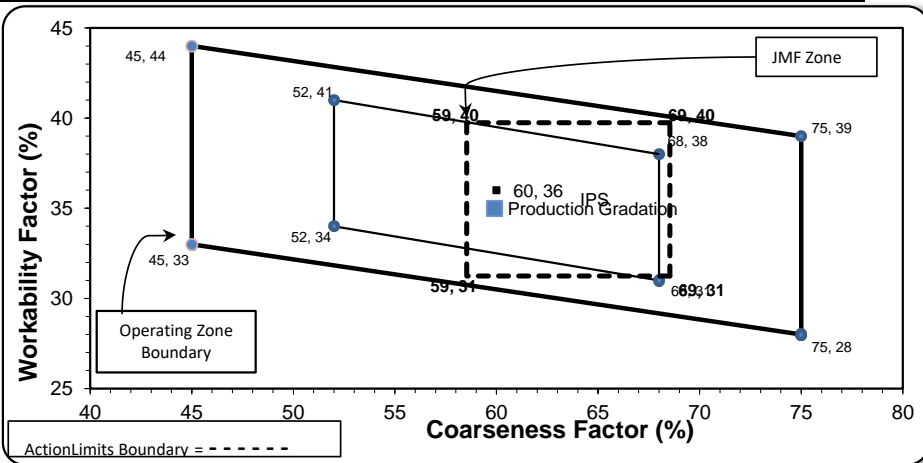

PREPARED BY:
 SM, LLC Technical Service

Approved By:

Aggregate Optimization Chart

PLANT #: **P-102**

Sample Date: 7/11/22

Concrete Grade: **S2M, 3500HP**

Dates Test Represents: 7/12/2022 through 7/18/2022

Contractor: _____

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
6AA	58-003	Stoneco	1750	10.43	2.69	56.5
26A	58-003	Stoneco	150	0.89	2.69	4.8
2NS	81-019	Pleasant Lake	1200	7.26	2.65	38.7
Total Wt			3100	18.58		100.0

<----- Verify this number is 100%




Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Sieve	6AA	26A	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	100.0	100.0	100.0	100.0	0.0	0.0
3/4"	90.6	100.0	100.0	94.7	5.3	5.3
1/2"	51.8	99.8	100.0	72.8	21.9	27.2
3/8"	32.7	89.3	100.0	61.5	11.3	38.5
#4	5.4	19.6	98.8	42.2	19.2	57.8
#8	2.3	6.6	83.8	34.1	8.2	65.9
#16	1.5	4.0	66.2	26.7	7.4	73.3
#30	1.4	3.1	48.5	19.7	7.0	80.3
#50	1.2	2.9	24.4	10.3	9.5	89.7
#100	1.2	2.7	7.4	3.7	6.6	96.3
LBW	1.0	2.6	1.3	1.2	2.5	98.8

*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations

Coarseness Factor:	58	Workability Factor:	34
---------------------------	-----------	----------------------------	-----------

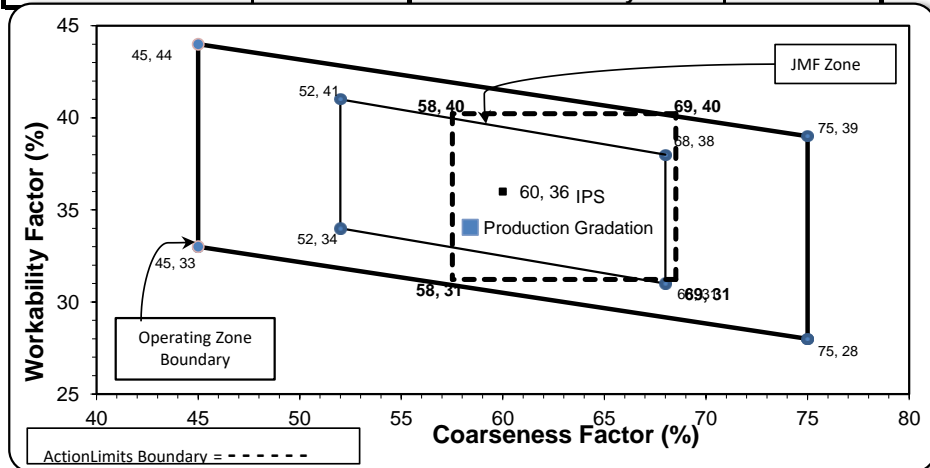

Intial Production Sample (IPS)

Coarseness Factor:	63		
Workability Factor:	36		
Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	99.2	0.8	0.8
3/4"	90.9	8.3	9.1
1/2"	71.3	19.6	28.7
3/8"	59.5	11.8	40.5
#4	43.8	15.7	56.2
#8	35.7	8.1	64.3
#16	27.0	8.7	73.0
#30	18.6	8.4	81.4
#50	6.8	11.8	93.2
#100	1.4	5.4	98.6
LBW	0.6	0.8	99.4

PREPARED BY:
 SM, LLC Technical Service

Approved By:

Aggregate Optimization Chart

PLANT #: **P-103**

Sample Date: 7/11/22

Concrete Grade: **S2M, 3500HP**

Dates Test Represents: 7/12/2022 through 7/18/2022

Contractor: _____

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
6AA	58-003	Stoneco	1750	10.43	2.69	56.5
26A	58-003	Stoneco	150	0.89	2.69	4.8
2NS	81-019	Pleasant Lake	1200	7.26	2.65	38.7
Total Wt			3100	18.58		100.0

<----- Verify this number is 100%




Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Sieve	6AA	26A	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	100.0	100.0	100.0	100.0	0.0	0.0
3/4"	90.6	100.0	100.0	94.7	5.3	5.3
1/2"	51.8	99.8	100.0	72.8	21.9	27.2
3/8"	32.7	89.3	100.0	61.5	11.3	38.5
#4	5.4	19.6	98.8	42.2	19.2	57.8
#8	2.3	6.6	83.8	34.1	8.2	65.9
#16	1.5	4.0	66.2	26.7	7.4	73.3
#30	1.4	3.1	48.5	19.7	7.0	80.3
#50	1.2	2.9	24.4	10.3	9.5	89.7
#100	1.2	2.7	7.4	3.7	6.6	96.3
LBW	1.0	2.6	1.3	1.2	2.5	98.8

*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations

Coarseness Factor:	58	Workability Factor:	34
---------------------------	-----------	----------------------------	-----------

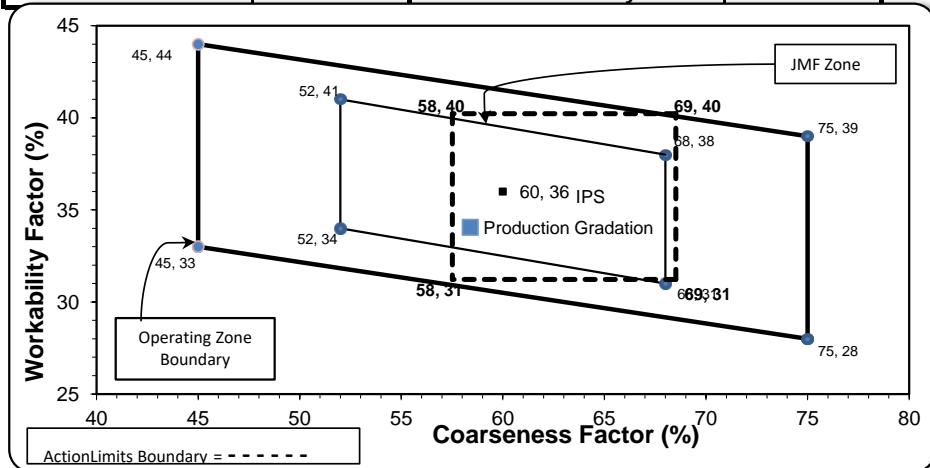

Intial Production Sample (IPS)

Coarseness Factor:	63
Workability Factor:	36

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	99.2	0.8	0.8
3/4"	90.9	8.3	9.1
1/2"	71.3	19.6	28.7
3/8"	59.5	11.8	40.5
#4	43.8	15.7	56.2
#8	35.7	8.1	64.3
#16	27.0	8.7	73.0
#30	18.6	8.4	81.4
#50	6.8	11.8	93.2
#100	1.4	5.4	98.6
LBW	0.6	0.8	99.4

PREPARED BY:
 SM, LLC Technical Service

Approved BY:

Aggregate Optimization Chart

PLANT #: **P-32**

Sample Date: 7/11/22

Concrete Grade: **S2M, 3500HP**

Dates Test Represents: 7/12/2022 through 7/18/2022

Contractor: _____

MDOT No.: _____



Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
6AA	71-47	Presque Isle	1820	11.13	2.62	59.7
26A	71-47	Presque Isle	0	0.00	2.62	0.0
2NS	95-013	Smelter Bay	1230	7.44	2.65	40.3
Total Wt			3050	18.57		100.0


<----- Verify this number is 100%

Sieve	6AA	26A	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	100.0	100.0	100.0	100.0	0.0	0.0
3/4"	85.1	100.0	100.0	91.1	8.9	8.9
1/2"	54.6	95.8	100.0	72.9	18.2	27.1
3/8"	32.1	82.3	100.0	59.5	13.4	40.5
#4	5.0	29.1	96.2	41.8	17.7	58.2
#8	2.3	11.0	83.1	34.9	6.9	65.1
#16	2.0	4.9	68.2	28.7	6.2	71.3
#30	1.9	3.5	49.7	21.2	7.5	78.8
#50	1.8	3.1	25.5	11.4	9.8	88.6
#100	1.7	2.9	8.2	4.3	7.0	95.7
LBW	1.3	2.5	1.6	1.4	2.9	98.6

*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations

Coarseness Factor:	62	Workability Factor:	35
---------------------------	-----------	----------------------------	-----------

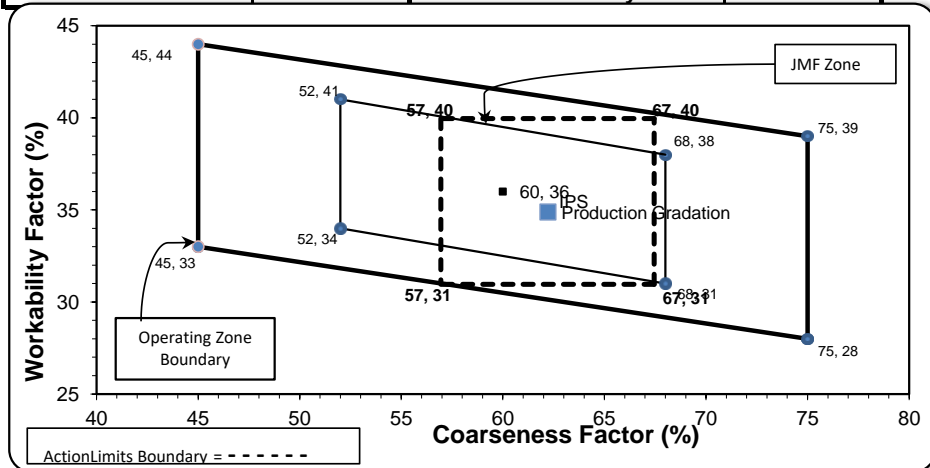

Initial Production Sample (IPS)

Coarseness Factor:	62		
Workability Factor:	35		
Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	100.0	0.0	0.0
3/4"	94.0	6.0	6.0
1/2"	70.2	23.7	29.8
3/8"	59.9	10.4	40.1
#4	42.7	17.2	57.3
#8	35.5	7.2	64.5
#16	28.4	7.0	71.6
#30	19.2	9.2	80.8
#50	8.9	10.3	91.1
#100	3.1	5.9	96.9
LBW	1.4	1.7	98.6

PREPARED BY:
 SM, LLC Technical Service

Approved By:

Aggregate Optimization Chart

PLANT #: **P-35**

Sample Date: 7/11/22

Concrete Grade: **S2M, 3500HP**

Dates Test Represents: 7/12/2022 through 7/18/2022

Contractor: _____

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
6AA	58-003	Stoneco	1750	10.43	2.69	56.5
26A	58-003	Stoneco	150	0.89	2.69	4.8
2NS	81-019	Pleasant Lake	1200	7.26	2.65	38.7
Total Wt			3100	18.58		100.0

<----- Verify this number is 100%




Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Sieve	6AA	26A	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	100.0	100.0	100.0	100.0	0.0	0.0
3/4"	90.6	100.0	100.0	94.7	5.3	5.3
1/2"	51.8	99.8	100.0	72.8	21.9	27.2
3/8"	32.7	89.3	100.0	61.5	11.3	38.5
#4	5.4	19.6	98.8	42.2	19.2	57.8
#8	2.3	6.6	83.8	34.1	8.2	65.9
#16	1.5	4.0	66.2	26.7	7.4	73.3
#30	1.4	3.1	48.5	19.7	7.0	80.3
#50	1.2	2.9	24.4	10.3	9.5	89.7
#100	1.2	2.7	7.4	3.7	6.6	96.3
LBW	1.0	2.6	1.3	1.2	2.5	98.8

*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations

Coarseness Factor:	58	Workability Factor:	34
---------------------------	-----------	----------------------------	-----------

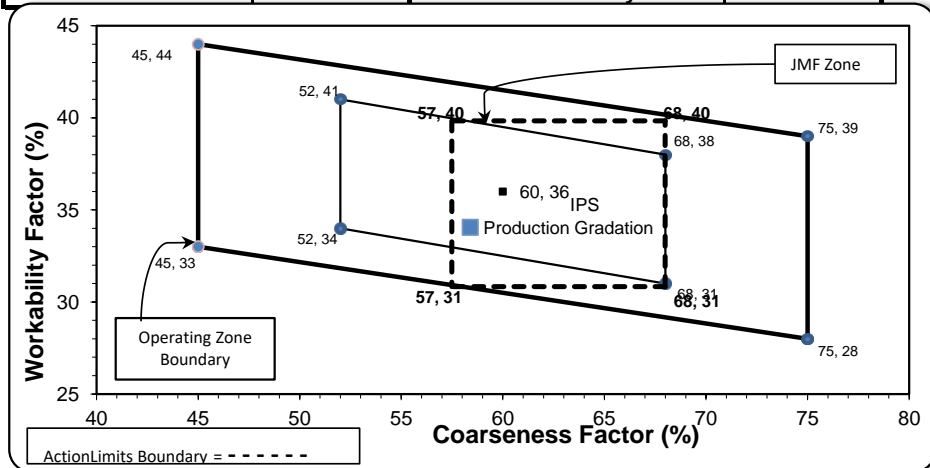

Intial Production Sample (IPS)

Coarseness Factor:	63
Workability Factor:	35

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	99.2	0.8	0.8
3/4"	90.9	8.3	9.1
1/2"	71.3	19.6	28.7
3/8"	59.4	11.9	40.6
#4	43.0	16.5	57.0
#8	35.3	7.6	64.7
#16	28.2	7.1	71.8
#30	21.6	6.6	78.4
#50	9.1	12.5	90.9
#100	1.7	7.4	98.3
LBW	1.1	0.6	98.9

PREPARED BY:
 SM, LLC Technical Service

Approved By:

Aggregate Optimization Chart

PLANT #: **P-39**

Sample Date: 7/11/22

Concrete Grade: **S2M, 3500HP**

Dates Test Represents: 7/12/2022 through 7/18/2022

Contractor: _____

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
6AA	71-47	Presque Isle	1600	9.79	2.62	52.5
26A	71-47	Presque Isle	200	1.22	2.62	6.6
2NS	44-051	Krake Willis Rd	1250	7.56	2.65	41.0
Total Wt			3050	18.57		100.0

<----- Verify this number is 100%




Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Sieve	6AA	26A	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	96.4	100.0	100.0	98.1	1.9	1.9
3/4"	84.0	100.0	100.0	91.6	6.5	8.4
1/2"	43.3	98.7	100.0	70.2	21.4	29.8
3/8"	28.2	88.6	100.0	61.6	8.6	38.4
#4	5.8	22.2	98.9	45.0	16.6	55.0
#8	2.2	5.0	83.2	35.6	9.5	64.4
#16	1.7	3.2	66.7	28.4	7.1	71.6
#30	1.6	2.8	51.0	21.9	6.5	78.1
#50	1.5	2.4	26.9	12.0	10.0	88.0
#100	1.4	2.2	7.0	3.7	8.2	96.3
LBW	1.3	2.0	0.8	1.1	2.6	98.9

*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations

Coarseness Factor: **60** **Workability Factor:** **36**

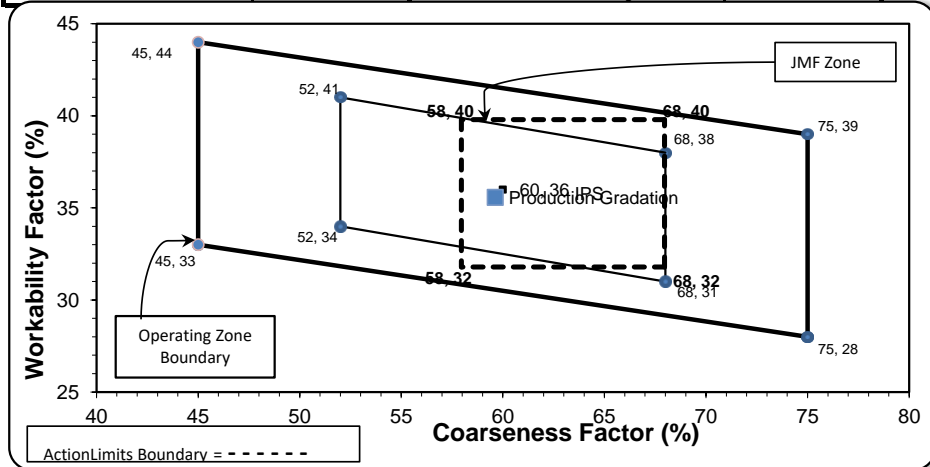

Initial Production Sample (IPS)

Coarseness Factor: **63**
Workability Factor: **36**

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	100.0	0.0	0.0
3/4"	89.8	10.2	10.2
1/2"	70.7	19.1	29.3
3/8"	59.6	11.1	40.4
#4	43.2	16.4	56.8
#8	35.8	7.4	64.2
#16	29.2	6.6	70.8
#30	21.4	7.8	78.6
#50	9.8	11.6	90.2
#100	3.7	6.1	96.3
LBW	1.2	2.5	98.8

PREPARED BY:
 SM, LLC Technical Service

Approved By:

Aggregate Optimization Chart

PLANT #: **P-O2**

Sample Date: 7/11/22

Concrete Grade: **S2M, 3500HP**

Dates Test Represents: 7/12/2022 through 7/18/2022

Contractor: _____

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
6AA	71-47	Presque Isle	1700	10.40	2.62	55.7
26A	71-47	Presque Isle	120	0.73	2.62	3.9
2NS	63-115	Ray Rd	1230	7.44	2.65	40.3
Total Wt			3050	18.57		100.0

<----- Verify this number is 100%




Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Sieve	6AA	26A	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	100.0	100.0	100.0	100.0	0.0	0.0
3/4"	87.6	100.0	100.0	93.1	6.9	6.9
1/2"	47.3	95.8	100.0	70.5	22.6	29.5
3/8"	22.4	82.3	100.0	56.1	14.4	43.9
#4	2.7	29.1	96.7	41.6	14.4	58.4
#8	1.6	11.0	79.3	33.3	8.3	66.7
#16	1.4	4.9	61.8	25.9	7.4	74.1
#30	1.4	3.5	45.5	19.3	6.6	80.7
#50	1.3	3.1	24.7	10.8	8.5	89.2
#100	1.2	2.9	4.9	2.8	8.0	97.2
LBW	0.9	2.5	1.0	1.0	1.8	99.0

*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations

Coarseness Factor: **66** **Workability Factor:** **33**

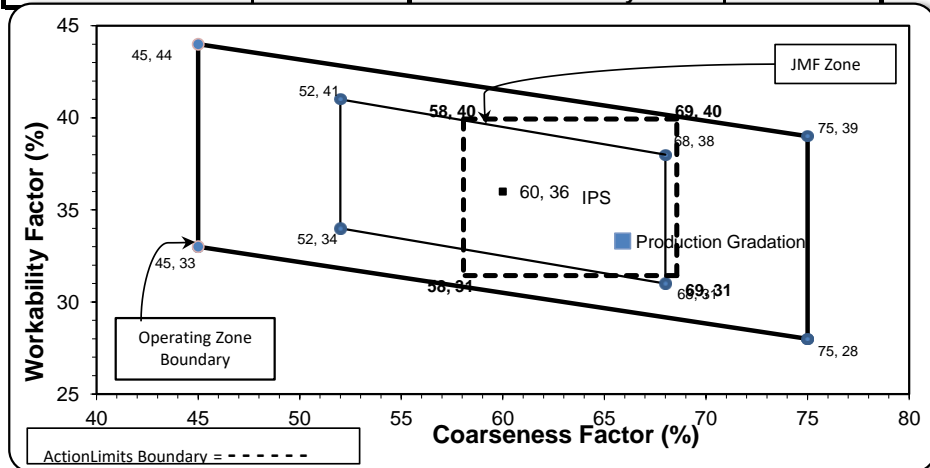

Initial Production Sample (IPS)

Coarseness Factor: **63**
Workability Factor: **36**

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	100.0	0.0	0.0
3/4"	95.6	4.4	4.4
1/2"	73.1	22.6	26.9
3/8"	59.3	13.8	40.7
#4	42.8	16.5	57.2
#8	35.7	7.1	64.3
#16	28.9	6.8	71.1
#30	20.7	8.2	79.3
#50	9.9	10.8	90.1
#100	2.1	7.8	97.9
LBW	0.9	1.2	99.1

PREPARED BY:
 SM, LLC Technical Service

Approved By: