

Aggregate Optimization Chart

PLANT #: **P-101**

Sample Date: 9/11/23

Concrete Grade: **P1M, 3500HP**

Dates Test Represents: 9/12/2023 through 9/18/2023

Contractor: _____

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
CA	71-47	Presque Isle	1070	6.54	2.62	34.9
IA	71-47	Presque Isle	800	4.89	2.62	26.1
2NS	75-051	Mid Michigan	1200	7.23	2.66	39.1
Total Wt			3070	18.67		100.0

<---- Verify this number is 100%



Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	94.8	100.0	100.0	98.2	1.8	1.8
1"	34.4	100.0	100.0	77.1	21.1	22.9
3/4"	10.8	98.5	100.0	68.5	8.6	31.5
1/2"	3.9	83.2	100.0	62.1	6.4	37.9
3/8"	3.4	63.7	100.0	56.9	5.3	43.1
#4	3.0	17.3	96.0	43.1	13.8	56.9
#8	2.8	4.5	80.8	33.7	9.3	66.3
#16	2.7	2.7	66.8	27.8	6.0	72.2
#30	2.6	2.3	51.9	21.8	6.0	78.2
#50	2.5	2.1	27.4	12.1	9.7	87.9
#100	2.2	1.9	7.9	4.3	7.8	95.7
LBW	1.8	1.7	1.2	1.5	2.8	98.5

*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.


Production Gradation Batch Plant Gradations Aggregate Supplier Gradations

Coarseness Factor:	65	Workability Factor:	34
---------------------------	-----------	----------------------------	-----------

Initial Production Sample (IPS)

Coarseness Factor:	66
Workability Factor:	35

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	99.6	0.4	0.4
1"	84.3	15.3	15.7
3/4"	74.8	9.6	25.2
1/2"	64.3	10.4	35.7
3/8"	56.8	7.5	43.2
#4	43.0	13.8	57.0
#8	34.9	8.1	65.1
#16	26.4	8.5	73.6
#30	19.9	6.5	80.1
#50	10.4	9.5	89.6
#100	3.4	7.0	96.6
LBW	1.2	2.2	98.8

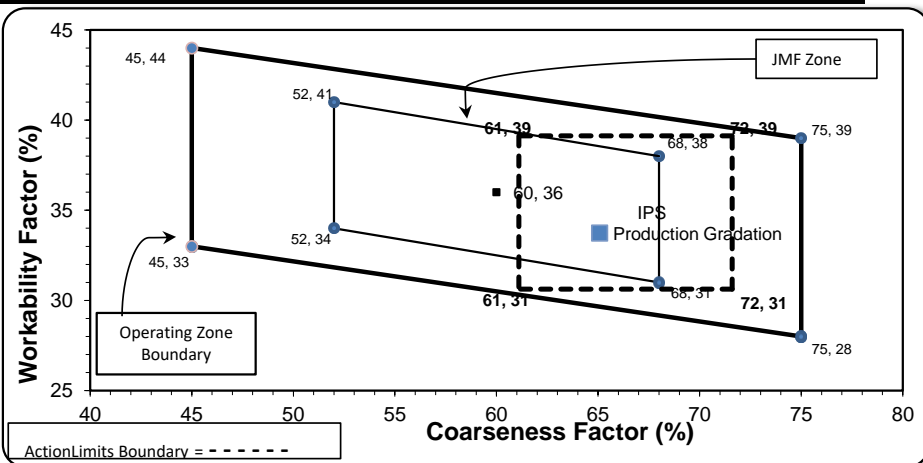

PREPARED BY:
 SM, LLC Technical Service

Approved By:

Aggregate Optimization Chart

PLANT #: **P-102**

Sample Date: 9/11/23

Concrete Grade: **P1M, 3500HP**

Dates Test Represents: 9/12/2023 through 9/18/2023

Contractor: _____

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
CA	58-003	Stoneco	1370	8.16	2.69	43.9
IA	58-003	Stoneco	550	3.28	2.69	17.6
2NS	81-019	Pleasant Lake	1200	7.26	2.65	38.5
Total Wt			3120	18.70		100.0

<----- Verify this number is 100%




Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	65.3	100.0	100.0	84.8	15.2	15.2
3/4"	39.1	100.0	100.0	73.3	11.5	26.7
1/2"	15.8	89.0	100.0	61.1	12.2	38.9
3/8"	7.7	73.0	100.0	54.7	6.4	45.3
#4	2.3	17.3	97.9	41.7	13.0	58.3
#8	1.6	3.8	83.0	33.3	8.4	66.7
#16	1.4	2.2	66.4	26.5	6.8	73.5
#30	1.3	1.8	47.2	19.0	7.5	81.0
#50	1.2	1.5	23.2	9.7	9.3	90.3
#100	1.2	1.4	4.4	2.5	7.2	97.5
LBW	1.0	1.2	0.4	0.8	1.7	99.2

*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations

Coarseness Factor:	68	Workability Factor:	33
---------------------------	-----------	----------------------------	-----------

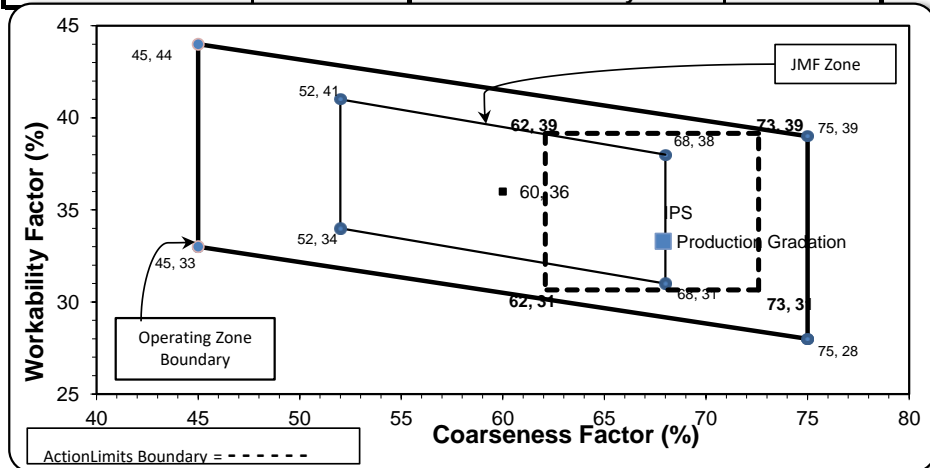

Initial Production Sample (IPS)

Coarseness Factor:	67
Workability Factor:	35

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	85.5	14.5	14.5
3/4"	73.4	12.1	26.6
1/2"	61.0	12.4	39.0
3/8"	56.2	4.8	43.8
#4	43.1	13.1	56.9
#8	34.9	8.2	65.1
#16	29.4	5.5	70.6
#30	21.6	7.8	78.4
#50	8.1	13.4	91.9
#100	2.2	5.9	97.8
LBW	1.4	0.8	98.6

PREPARED BY:
 SM, LLC Technical Service

Approved By:

Aggregate Optimization Chart

PLANT #: **P-103**

Sample Date: 9/11/23

Concrete Grade: **P1M, 3500HP**

Dates Test Represents: 9/12/2023 through 9/18/2023

Contractor: _____

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
CA	58-003	Stoneco	1370	8.16	2.69	43.9
IA	58-003	Stoneco	550	3.28	2.69	17.6
2NS	81-019	Pleasant Lake	1200	7.26	2.65	38.5
Total Wt			3120	18.70		100.0

<----- Verify this number is 100%




Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	65.3	100.0	100.0	84.8	15.2	15.2
3/4"	39.1	100.0	100.0	73.3	11.5	26.7
1/2"	15.8	89.0	100.0	61.1	12.2	38.9
3/8"	7.7	73.0	100.0	54.7	6.4	45.3
#4	2.3	17.3	97.9	41.7	13.0	58.3
#8	1.6	3.8	83.0	33.3	8.4	66.7
#16	1.4	2.2	66.4	26.5	6.8	73.5
#30	1.3	1.8	47.2	19.0	7.5	81.0
#50	1.2	1.5	23.2	9.7	9.3	90.3
#100	1.2	1.4	4.4	2.5	7.2	97.5
LBW	1.0	1.2	0.4	0.8	1.7	99.2

*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations

Coarseness Factor: 68 **Workability Factor:** 33

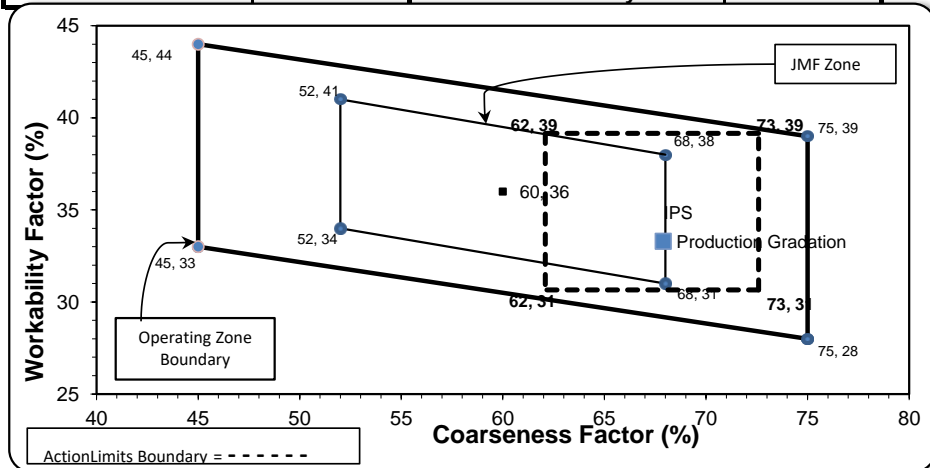

Initial Production Sample (IPS)

Coarseness Factor: 67
Workability Factor: 35

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	85.5	14.5	14.5
3/4"	73.4	12.1	26.6
1/2"	61.0	12.4	39.0
3/8"	56.2	4.8	43.8
#4	43.1	13.1	56.9
#8	34.9	8.2	65.1
#16	29.4	5.5	70.6
#30	21.6	7.8	78.4
#50	8.1	13.4	91.9
#100	2.2	5.9	97.8
LBW	1.4	0.8	98.6

PREPARED BY:
 SM, LLC Technical Service

Approved BY:

Aggregate Optimization Chart

PLANT #: 14

Sample Date: 9/11/23

Concrete Grade: **P1M, 3500HP**

Dates Test Represents: 9/12/2023 through 9/18/2023

Contractor: _____

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
CA	58-003	Stoneco	1370	8.16	2.69	43.9
IA	58-003	Stoneco	550	3.28	2.69	17.6
2NS	19-04	Schlegel	1200	7.20	2.67	38.5
Total Wt			3120	18.64		100.0

<----- Verify this number is 100%




Builders Redi-Mix
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	65.3	100.0	100.0	84.8	15.2	15.2
3/4"	39.1	100.0	100.0	73.3	11.5	26.7
1/2"	15.8	89.0	100.0	61.1	12.2	38.9
3/8"	7.7	73.0	100.0	54.7	6.4	45.3
#4	2.3	17.3	99.9	42.5	12.2	57.5
#8	1.6	3.8	90.1	36.0	6.5	64.0
#16	1.4	2.2	69.4	27.7	8.3	72.3
#30	1.3	1.8	44.5	18.0	9.7	82.0
#50	1.2	1.5	14.3	6.3	11.7	93.7
#100	1.2	1.4	2.7	1.8	4.5	98.2
LBW	1.0	1.2	0.2	0.7	1.1	99.3

*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations

Coarseness Factor:	71	Workability Factor:	36
---------------------------	-----------	----------------------------	-----------

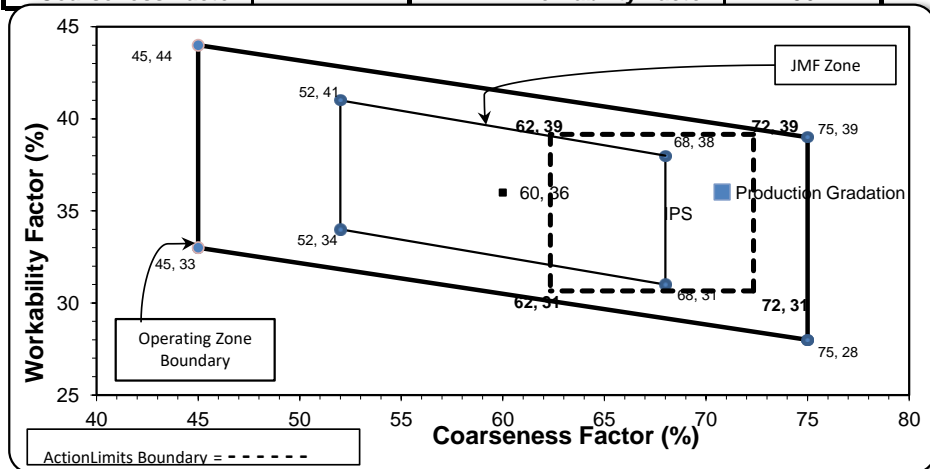

Initial Production Sample (IPS)

Coarseness Factor:	67		
Workability Factor:	35		
Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	85.5	14.5	14.5
3/4"	73.4	12.1	26.6
1/2"	61.0	12.4	39.0
3/8"	56.2	4.8	43.8
#4	43.1	13.1	56.9
#8	34.9	8.2	65.1
#16	29.4	5.5	70.6
#30	21.6	7.8	78.4
#50	8.1	13.4	91.9
#100	2.2	5.9	97.8
LBW	1.4	0.8	98.6

PREPARED BY:
 SM, LLC Technical Service

Approved By:

Aggregate Optimization Chart

PLANT #: 12

Sample Date: 9/11/23

Concrete Grade: **P1M, 3500HP**

Dates Test Represents: 9/12/2023 through 9/18/2023

Contractor: _____

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
CA	71-47	Presque Isle	870	5.32	2.62	28.3
IA	71-47	Presque Isle	1000	6.12	2.62	32.6
2NS	63-115	Ray Rd	1200	7.26	2.65	39.1
Total Wt			3070	18.70		100.0

<----- Verify this number is 100%




Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	98.4	100.0	100.0	99.5	0.5	0.5
1"	36.9	100.0	100.0	82.1	17.4	17.9
3/4"	9.8	98.5	100.0	73.9	8.2	26.1
1/2"	2.2	72.4	100.0	63.3	10.7	36.7
3/8"	2.1	49.7	100.0	55.9	7.4	44.1
#4	2.0	8.2	96.4	40.9	15.0	59.1
#8	2.0	2.8	82.0	33.5	7.4	66.5
#16	2.0	2.1	67.0	27.4	6.1	72.6
#30	2.0	1.9	50.1	20.8	6.7	79.2
#50	1.9	1.9	24.6	10.8	10.0	89.2
#100	1.8	1.7	4.7	2.9	7.9	97.1
LBW	1.3	1.3	0.8	1.1	1.8	98.9

*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations

Coarseness Factor: 66 **Workability Factor:** 34

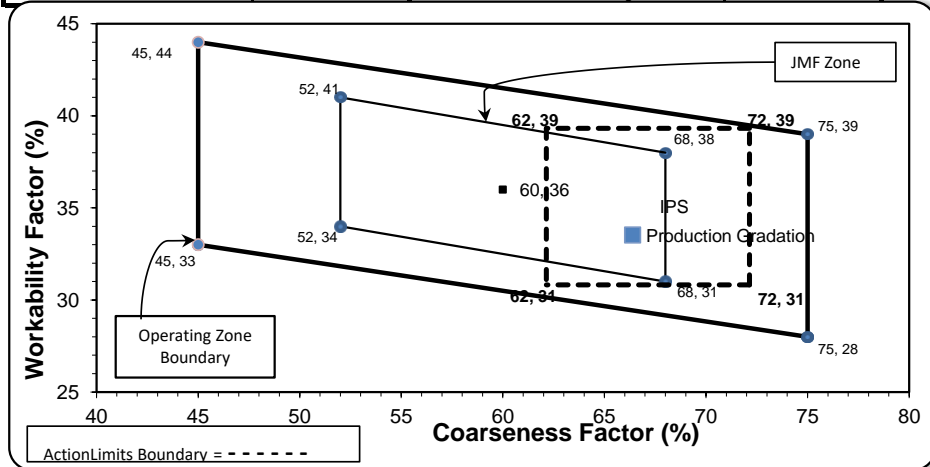

Initial Production Sample (IPS)

Coarseness Factor: 67
Workability Factor: 35

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	99.6	0.4	0.4
1"	83.9	15.7	16.1
3/4"	74.0	9.8	26.0
1/2"	63.7	10.3	36.3
3/8"	56.4	7.3	43.6
#4	43.0	13.4	57.0
#8	35.1	7.9	64.9
#16	29.0	6.1	71.0
#30	20.9	8.0	79.1
#50	8.1	12.8	91.9
#100	1.6	6.5	98.4
LBW	0.9	0.8	99.1

PREPARED BY:
 SM, LLC Technical Service

Approved By:

Aggregate Optimization Chart

PLANT #: 20

Sample Date: 9/11/23

Concrete Grade: **P1M, 3500HP**

Dates Test Represents: 9/12/2023 through 9/18/2023

Contractor: _____

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
CA	71-47	Presque Isle	970	5.93	2.62	31.6
IA	71-47	Presque Isle	900	5.50	2.62	29.3
2NS	63-92	Grange Hall	1200	7.26	2.65	39.1
Total Wt			3070	18.70		100.0

<----- Verify this number is 100%




Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	96.3	100.0	100.0	98.8	1.2	1.2
1"	42.7	100.0	100.0	81.9	16.9	18.1
3/4"	10.3	98.2	100.0	71.1	10.8	28.9
1/2"	3.5	83.0	100.0	64.5	6.6	35.5
3/8"	2.7	62.9	100.0	58.4	6.1	41.6
#4	2.2	15.2	97.6	43.3	15.1	56.7
#8	2.0	2.7	84.4	34.4	8.9	65.6
#16	1.9	2.1	70.1	28.6	5.8	71.4
#30	1.9	2.0	51.6	21.4	7.3	78.6
#50	1.8	1.8	21.4	9.5	11.9	90.5
#100	1.7	1.7	3.3	2.3	7.1	97.7
LBW	1.5	1.5	0.6	1.1	1.2	98.9

*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations

Coarseness Factor: 63 **Workability Factor:** 34

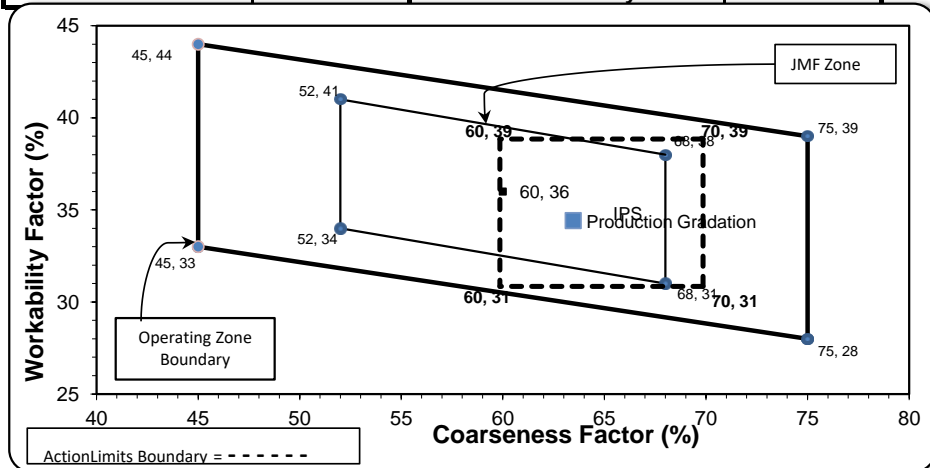

Initial Production Sample (IPS)

Coarseness Factor: 65
Workability Factor: 35

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	99.1	0.9	0.9
1"	80.8	18.2	19.2
3/4"	71.3	9.6	28.7
1/2"	64.0	7.3	36.0
3/8"	57.7	6.2	42.3
#4	42.8	15.0	57.2
#8	34.8	7.9	65.2
#16	28.4	6.4	71.6
#30	20.2	8.2	79.8
#50	7.6	12.6	92.4
#100	1.6	6.0	98.4
LBW	1.0	0.6	99.0

PREPARED BY:
 SM, LLC Technical Service

Approved By:

Aggregate Optimization Chart

PLANT #: P11

Sample Date: 9/11/23

Concrete Grade: P1M, 3500HP

Dates Test Represents: 9/12/2023 through 9/18/2023

Contractor: _____

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
CA	71-47	Presque Isle	870	5.32	2.62	28.3
IA	71-47	Presque Isle	1000	6.12	2.62	32.6
2NS	95-013	Smelter Bay	1200	7.26	2.65	39.1
Total Wt			3070	18.70		100.0

<----- Verify this number is 100%

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	98.4	100.0	100.0	99.5	0.5	0.5
1"	36.9	100.0	100.0	82.1	17.4	17.9
3/4"	9.8	98.5	100.0	73.9	8.2	26.1
1/2"	2.2	72.4	100.0	63.3	10.7	36.7
3/8"	2.1	49.7	100.0	55.9	7.4	44.1
#4	2.0	8.2	96.5	41.0	14.9	59.0
#8	2.0	2.8	85.6	34.9	6.0	65.1
#16	2.0	2.1	70.5	28.8	6.1	71.2
#30	2.0	1.9	50.5	20.9	7.9	79.1
#50	1.9	1.9	24.1	10.6	10.3	89.4
#100	1.8	1.7	7.4	4.0	6.6	96.0
LBW	1.3	1.3	1.5	1.4	2.6	98.6




Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations

Coarseness Factor: 68 **Workability Factor:** 35

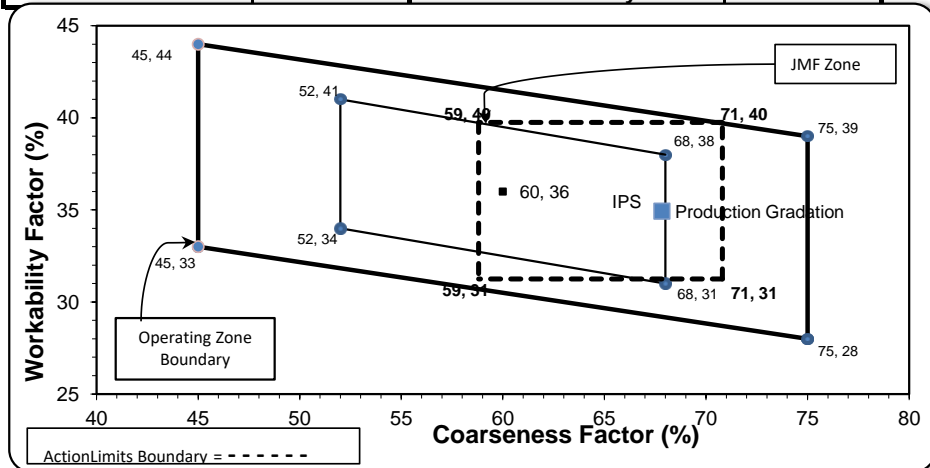

Initial Production Sample (IPS)

Coarseness Factor: 65
Workability Factor: 36

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	99.0	0.6	0.6
1"	84.0	15.3	16.0
3/4"	73.5	10.5	26.5
1/2"	65.2	8.2	34.8
3/8"	58.2	7.1	41.8
#4	44.1	14.1	55.9
#8	35.5	8.6	64.5
#16	29.1	6.4	70.9
#30	21.9	7.3	78.1
#50	9.6	12.2	90.4
#100	2.6	7.1	97.4
LBW	1.0	1.6	99.0

PREPARED BY:
 SM, LLC Technical Service

Approved By:

Aggregate Optimization Chart

PLANT #: **P-32**

Sample Date: 9/11/23

Concrete Grade: **P1M, 3500HP**

Dates Test Represents: 9/12/2023 through 9/18/2023

Contractor: _____

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
CA	71-47	Presque Isle	870	5.32	2.62	28.3
IA	71-47	Presque Isle	1000	6.12	2.62	32.6
2NS	95-013	Smelter Bay	1200	7.26	2.65	39.1
Total Wt			3070	18.70		100.0

<----- Verify this number is 100%




Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	98.4	100.0	100.0	99.5	0.5	0.5
1"	36.9	100.0	100.0	82.1	17.4	17.9
3/4"	9.8	98.5	100.0	73.9	8.2	26.1
1/2"	2.2	72.4	100.0	63.3	10.7	36.7
3/8"	2.1	49.7	100.0	55.9	7.4	44.1
#4	2.0	8.2	96.5	41.0	14.9	59.0
#8	2.0	2.8	85.6	34.9	6.0	65.1
#16	2.0	2.1	70.5	28.8	6.1	71.2
#30	2.0	1.9	50.5	20.9	7.9	79.1
#50	1.9	1.9	24.1	10.6	10.3	89.4
#100	1.8	1.7	7.4	4.0	6.6	96.0
LBW	1.3	1.3	1.5	1.4	2.6	98.6

*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations

Coarseness Factor: **68** **Workability Factor:** **35**

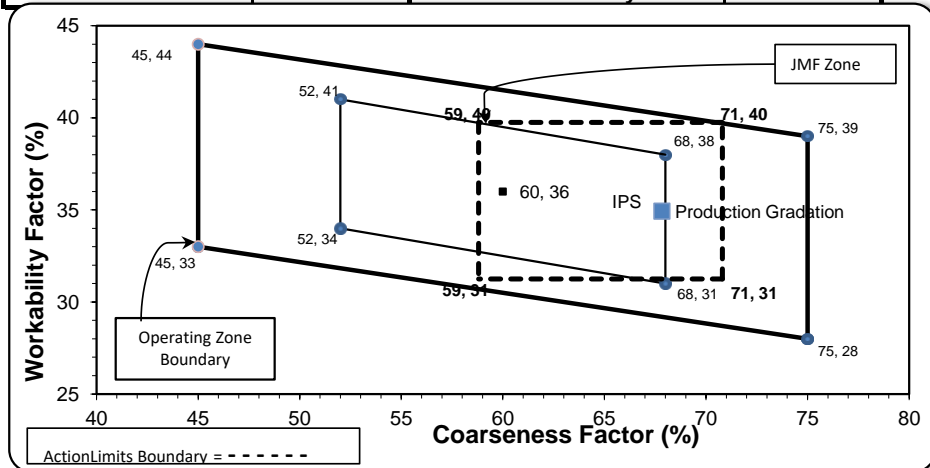

Initial Production Sample (IPS)

Coarseness Factor: 65		Workability Factor: 36	
Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	99.0	0.6	0.6
1"	84.0	15.3	16.0
3/4"	73.5	10.5	26.5
1/2"	65.2	8.2	34.8
3/8"	58.2	7.1	41.8
#4	44.1	14.1	55.9
#8	35.5	8.6	64.5
#16	29.1	6.4	70.9
#30	21.9	7.3	78.1
#50	9.6	12.2	90.4
#100	2.6	7.1	97.4
LBW	1.0	1.6	99.0

PREPARED BY:
 SM, LLC Technical Service

Approved By:

Aggregate Optimization Chart

PLANT #: **P-35**

Sample Date: 9/11/23

Concrete Grade: **P1M, 3500HP**

Dates Test Represents: 9/12/2023 through 9/18/2023

Contractor: _____

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
CA	58-003	Stoneco	1370	8.16	2.69	43.9
IA	58-003	Stoneco	550	3.28	2.69	17.6
2NS	81-019	Pleasant Lake	1200	7.26	2.65	38.5
Total Wt			3120	18.70		100.0

<----- Verify this number is 100%




Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	65.3	100.0	100.0	84.8	15.2	15.2
3/4"	39.1	100.0	100.0	73.3	11.5	26.7
1/2"	15.8	89.0	100.0	61.1	12.2	38.9
3/8"	7.7	73.0	100.0	54.7	6.4	45.3
#4	2.3	17.3	97.9	41.7	13.0	58.3
#8	1.6	3.8	83.0	33.3	8.4	66.7
#16	1.4	2.2	66.4	26.5	6.8	73.5
#30	1.3	1.8	47.2	19.0	7.5	81.0
#50	1.2	1.5	23.2	9.7	9.3	90.3
#100	1.2	1.4	4.4	2.5	7.2	97.5
LBW	1.0	1.2	0.4	0.8	1.7	99.2

*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations

Coarseness Factor: 68 **Workability Factor:** 33

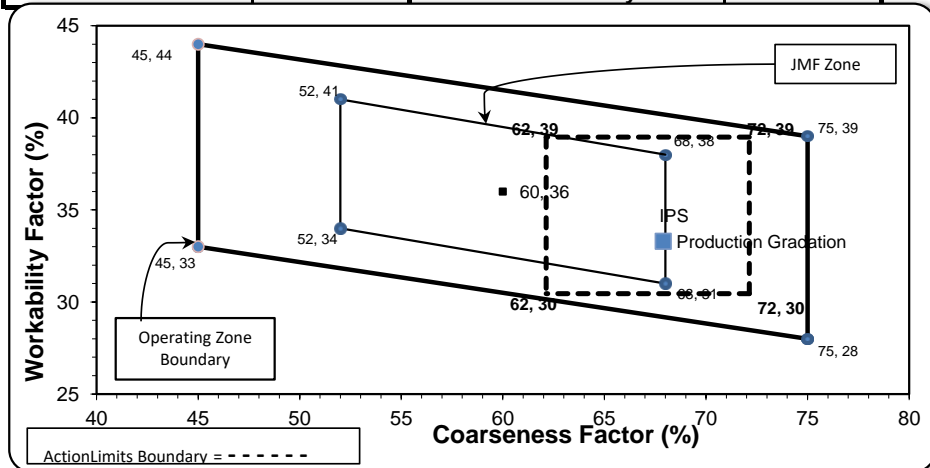

Initial Production Sample (IPS)

Coarseness Factor: 67
Workability Factor: 35

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	86.9	13.1	13.1
3/4"	76.1	10.8	23.9
1/2"	63.7	12.4	36.3
3/8"	56.2	7.5	43.8
#4	43.2	13.0	56.8
#8	34.7	8.5	65.3
#16	27.5	7.2	72.5
#30	20.6	7.0	79.4
#50	9.0	11.6	91.0
#100	2.1	6.9	97.9
LBW	1.0	1.1	99.0

PREPARED BY:
 SM, LLC Technical Service

Approved By:

Aggregate Optimization Chart

PLANT #: **P-36**

Sample Date: 9/11/23

Concrete Grade: **P1M, 3500HP**

Dates Test Represents: 9/12/2023 through 9/18/2023

Contractor: _____

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
CA	71-47	Presque Isle	870	5.32	2.62	28.3
IA	71-47	Presque Isle	1000	6.12	2.62	32.6
2NS	63-92	Grange Hall	1200	7.26	2.65	39.1
Total Wt			3070	18.70		100.0

<----- Verify this number is 100%




Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	98.4	100.0	100.0	99.5	0.5	0.5
1"	36.9	100.0	100.0	82.1	17.4	17.9
3/4"	9.8	98.5	100.0	73.9	8.2	26.1
1/2"	2.2	72.4	100.0	63.3	10.7	36.7
3/8"	2.1	49.7	100.0	55.9	7.4	44.1
#4	2.0	8.2	97.6	41.4	14.5	58.6
#8	2.0	2.8	84.4	34.5	6.9	65.5
#16	2.0	2.1	70.1	28.7	5.8	71.3
#30	2.0	1.9	51.6	21.4	7.3	78.6
#50	1.9	1.9	21.4	9.5	11.8	90.5
#100	1.8	1.7	3.3	2.4	7.2	97.6
LBW	1.3	1.3	0.6	1.0	1.3	99.0

*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations

Coarseness Factor: **67** **Workability Factor:** **34**

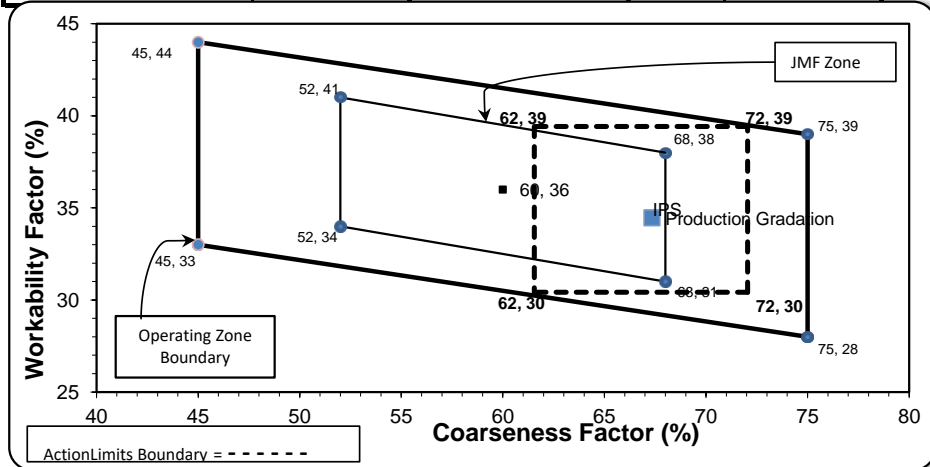

Initial Production Sample (IPS)

Coarseness Factor: **67**
Workability Factor: **35**

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	85.0	15.0	15.0
3/4"	72.1	12.9	27.9
1/2"	64.5	7.6	35.5
3/8"	56.5	8.0	43.5
#4	42.7	13.8	57.3
#8	34.9	7.8	65.1
#16	29.0	5.9	71.0
#30	21.0	8.0	79.0
#50	8.2	12.8	91.8
#100	1.6	6.5	98.4
LBW	0.7	0.9	99.3

PREPARED BY:
 SM, LLC Technical Service

Approved By:

Aggregate Optimization Chart

PLANT #: **P-39**

Sample Date: 9/11/23 Concrete Grade: **P1M, 3500HP**
 Dates Test Represents: 9/12/2023 through 9/18/2023

Contractor: _____

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
CA	71-47	Presque Isle	1020	6.24	2.62	33.2
IA	71-47	Presque Isle	800	4.89	2.62	26.1
2NS	44-051	Krake Willis Rd	1250	7.56	2.65	40.7
Total Wt			3070	18.69		100.0

<----- Verify this number is 100%




Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	94.8	100.0	100.0	98.3	1.7	1.7
1"	34.4	100.0	100.0	78.2	20.1	21.8
3/4"	10.8	98.5	100.0	70.0	8.2	30.0
1/2"	3.9	83.2	100.0	63.7	6.3	36.3
3/8"	3.4	63.7	100.0	58.4	5.2	41.6
#4	3.0	17.3	98.9	45.8	12.7	54.2
#8	2.8	4.5	84.6	36.5	9.2	63.5
#16	2.7	2.7	68.9	29.7	6.9	70.3
#30	2.6	2.3	49.7	21.7	8.0	78.3
#50	2.5	2.1	23.8	11.1	10.6	88.9
#100	2.2	1.9	6.5	3.9	7.2	96.1
LBW	1.8	1.7	1.6	1.7	2.2	98.3

*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations

Coarseness Factor: 65 **Workability Factor:** 37

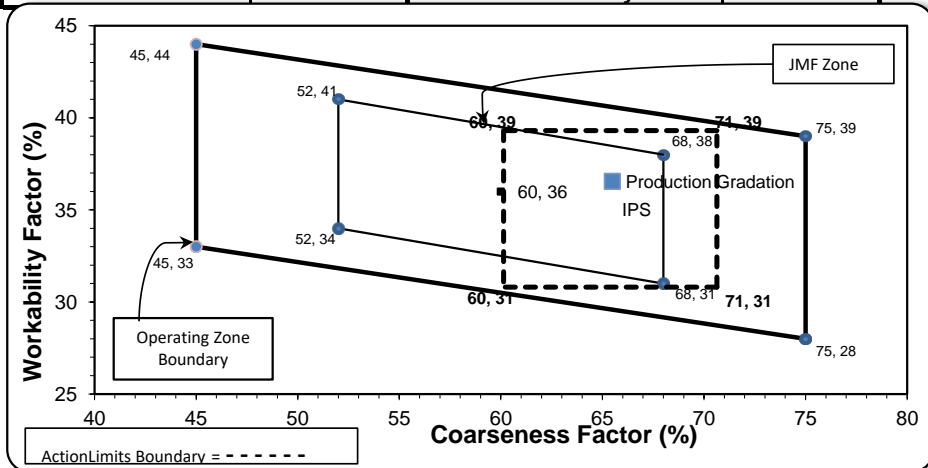

Initial Production Sample (IPS)

Coarseness Factor:		65	
Workability Factor:		35	
Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	99.6	0.4	0.4
1"	83.9	15.7	16.1
3/4"	74.1	9.8	25.9
1/2"	64.3	9.7	35.7
3/8"	57.5	6.8	42.5
#4	44.5	13.1	55.5
#8	35.1	9.4	64.9
#16	27.9	7.2	72.1
#30	21.7	6.2	78.3
#50	12.6	9.1	87.4
#100	3.5	9.1	96.5
LBW	1.2	2.4	98.8

PREPARED BY:
 SM, LLC Technical Service

Approved By:

Aggregate Optimization Chart

PLANT #: **P-O2**

Sample Date: 9/11/23 Concrete Grade: **P1M, 3500HP**
 Dates Test Represents: 9/12/2023 through 9/18/2023

Contractor: _____

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
CA	71-47	Presque Isle	870	5.32	2.62	28.3
IA	71-47	Presque Isle	1000	6.12	2.62	32.6
2NS	63-115	Ray Rd	1200	7.26	2.65	39.1
Total Wt			3070	18.70		100.0

<----- Verify this number is 100%




Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	98.4	100.0	100.0	99.5	0.5	0.5
1"	36.9	100.0	100.0	82.1	17.4	17.9
3/4"	9.8	98.5	100.0	73.9	8.2	26.1
1/2"	2.2	72.4	100.0	63.3	10.7	36.7
3/8"	2.1	49.7	100.0	55.9	7.4	44.1
#4	2.0	8.2	96.4	40.9	15.0	59.1
#8	2.0	2.8	82.0	33.5	7.4	66.5
#16	2.0	2.1	67.0	27.4	6.1	72.6
#30	2.0	1.9	50.1	20.8	6.7	79.2
#50	1.9	1.9	24.6	10.8	10.0	89.2
#100	1.8	1.7	4.7	2.9	7.9	97.1
LBW	1.3	1.3	0.8	1.1	1.8	98.9

*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations

Coarseness Factor:	66	Workability Factor:	34
---------------------------	-----------	----------------------------	-----------

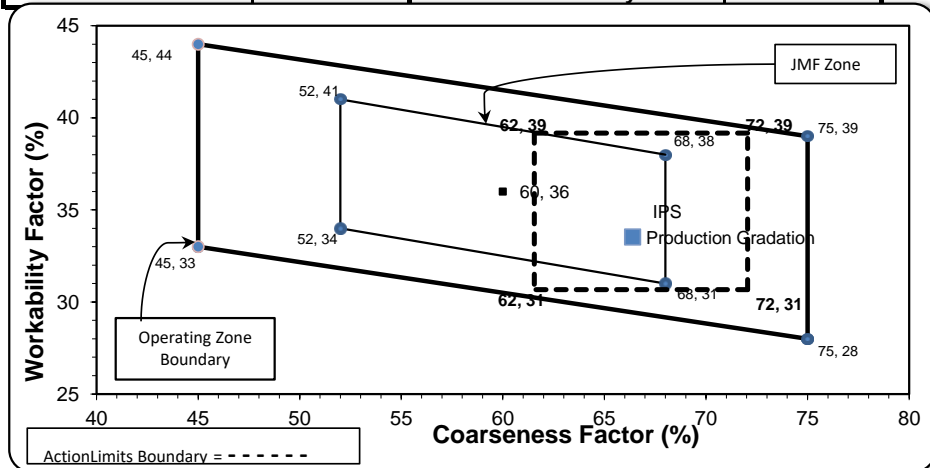

Initial Production Sample (IPS)

Coarseness Factor:	67		
Workability Factor:	35		
Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	85.0	15.0	15.0
3/4"	72.3	12.7	27.7
1/2"	64.5	7.8	35.5
3/8"	56.5	8.0	43.5
#4	42.7	13.8	57.3
#8	34.9	7.8	65.1
#16	29.0	5.9	71.0
#30	21.0	8.0	79.0
#50	8.2	12.8	91.8
#100	1.6	6.5	98.4
LBW	0.7	0.9	99.3

PREPARED BY:
 SM, LLC Technical Service

Approved By: