

Aggregate Optimization Chart

PLANT #: **P-101**

Sample Date: 7/15/24 Concrete Grade: **P1M, 3500HP**
 Dates Test Represents: 7/16/2024 through 7/22/2024

Contractor: _____

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
CA	71-47	Presque Isle	1020	6.24	2.62	33.2
IA	71-47	Presque Isle	850	5.20	2.62	27.7
2NS	75-051	Mid Michigan	1200	7.23	2.66	39.1
Total Wt			3070	18.67		100.0

<---- Verify this number is 100%



Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	97.5	100.0	100.0	99.2	0.8	0.8
1"	55.4	100.0	100.0	85.2	14.0	14.8
3/4"	23.1	98.2	100.0	74.0	11.2	26.0
1/2"	9.4	75.0	100.0	63.0	11.0	37.0
3/8"	7.3	43.0	100.0	53.4	9.6	46.6
#4	3.2	4.1	96.0	39.7	13.7	60.3
#8	2.2	1.2	79.4	32.1	7.6	67.9
#16	2.1	0.9	63.7	25.8	6.3	74.2
#30	2.0	0.8	48.8	20.0	5.9	80.0
#50	1.9	0.8	26.1	11.1	8.9	88.9
#100	1.8	0.8	7.8	3.9	7.2	96.1
LBW	1.4	0.6	1.2	1.1	2.8	98.9


*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations

Coarseness Factor:	69	Workability Factor:	32
---------------------------	-----------	----------------------------	-----------

Initial Production Sample (IPS)

Coarseness Factor:	66		
Workability Factor:	35		
Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	99.6	0.4	0.4
1"	84.3	15.3	15.7
3/4"	74.8	9.6	25.2
1/2"	64.3	10.4	35.7
3/8"	56.8	7.5	43.2
#4	43.0	13.8	57.0
#8	34.9	8.1	65.1
#16	26.4	8.5	73.6
#30	19.9	6.5	80.1
#50	10.4	9.5	89.6
#100	3.4	7.0	96.6
LBW	1.2	2.2	98.8

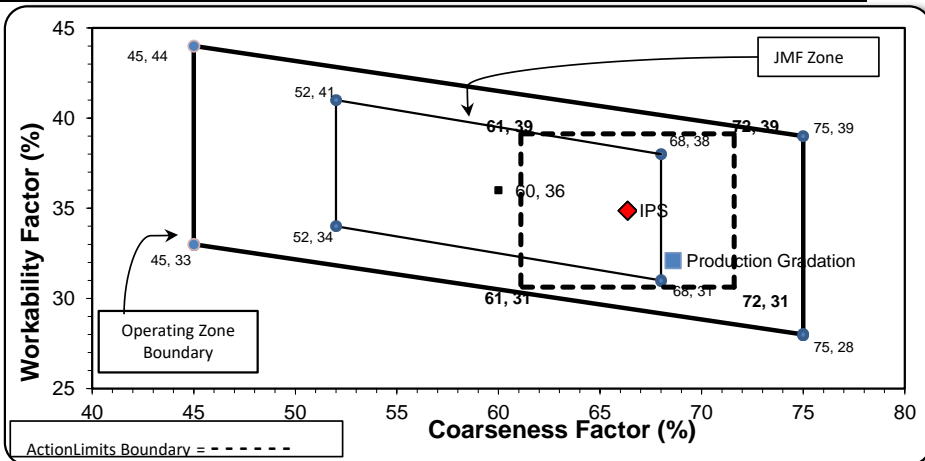

PREPARED BY:
 SM, LLC Technical Service

Approved By:

Aggregate Optimization Chart

PLANT #: **P-102**

Sample Date: 7/15/24

Concrete Grade: **P1M, 3500HP**

Contractor: _____

Dates Test Represents: 7/16/2024 through 7/22/2024

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
CA	58-003	Stoneco	1420	8.46	2.69	45.5
IA	58-003	Stoneco	500	2.98	2.69	16.0
2NS	63-114	Highland	1200	7.26	2.65	38.5
Total Wt			3120	18.70		100.0

<----- Verify this number is 100%




Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	66.6	100.0	100.0	84.8	15.2	15.2
3/4"	38.7	100.0	100.0	72.1	12.7	27.9
1/2"	19.1	94.4	100.0	62.3	9.8	37.7
3/8"	12.6	79.1	100.0	56.9	5.4	43.1
#4	2.9	20.3	98.8	42.6	14.3	57.4
#8	1.9	5.5	85.1	34.5	8.1	65.5
#16	1.7	2.6	68.0	27.3	7.1	72.7
#30	1.6	1.7	48.3	19.6	7.8	80.4
#50	1.5	1.4	18.7	8.1	11.5	91.9
#100	1.4	1.3	3.4	2.2	5.9	97.8
LBW	1.2	1.0	0.6	0.9	1.2	99.1

*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations

Coarseness Factor: **66** **Workability Factor:** **34**

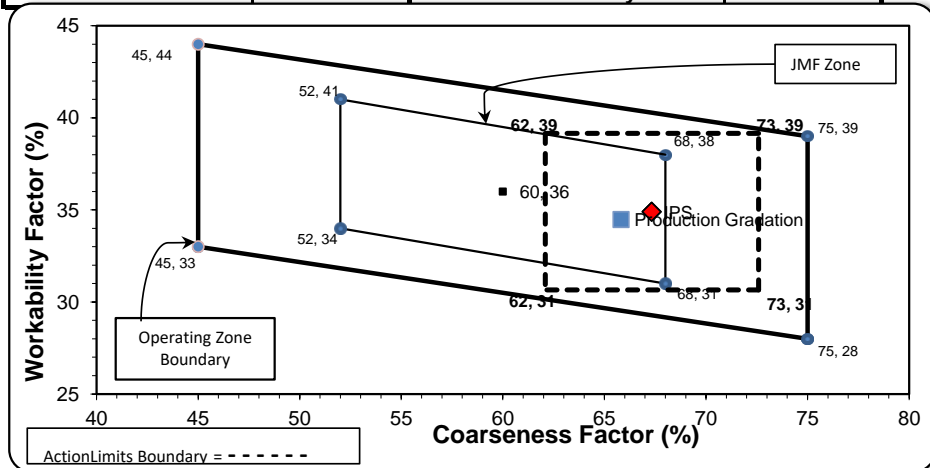

Initial Production Sample (IPS)

Coarseness Factor: **67**
Workability Factor: **35**

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	85.5	14.5	14.5
3/4"	73.4	12.1	26.6
1/2"	61.0	12.4	39.0
3/8"	56.2	4.8	43.8
#4	43.1	13.1	56.9
#8	34.9	8.2	65.1
#16	29.4	5.5	70.6
#30	21.6	7.8	78.4
#50	8.1	13.4	91.9
#100	2.2	5.9	97.8
LBW	1.4	0.8	98.6

PREPARED BY:
 SM, LLC Technical Service

Approved By:

Aggregate Optimization Chart

PLANT #: **P-103**

Sample Date: 7/15/24

Concrete Grade: **P1M, 3500HP**

Dates Test Represents: 7/16/2024 through 7/22/2024

Contractor: _____

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
CA	58-003	Stoneco	1420	8.46	2.69	45.5
IA	58-003	Stoneco	500	2.98	2.69	16.0
2NS	63-114	Highland	1200	7.26	2.65	38.5
Total Wt			3120	18.70		100.0

<----- Verify this number is 100%




Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	66.6	100.0	100.0	84.8	15.2	15.2
3/4"	38.7	100.0	100.0	72.1	12.7	27.9
1/2"	19.1	94.4	100.0	62.3	9.8	37.7
3/8"	12.6	79.1	100.0	56.9	5.4	43.1
#4	2.9	20.3	98.8	42.6	14.3	57.4
#8	1.9	5.5	85.1	34.5	8.1	65.5
#16	1.7	2.6	68.0	27.3	7.1	72.7
#30	1.6	1.7	48.3	19.6	7.8	80.4
#50	1.5	1.4	18.7	8.1	11.5	91.9
#100	1.4	1.3	3.4	2.2	5.9	97.8
LBW	1.2	1.0	0.6	0.9	1.2	99.1

*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations

Coarseness Factor: **66** **Workability Factor:** **34**

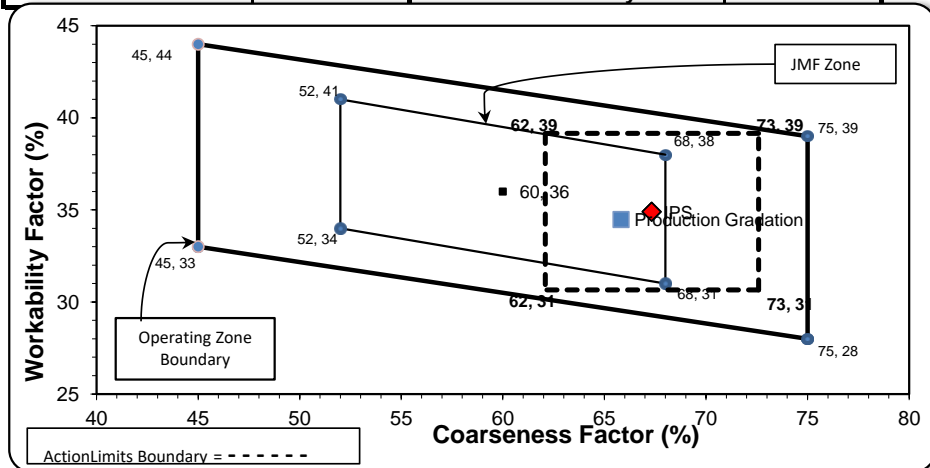

Initial Production Sample (IPS)

Coarseness Factor: **67**
Workability Factor: **35**

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	85.5	14.5	14.5
3/4"	73.4	12.1	26.6
1/2"	61.0	12.4	39.0
3/8"	56.2	4.8	43.8
#4	43.1	13.1	56.9
#8	34.9	8.2	65.1
#16	29.4	5.5	70.6
#30	21.6	7.8	78.4
#50	8.1	13.4	91.9
#100	2.2	5.9	97.8
LBW	1.4	0.8	98.6

PREPARED BY:
 SM, LLC Technical Service

Approved BY:

Aggregate Optimization Chart

PLANT #: 12

Sample Date: 7/15/24

Concrete Grade: **P1M, 3500HP**

Dates Test Represents: 7/16/2024 through 7/22/2024

Contractor: _____

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
CA	71-47	Presque Isle	1020	6.24	2.62	33.2
IA	71-47	Presque Isle	850	5.20	2.62	27.7
2NS	63-115	Ray Rd	1200	7.26	2.65	39.1
Total Wt			3070	18.70		100.0

<----- Verify this number is 100%




Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	97.5	100.0	100.0	99.2	0.8	0.8
1"	55.4	100.0	100.0	85.2	14.0	14.8
3/4"	23.1	98.2	100.0	74.0	11.2	26.0
1/2"	9.4	75.0	100.0	63.0	11.0	37.0
3/8"	7.3	43.0	100.0	53.4	9.6	46.6
#4	3.2	4.1	96.8	40.0	13.4	60.0
#8	2.2	1.2	80.2	32.4	7.6	67.6
#16	2.1	0.9	64.6	26.2	6.2	73.8
#30	2.0	0.8	49.4	20.2	6.0	79.8
#50	1.9	0.8	27.7	11.7	8.5	88.3
#100	1.8	0.8	7.3	3.7	8.0	96.3
LBW	1.4	0.6	0.7	0.9	2.8	99.1

*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations

Coarseness Factor:	69	Workability Factor:	32
---------------------------	-----------	----------------------------	-----------

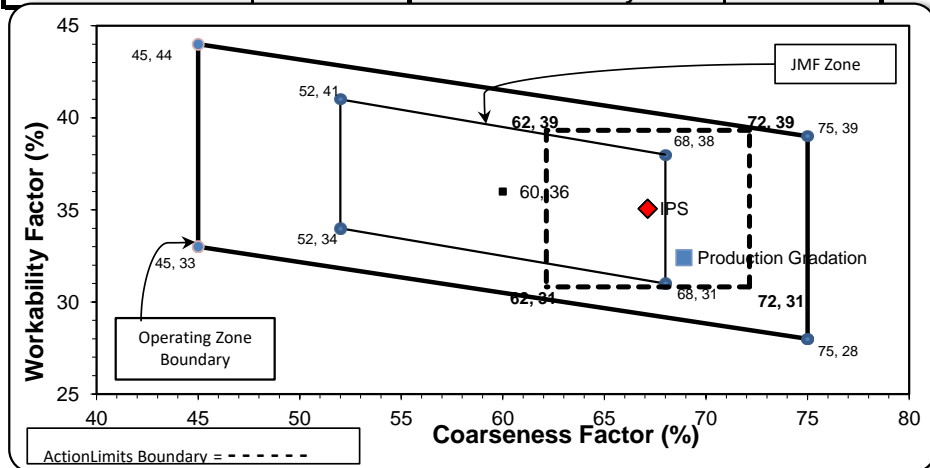

Initial Production Sample (IPS)

Coarseness Factor:	67
Workability Factor:	35

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	99.6	0.4	0.4
1"	83.9	15.7	16.1
3/4"	74.0	9.8	26.0
1/2"	63.7	10.3	36.3
3/8"	56.4	7.3	43.6
#4	43.0	13.4	57.0
#8	35.1	7.9	64.9
#16	29.0	6.1	71.0
#30	20.9	8.0	79.1
#50	8.1	12.8	91.9
#100	1.6	6.5	98.4
LBW	0.9	0.8	99.1

PREPARED BY:
 SM, LLC Technical Service

Approved By:

Aggregate Optimization Chart

PLANT #: 20

Sample Date: 7/15/24

Concrete Grade: **P1M, 3500HP**

Dates Test Represents: 7/16/2024 through 7/22/2024

Contractor: _____

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
CA	71-47	Presque Isle	950	5.81	2.62	30.9
IA	71-47	Presque Isle	920	5.63	2.62	30.0
2NS	63-92	Grange Hall	1200	7.26	2.65	39.1
Total Wt			3070	18.70		100.0

<----- Verify this number is 100%




Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	98.6	100.0	100.0	99.6	0.4	0.4
1"	36.0	100.0	100.0	80.2	19.4	19.8
3/4"	8.4	98.2	100.0	71.1	9.1	28.9
1/2"	2.6	75.2	100.0	62.4	8.7	37.6
3/8"	2.0	50.6	100.0	54.9	7.6	45.1
#4	1.4	10.0	97.8	41.7	13.2	58.3
#8	1.4	3.4	82.1	33.5	8.1	66.5
#16	1.4	2.5	67.4	27.5	6.0	72.5
#30	1.4	2.3	49.7	20.5	7.0	79.5
#50	1.4	2.2	25.4	11.0	9.5	89.0
#100	1.3	2.1	4.1	2.6	8.4	97.4
LBW	1.0	1.8	0.4	1.0	1.6	99.0

*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations

Coarseness Factor:	68	Workability Factor:	34
---------------------------	-----------	----------------------------	-----------

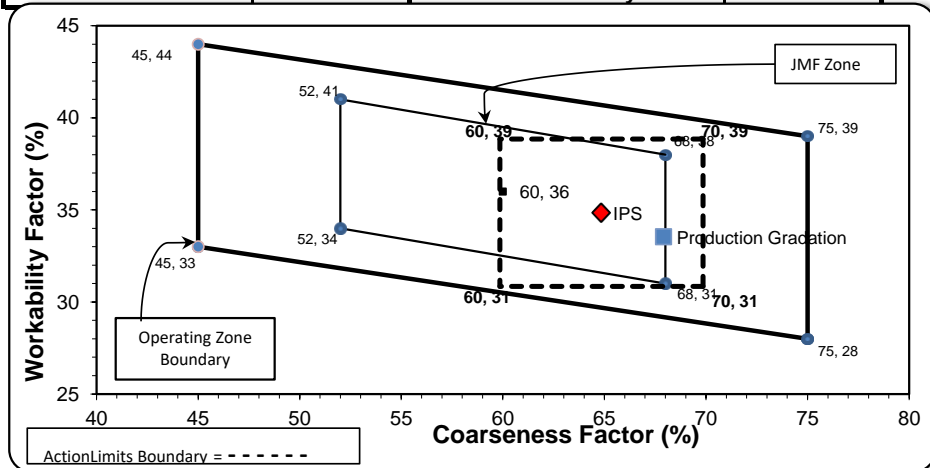

Initial Production Sample (IPS)

Coarseness Factor:	65
Workability Factor:	35

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	99.1	0.9	0.9
1"	80.8	18.2	19.2
3/4"	71.3	9.6	28.7
1/2"	64.0	7.3	36.0
3/8"	57.7	6.2	42.3
#4	42.8	15.0	57.2
#8	34.8	7.9	65.2
#16	28.4	6.4	71.6
#30	20.2	8.2	79.8
#50	7.6	12.6	92.4
#100	1.6	6.0	98.4
LBW	1.0	0.6	99.0

PREPARED BY:
 SM, LLC Technical Service

Approved By:

Aggregate Optimization Chart

PLANT #: P11

Sample Date: 7/15/24

Concrete Grade: P1M, 3500HP

Contractor: _____

Dates Test Represents: 7/16/2024 through 7/22/2024

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
CA	71-47	Presque Isle	1020	6.24	2.62	33.2
IA	71-47	Presque Isle	850	5.20	2.62	27.7
2NS	63-115	Ray Rd	1200	7.26	2.65	39.1
Total Wt			3070	18.70		100.0

<----- Verify this number is 100%




Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	97.5	100.0	100.0	99.2	0.8	0.8
1"	55.4	100.0	100.0	85.2	14.0	14.8
3/4"	23.1	98.2	100.0	74.0	11.2	26.0
1/2"	9.4	75.0	100.0	63.0	11.0	37.0
3/8"	7.3	43.0	100.0	53.4	9.6	46.6
#4	3.2	4.1	96.8	40.0	13.4	60.0
#8	2.2	1.2	80.2	32.4	7.6	67.6
#16	2.1	0.9	64.6	26.2	6.2	73.8
#30	2.0	0.8	49.4	20.2	6.0	79.8
#50	1.9	0.8	27.7	11.7	8.5	88.3
#100	1.8	0.8	7.3	3.7	8.0	96.3
LBW	1.4	0.6	0.7	0.9	2.8	99.1

*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations

Coarseness Factor: 69 **Workability Factor:** 32

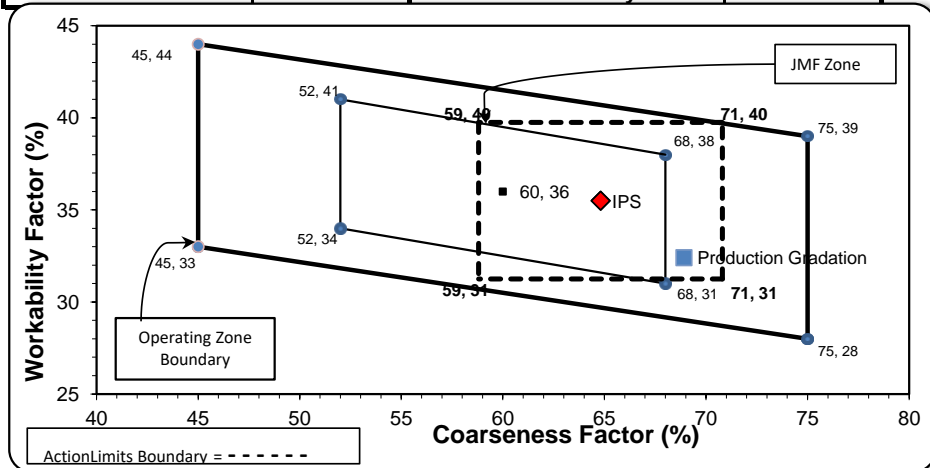

Initial Production Sample (IPS)

Coarseness Factor: 65
Workability Factor: 36

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	99.0	0.6	0.6
1"	84.0	15.3	16.0
3/4"	73.5	10.5	26.5
1/2"	65.2	8.2	34.8
3/8"	58.2	7.1	41.8
#4	44.1	14.1	55.9
#8	35.5	8.6	64.5
#16	29.1	6.4	70.9
#30	21.9	7.3	78.1
#50	9.6	12.2	90.4
#100	2.6	7.1	97.4
LBW	1.0	1.6	99.0

PREPARED BY:
 SM, LLC Technical Service

Approved By:

Aggregate Optimization Chart

PLANT #: **P-35**

Sample Date: 7/15/24

Concrete Grade: **P1M, 3500HP**

Dates Test Represents: 7/16/2024 through 7/22/2024

Contractor: _____

MDOT No.: _____



Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
CA	58-003	Stoneco	1420	8.46	2.69	45.5
IA	58-003	Stoneco	500	2.98	2.69	16.0
2NS	81-019	Pleasant Lake	1200	7.26	2.65	38.5
Total Wt			3120	18.70		100.0


<----- Verify this number is 100%

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	66.6	100.0	100.0	84.8	15.2	15.2
3/4"	38.7	100.0	100.0	72.1	12.7	27.9
1/2"	19.1	94.4	100.0	62.3	9.8	37.7
3/8"	12.6	79.1	100.0	56.9	5.4	43.1
#4	2.9	20.3	98.6	42.5	14.4	57.5
#8	1.9	5.5	87.0	35.2	7.3	64.8
#16	1.7	2.6	66.6	26.8	8.4	73.2
#30	1.6	1.7	45.0	18.3	8.5	81.7
#50	1.5	1.4	20.8	8.9	9.4	91.1
#100	1.4	1.3	3.8	2.3	6.6	97.7
LBW	1.2	1.0	1.0	1.1	1.2	98.9

*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations

Coarseness Factor:	67	Workability Factor:	35
---------------------------	-----------	----------------------------	-----------

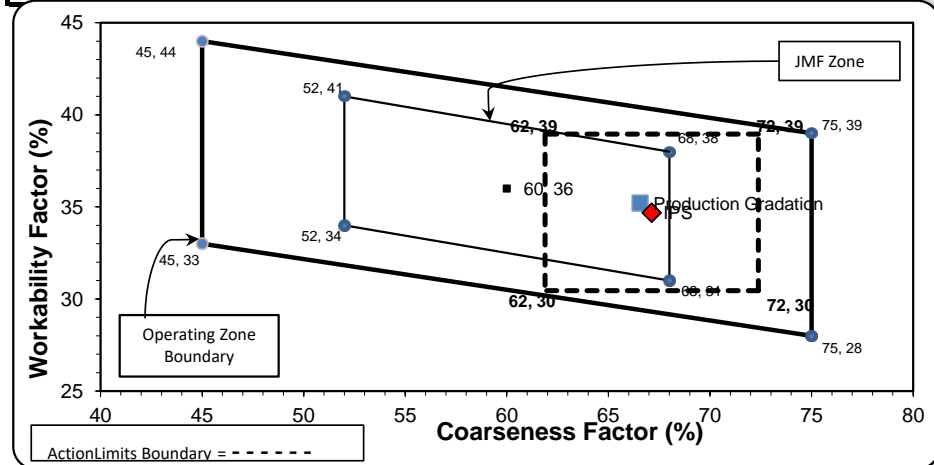

Initial Production Sample (IPS)

Coarseness Factor:	67
Workability Factor:	35

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	86.9	13.1	13.1
3/4"	76.1	10.8	23.9
1/2"	63.7	12.4	36.3
3/8"	56.2	7.5	43.8
#4	43.2	13.0	56.8
#8	34.7	8.5	65.3
#16	27.5	7.2	72.5
#30	20.6	7.0	79.4
#50	9.0	11.6	91.0
#100	2.1	6.9	97.9
LBW	1.0	1.1	99.0

PREPARED BY:
 SM, LLC Technical Service

Approved By:

Aggregate Optimization Chart

PLANT #: **P-36**

Sample Date: 7/15/24

Concrete Grade: **P1M, 3500HP**

Dates Test Represents: 7/16/2024 through 7/22/2024

Contractor: _____

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
CA	71-47	Presque Isle	1020	6.24	2.62	33.2
IA	71-47	Presque Isle	850	5.20	2.62	27.7
2NS	63-92	Grange Hall	1200	7.26	2.65	39.1
Total Wt			3070	18.70		100.0

<----- Verify this number is 100%




Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	97.5	100.0	100.0	99.2	0.8	0.8
1"	55.4	100.0	100.0	85.2	14.0	14.8
3/4"	23.1	98.2	100.0	74.0	11.2	26.0
1/2"	9.4	75.0	100.0	63.0	11.0	37.0
3/8"	7.3	43.0	100.0	53.4	9.6	46.6
#4	3.2	4.1	97.8	40.4	13.0	59.6
#8	2.2	1.2	82.1	33.2	7.3	66.8
#16	2.1	0.9	67.4	27.3	5.9	72.7
#30	2.0	0.8	49.7	20.3	7.0	79.7
#50	1.9	0.8	25.4	10.8	9.5	89.2
#100	1.8	0.8	4.1	2.4	8.4	97.6
LBW	1.4	0.6	0.4	0.8	1.6	99.2

*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations

Coarseness Factor:	70	Workability Factor:	33
---------------------------	-----------	----------------------------	-----------

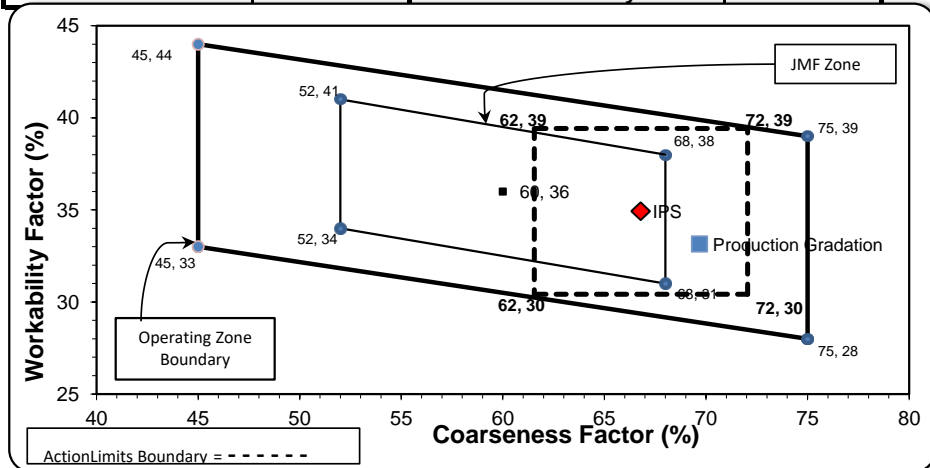

Initial Production Sample (IPS)

Coarseness Factor:	67		
Workability Factor:	35		
Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	85.0	15.0	15.0
3/4"	72.1	12.9	27.9
1/2"	64.5	7.6	35.5
3/8"	56.5	8.0	43.5
#4	42.7	13.8	57.3
#8	34.9	7.8	65.1
#16	29.0	5.9	71.0
#30	21.0	8.0	79.0
#50	8.2	12.8	91.8
#100	1.6	6.5	98.4
LBW	0.7	0.9	99.3

PREPARED BY:
 SM, LLC Technical Service

Approved By:

Aggregate Optimization Chart

PLANT #: **P-39**

Sample Date: 7/15/24

Concrete Grade: **P1M, 3500HP**

Dates Test Represents: 7/16/2024 through 7/22/2024

Contractor: _____

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
CA	71-47	Presque Isle	970	5.93	2.62	31.6
IA	71-47	Presque Isle	850	5.20	2.62	27.7
2NS	44-051	Krake Willis Rd	1250	7.56	2.65	40.7
Total Wt			3070	18.69		100.0

<----- Verify this number is 100%




Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	97.5	100.0	100.0	99.2	0.8	0.8
1"	55.4	100.0	100.0	85.9	13.3	14.1
3/4"	23.1	98.2	100.0	75.2	10.7	24.8
1/2"	9.4	75.0	100.0	64.5	10.8	35.5
3/8"	7.3	43.0	100.0	54.9	9.5	45.1
#4	3.2	4.1	99.2	42.5	12.4	57.5
#8	2.2	1.2	84.4	35.4	7.1	64.6
#16	2.1	0.9	68.1	28.6	6.8	71.4
#30	2.0	0.8	49.9	21.2	7.5	78.8
#50	1.9	0.8	22.5	10.0	11.2	90.0
#100	1.8	0.8	5.3	2.9	7.0	97.1
LBW	1.4	0.6	0.5	0.8	2.1	99.2

*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations

Coarseness Factor: **70** **Workability Factor:** **35**

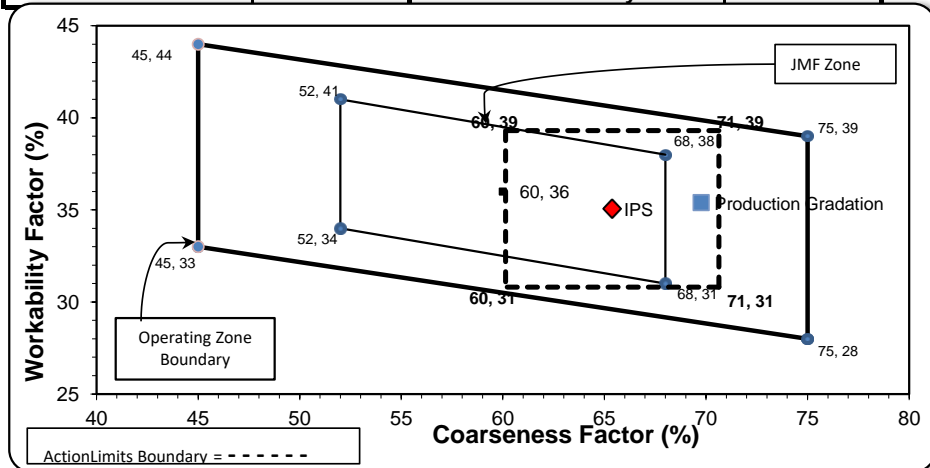

Initial Production Sample (IPS)

Coarseness Factor: 65		Workability Factor: 35	
Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	99.6	0.4	0.4
1"	83.9	15.7	16.1
3/4"	74.1	9.8	25.9
1/2"	64.3	9.7	35.7
3/8"	57.5	6.8	42.5
#4	44.5	13.1	55.5
#8	35.1	9.4	64.9
#16	27.9	7.2	72.1
#30	21.7	6.2	78.3
#50	12.6	9.1	87.4
#100	3.5	9.1	96.5
LBW	1.2	2.4	98.8

PREPARED BY:
 SM, LLC Technical Service

Approved By:

Aggregate Optimization Chart

PLANT #: **P-02**

Sample Date: 7/15/24

Concrete Grade: **P1M, 3500HP**

Dates Test Represents: 7/16/2024 through 7/22/2024

Contractor: _____

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
CA	71-47	Presque Isle	1020	6.24	2.62	33.2
IA	71-47	Presque Isle	850	5.20	2.62	27.7
2NS	63-115	Ray Rd	1200	7.26	2.65	39.1
Total Wt			3070	18.70		100.0

<----- Verify this number is 100%




Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	97.5	100.0	100.0	99.2	0.8	0.8
1"	55.4	100.0	100.0	85.2	14.0	14.8
3/4"	23.1	98.2	100.0	74.0	11.2	26.0
1/2"	9.4	75.0	100.0	63.0	11.0	37.0
3/8"	7.3	43.0	100.0	53.4	9.6	46.6
#4	3.2	4.1	96.8	40.0	13.4	60.0
#8	2.2	1.2	80.2	32.4	7.6	67.6
#16	2.1	0.9	64.6	26.2	6.2	73.8
#30	2.0	0.8	49.4	20.2	6.0	79.8
#50	1.9	0.8	27.7	11.7	8.5	88.3
#100	1.8	0.8	7.3	3.7	8.0	96.3
LBW	1.4	0.6	0.7	0.9	2.8	99.1

*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation Batch Plant Gradations Aggregate Supplier Gradations

Coarseness Factor: **69** **Workability Factor:** **32**

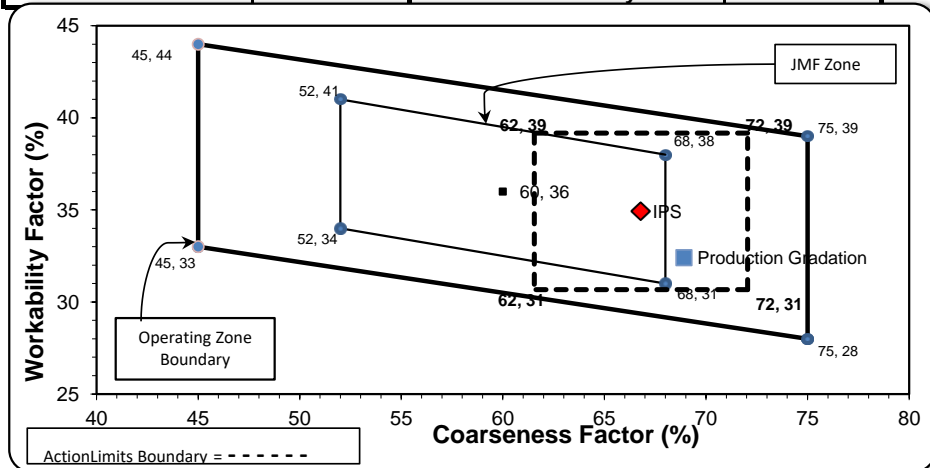

Initial Production Sample (IPS)

Coarseness Factor: **67**
Workability Factor: **35**

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	85.0	15.0	15.0
3/4"	72.3	12.7	27.7
1/2"	64.5	7.8	35.5
3/8"	56.5	8.0	43.5
#4	42.7	13.8	57.3
#8	34.9	7.8	65.1
#16	29.0	5.9	71.0
#30	21.0	8.0	79.0
#50	8.2	12.8	91.8
#100	1.6	6.5	98.4
LBW	0.7	0.9	99.3

PREPARED BY:
 SM, LLC Technical Service

Approved By: