

# Aggregate Optimization Chart

**PLANT #:** **P-101**

Sample Date: 8/28/23

Concrete Grade: **P1M, 3500HP**

Contractor: \_\_\_\_\_

Dates Test Represents: 8/29/2023 through 9/4/2023

MDOT No.: \_\_\_\_\_

Agg. Class	Pit #	Source	Weight (SSD)	ft <sup>3</sup>	Specific Gravity	% Contribution
CA	71-47	Presque Isle	1070	6.54	2.62	34.9
IA	71-47	Presque Isle	800	4.89	2.62	26.1
2NS	75-051	Mid Michigan	1200	7.23	2.66	39.1
<b>Total Wt</b>			<b>3070</b>	<b>18.67</b>		<b>100.0</b>

<---- Verify this number is 100%



**Superior Materials, LLC**  
 30701 W. 10 Mile Rd.  
 Suite 500  
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	94.8	100.0	100.0	98.2	1.8	1.8
1"	34.4	100.0	100.0	77.1	21.1	22.9
3/4"	10.8	98.5	100.0	68.5	8.6	31.5
1/2"	3.9	83.2	100.0	62.1	6.4	37.9
3/8"	3.4	63.7	100.0	56.9	5.3	43.1
#4	3.0	17.3	96.1	43.1	13.8	56.9
#8	2.8	4.5	80.1	33.5	9.7	66.5
#16	2.7	2.7	65.1	27.1	6.4	72.9
#30	2.6	2.3	50.1	21.1	6.0	78.9
#50	2.5	2.1	26.5	11.8	9.3	88.2
#100	2.2	1.9	7.1	4.0	7.7	96.0
LBW	1.8	1.7	1.1	1.5	2.5	98.5

\*Maximum % Retained must be above the 3/8" sieve.  
 \*Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.


Production Gradation  Batch Plant Gradations  Aggregate Supplier Gradations

<b>Coarseness Factor:</b>	<b>65</b>	<b>Workability Factor:</b>	<b>33</b>
---------------------------	-----------	----------------------------	-----------

Initial Production Sample (IPS)

<b>Coarseness Factor:</b>	<b>66</b>
<b>Workability Factor:</b>	<b>35</b>

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	99.6	0.4	0.4
1"	84.3	15.3	15.7
3/4"	74.8	9.6	25.2
1/2"	64.3	10.4	35.7
3/8"	56.8	7.5	43.2
#4	43.0	13.8	57.0
#8	34.9	8.1	65.1
#16	26.4	8.5	73.6
#30	19.9	6.5	80.1
#50	10.4	9.5	89.6
#100	3.4	7.0	96.6
LBW	1.2	2.2	98.8

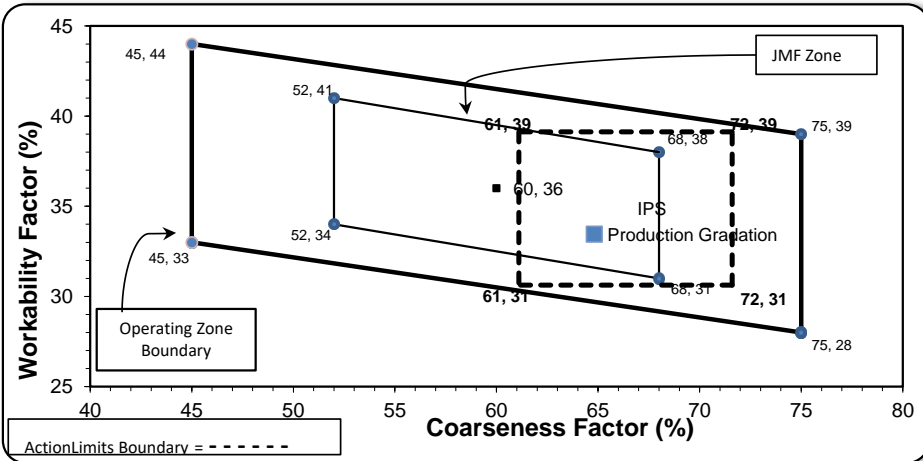

PREPARED BY:  
 SM, LLC Technical Service

Approved By:

# Aggregate Optimization Chart

**PLANT #:** **P-102**

Sample Date: 8/28/23

Concrete Grade: **P1M, 3500HP**

Dates Test Represents: 8/29/2023 through 9/4/2023

Contractor: \_\_\_\_\_

MDOT No.: \_\_\_\_\_

Agg. Class	Pit #	Source	Weight (SSD)	ft <sup>3</sup>	Specific Gravity	% Contribution
CA	58-003	Stoneco	1370	8.16	2.69	43.9
IA	58-003	Stoneco	550	3.28	2.69	17.6
2NS	81-019	Pleasant Lake	1200	7.26	2.65	38.5
<b>Total Wt</b>			<b>3120</b>	<b>18.70</b>		<b>100.0</b>

<----- Verify this number is 100%




**Superior Materials, LLC**  
 30701 W. 10 Mile Rd.  
 Suite 500  
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	65.3	100.0	100.0	84.8	15.2	15.2
3/4"	37.5	100.0	100.0	72.6	12.2	27.4
1/2"	19.7	91.9	100.0	63.3	9.2	36.7
3/8"	13.0	73.4	100.0	57.1	6.2	42.9
#4	3.4	18.1	97.4	42.1	15.0	57.9
#8	2.0	5.5	82.3	33.5	8.6	66.5
#16	1.7	3.2	65.1	26.3	7.2	73.7
#30	1.5	2.4	46.3	18.9	7.5	81.1
#50	1.4	2.1	23.3	9.9	8.9	90.1
#100	1.3	1.9	5.9	3.2	6.8	96.8
LBW	1.0	1.6	1.0	1.1	2.1	98.9

\*Maximum % Retained must be above the 3/8" sieve.  
 \*Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation  Batch Plant Gradations  Aggregate Supplier Gradations

<b>Coarseness Factor:</b>	<b>64</b>	<b>Workability Factor:</b>	<b>34</b>
---------------------------	-----------	----------------------------	-----------

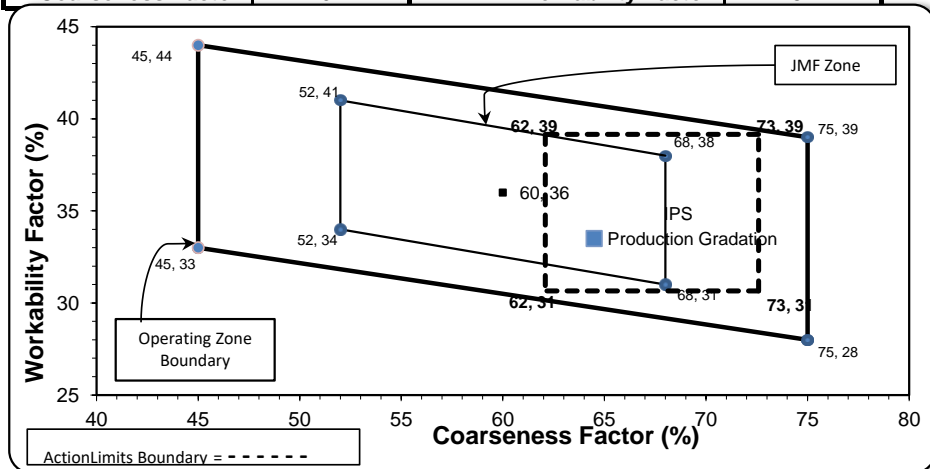

Initial Production Sample (IPS)

<b>Coarseness Factor:</b>	<b>67</b>		
<b>Workability Factor:</b>	<b>35</b>		
Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	85.5	14.5	14.5
3/4"	73.4	12.1	26.6
1/2"	61.0	12.4	39.0
3/8"	56.2	4.8	43.8
#4	43.1	13.1	56.9
#8	34.9	8.2	65.1
#16	29.4	5.5	70.6
#30	21.6	7.8	78.4
#50	8.1	13.4	91.9
#100	2.2	5.9	97.8
LBW	1.4	0.8	98.6

PREPARED BY:  
 SM, LLC Technical Service

Approved By:

# Aggregate Optimization Chart

**PLANT #:** **P-103**

Sample Date: 8/28/23

Concrete Grade: **P1M, 3500HP**

Dates Test Represents: 8/29/2023 through 9/4/2023

Contractor: \_\_\_\_\_

MDOT No.: \_\_\_\_\_

Agg. Class	Pit #	Source	Weight (SSD)	ft <sup>3</sup>	Specific Gravity	% Contribution
CA	58-003	Stoneco	1370	8.16	2.69	43.9
IA	58-003	Stoneco	550	3.28	2.69	17.6
2NS	81-019	Pleasant Lake	1200	7.26	2.65	38.5
<b>Total Wt</b>			<b>3120</b>	<b>18.70</b>		<b>100.0</b>

<----- Verify this number is 100%




**Superior Materials, LLC**  
 30701 W. 10 Mile Rd.  
 Suite 500  
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	65.3	100.0	100.0	84.8	15.2	15.2
3/4"	37.5	100.0	100.0	72.6	12.2	27.4
1/2"	19.7	91.9	100.0	63.3	9.2	36.7
3/8"	13.0	73.4	100.0	57.1	6.2	42.9
#4	3.4	18.1	97.4	42.1	15.0	57.9
#8	2.0	5.5	82.3	33.5	8.6	66.5
#16	1.7	3.2	65.1	26.3	7.2	73.7
#30	1.5	2.4	46.3	18.9	7.5	81.1
#50	1.4	2.1	23.3	9.9	8.9	90.1
#100	1.3	1.9	5.9	3.2	6.8	96.8
LBW	1.0	1.6	1.0	1.1	2.1	98.9

\*Maximum % Retained must be above the 3/8" sieve.  
 \*Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation  Batch Plant Gradations  Aggregate Supplier Gradations

<b>Coarseness Factor:</b>	<b>64</b>	<b>Workability Factor:</b>	<b>34</b>
---------------------------	-----------	----------------------------	-----------

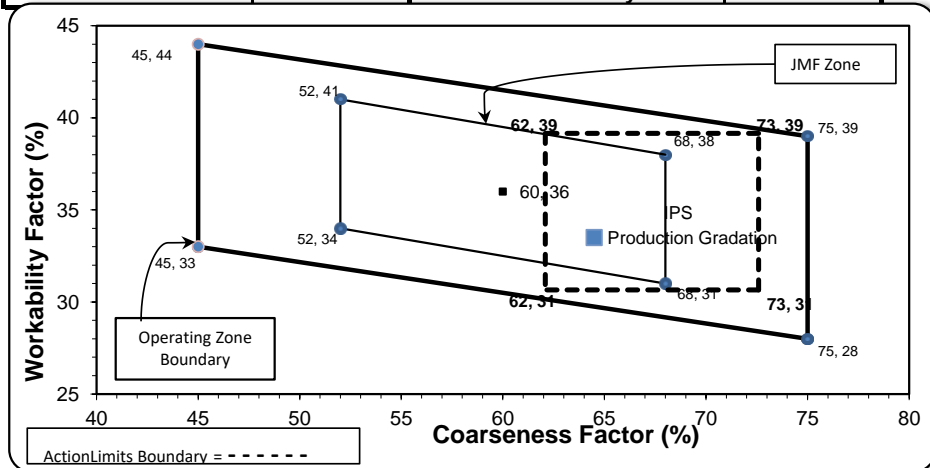

Initial Production Sample (IPS)

<b>Coarseness Factor:</b>	<b>67</b>		
<b>Workability Factor:</b>	<b>35</b>		
Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	85.5	14.5	14.5
3/4"	73.4	12.1	26.6
1/2"	61.0	12.4	39.0
3/8"	56.2	4.8	43.8
#4	43.1	13.1	56.9
#8	34.9	8.2	65.1
#16	29.4	5.5	70.6
#30	21.6	7.8	78.4
#50	8.1	13.4	91.9
#100	2.2	5.9	97.8
LBW	1.4	0.8	98.6

PREPARED BY:  
 SM, LLC Technical Service

Approved BY:

# Aggregate Optimization Chart

**PLANT #:** 14

Sample Date: 8/28/23

Concrete Grade: **P1M, 3500HP**

Contractor: \_\_\_\_\_

Dates Test Represents: 8/29/2023 through 9/4/2023

MDOT No.: \_\_\_\_\_

Agg. Class	Pit #	Source	Weight (SSD)	ft <sup>3</sup>	Specific Gravity	% Contribution
CA	58-003	Stoneco	1370	8.16	2.69	43.9
IA	58-003	Stoneco	550	3.28	2.69	17.6
2NS	19-04	Schlegel	1200	7.20	2.67	38.5
<b>Total Wt</b>			<b>3120</b>	<b>18.64</b>		<b>100.0</b>

<----- Verify this number is 100%




**Builders Redi-Mix**  
 30701 W. 10 Mile Rd.  
 Suite 500  
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	65.3	100.0	100.0	84.8	15.2	15.2
3/4"	37.5	100.0	100.0	72.6	12.2	27.4
1/2"	19.7	91.9	100.0	63.3	9.2	36.7
3/8"	13.0	73.4	100.0	57.1	6.2	42.9
#4	3.4	18.1	99.9	43.1	14.0	56.9
#8	2.0	5.5	90.1	36.5	6.6	63.5
#16	1.7	3.2	69.4	28.0	8.5	72.0
#30	1.5	2.4	44.5	18.2	9.8	81.8
#50	1.4	2.1	14.3	6.5	11.7	93.5
#100	1.3	1.9	2.7	1.9	4.5	98.1
LBW	1.0	1.6	0.2	0.8	1.1	99.2

\*Maximum % Retained must be above the 3/8" sieve.  
 \*Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation  Batch Plant Gradations  Aggregate Supplier Gradations

<b>Coarseness Factor:</b>	<b>68</b>	<b>Workability Factor:</b>	<b>37</b>
---------------------------	-----------	----------------------------	-----------

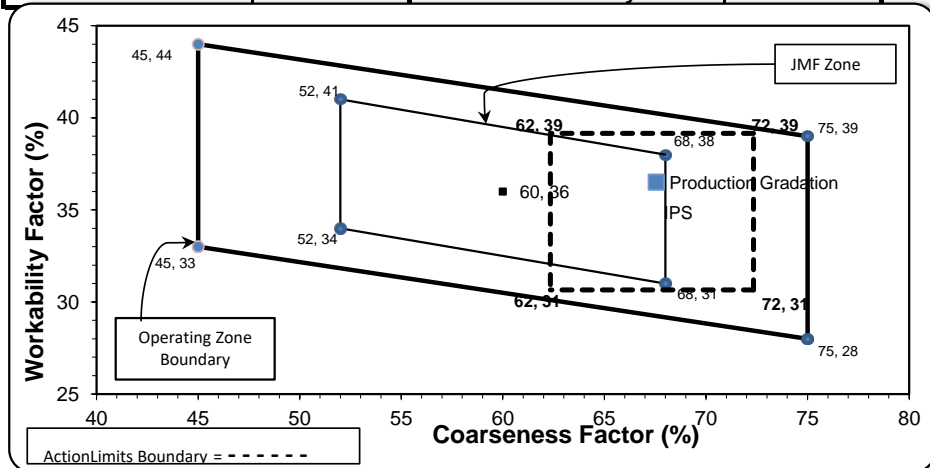

Initial Production Sample (IPS)

<b>Coarseness Factor:</b>	<b>67</b>		
<b>Workability Factor:</b>	<b>35</b>		
Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	85.5	14.5	14.5
3/4"	73.4	12.1	26.6
1/2"	61.0	12.4	39.0
3/8"	56.2	4.8	43.8
#4	43.1	13.1	56.9
#8	34.9	8.2	65.1
#16	29.4	5.5	70.6
#30	21.6	7.8	78.4
#50	8.1	13.4	91.9
#100	2.2	5.9	97.8
LBW	1.4	0.8	98.6

PREPARED BY:  
 SM, LLC Technical Service

Approved By:

# Aggregate Optimization Chart

**PLANT #:** 12

Sample Date: 8/28/23

Dates Test Represents: 8/29/2023 through 9/4/2023

Concrete Grade: **P1M, 3500HP**

Contractor: \_\_\_\_\_

MDOT No.: \_\_\_\_\_

Agg. Class	Pit #	Source	Weight (SSD)	ft <sup>3</sup>	Specific Gravity	% Contribution
CA	71-47	Presque Isle	870	5.32	2.62	28.3
IA	71-47	Presque Isle	1000	6.12	2.62	32.6
2NS	63-115	Ray Rd	1200	7.26	2.65	39.1
<b>Total Wt</b>			<b>3070</b>	<b>18.70</b>		<b>100.0</b>

<----- Verify this number is 100%




**Superior Materials, LLC**  
 30701 W. 10 Mile Rd.  
 Suite 500  
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	83.9	100.0	100.0	95.4	4.6	4.6
1"	14.8	100.0	100.0	75.9	19.6	24.1
3/4"	2.8	97.0	100.0	71.5	4.4	28.5
1/2"	1.7	65.7	100.0	61.0	10.5	39.0
3/8"	1.7	40.1	100.0	52.6	8.3	47.4
#4	1.7	6.9	96.7	40.5	12.1	59.5
#8	1.7	2.8	83.0	33.8	6.7	66.2
#16	1.6	2.2	67.8	27.7	6.2	72.3
#30	1.6	2.1	50.4	20.8	6.8	79.2
#50	1.5	2.0	25.8	11.2	9.7	88.8
#100	1.3	1.9	5.1	3.0	8.2	97.0
LBW	1.0	1.6	0.7	1.1	1.9	98.9

\*Maximum % Retained must be above the 3/8" sieve.  
 \*Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation  Batch Plant Gradations  Aggregate Supplier Gradations

<b>Coarseness Factor:</b>	<b>72</b>	<b>Workability Factor:</b>	<b>34</b>
---------------------------	-----------	----------------------------	-----------

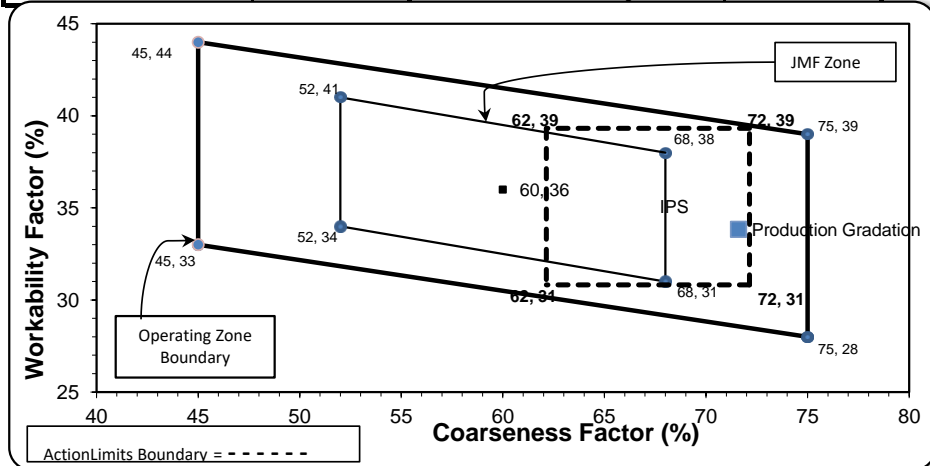

Initial Production Sample (IPS)

<b>Coarseness Factor:</b>	<b>67</b>
<b>Workability Factor:</b>	<b>35</b>

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	99.6	0.4	0.4
1"	83.9	15.7	16.1
3/4"	74.0	9.8	26.0
1/2"	63.7	10.3	36.3
3/8"	56.4	7.3	43.6
#4	43.0	13.4	57.0
#8	35.1	7.9	64.9
#16	29.0	6.1	71.0
#30	20.9	8.0	79.1
#50	8.1	12.8	91.9
#100	1.6	6.5	98.4
LBW	0.9	0.8	99.1

PREPARED BY:  
 SM, LLC Technical Service

Approved By:

# Aggregate Optimization Chart

**PLANT #:** 20

Sample Date: 8/28/23

Concrete Grade: **P1M, 3500HP**

Dates Test Represents: 8/29/2023 through 9/4/2023

Contractor: \_\_\_\_\_

MDOT No.: \_\_\_\_\_

Agg. Class	Pit #	Source	Weight (SSD)	ft <sup>3</sup>	Specific Gravity	% Contribution
CA	71-47	Presque Isle	970	5.93	2.62	31.6
IA	71-47	Presque Isle	900	5.50	2.62	29.3
2NS	63-92	Grange Hall	1200	7.26	2.65	39.1
<b>Total Wt</b>			<b>3070</b>	<b>18.70</b>		<b>100.0</b>

<----- Verify this number is 100%




**Superior Materials, LLC**  
 30701 W. 10 Mile Rd.  
 Suite 500  
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	99.3	100.0	100.0	99.8	0.2	0.2
1"	34.6	100.0	100.0	79.3	20.4	20.7
3/4"	7.8	99.2	100.0	70.6	8.7	29.4
1/2"	2.8	80.9	100.0	63.7	6.9	36.3
3/8"	2.3	57.8	100.0	56.8	6.9	43.2
#4	1.8	15.1	97.4	43.1	13.7	56.9
#8	1.6	5.6	83.3	34.7	8.4	65.3
#16	1.6	3.8	68.5	28.4	6.3	71.6
#30	1.5	3.4	49.2	20.7	7.7	79.3
#50	1.4	3.2	20.1	9.2	11.5	90.8
#100	1.3	3.0	3.3	2.6	6.7	97.4
LBW	1.0	2.6	0.6	1.3	1.3	98.7

\*Maximum % Retained must be above the 3/8" sieve.  
 \*Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation  Batch Plant Gradations  Aggregate Supplier Gradations

**Coarseness Factor:** 66      **Workability Factor:** 35

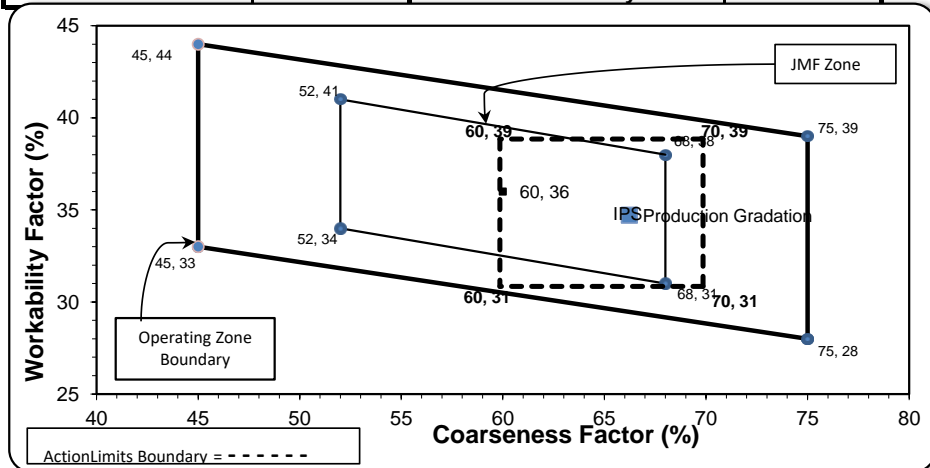

Initial Production Sample (IPS)

**Coarseness Factor:** 65  
**Workability Factor:** 35

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	99.1	0.9	0.9
1"	80.8	18.2	19.2
3/4"	71.3	9.6	28.7
1/2"	64.0	7.3	36.0
3/8"	57.7	6.2	42.3
#4	42.8	15.0	57.2
#8	34.8	7.9	65.2
#16	28.4	6.4	71.6
#30	20.2	8.2	79.8
#50	7.6	12.6	92.4
#100	1.6	6.0	98.4
LBW	1.0	0.6	99.0

PREPARED BY:  
 SM, LLC Technical Service

Approved By:

# Aggregate Optimization Chart

**PLANT #:** P11

Sample Date: 8/28/23

Concrete Grade: P1M, 3500HP

Dates Test Represents: 8/29/2023 through 9/4/2023

Contractor: \_\_\_\_\_

MDOT No.: \_\_\_\_\_

Agg. Class	Pit #	Source	Weight (SSD)	ft <sup>3</sup>	Specific Gravity	% Contribution
CA	71-47	Presque Isle	770	4.71	2.62	25.1
IA	71-47	Presque Isle	1100	6.73	2.62	35.8
2NS	95-013	Smelter Bay	1200	7.26	2.65	39.1
<b>Total Wt</b>			<b>3070</b>	<b>18.70</b>		<b>100.0</b>

<----- Verify this number is 100%




**Superior Materials, LLC**  
 30701 W. 10 Mile Rd.  
 Suite 500  
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	83.9	100.0	100.0	96.0	4.0	4.0
1"	14.8	100.0	100.0	78.6	17.3	21.4
3/4"	2.8	97.0	100.0	74.5	4.1	25.5
1/2"	1.7	65.7	100.0	63.1	11.5	36.9
3/8"	1.7	40.1	100.0	53.9	9.2	46.1
#4	1.7	6.9	96.4	40.6	13.3	59.4
#8	1.7	2.8	85.0	34.7	5.9	65.3
#16	1.6	2.2	70.0	28.6	6.1	71.4
#30	1.6	2.1	50.3	20.8	7.7	79.2
#50	1.5	2.0	24.1	10.5	10.3	89.5
#100	1.3	1.9	7.1	3.8	6.7	96.2
LBW	1.0	1.6	1.5	1.4	2.4	98.6

\*Maximum % Retained must be above the 3/8" sieve.  
 \*Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation  Batch Plant Gradations  Aggregate Supplier Gradations

<b>Coarseness Factor:</b>	<b>71</b>	<b>Workability Factor:</b>	<b>35</b>
---------------------------	-----------	----------------------------	-----------

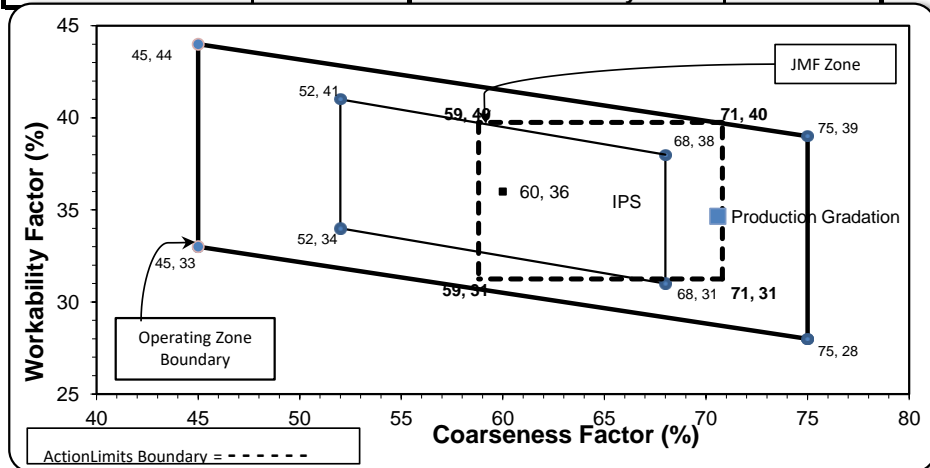

Initial Production Sample (IPS)

<b>Coarseness Factor:</b>	<b>65</b>		
<b>Workability Factor:</b>	<b>36</b>		
Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	99.0	0.6	0.6
1"	84.0	15.3	16.0
3/4"	73.5	10.5	26.5
1/2"	65.2	8.2	34.8
3/8"	58.2	7.1	41.8
#4	44.1	14.1	55.9
#8	35.5	8.6	64.5
#16	29.1	6.4	70.9
#30	21.9	7.3	78.1
#50	9.6	12.2	90.4
#100	2.6	7.1	97.4
LBW	1.0	1.6	99.0

PREPARED BY:  
 SM, LLC Technical Service

Approved By:



# Aggregate Optimization Chart

**PLANT #:** **P-32**

Sample Date: 8/28/23

Concrete Grade: **P1M, 3500HP**

Dates Test Represents: 8/29/2023 through 9/4/2023

Contractor: \_\_\_\_\_

MDOT No.: \_\_\_\_\_

Agg. Class	Pit #	Source	Weight (SSD)	ft <sup>3</sup>	Specific Gravity	% Contribution
CA	71-47	Presque Isle	770	4.71	2.62	25.1
IA	71-47	Presque Isle	1100	6.73	2.62	35.8
2NS	95-013	Smelter Bay	1200	7.26	2.65	39.1
<b>Total Wt</b>			<b>3070</b>	<b>18.70</b>		<b>100.0</b>

<----- Verify this number is 100%




**Superior Materials, LLC**  
 30701 W. 10 Mile Rd.  
 Suite 500  
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	83.9	100.0	100.0	96.0	4.0	4.0
1"	14.8	100.0	100.0	78.6	17.3	21.4
3/4"	2.8	97.0	100.0	74.5	4.1	25.5
1/2"	1.7	65.7	100.0	63.1	11.5	36.9
3/8"	1.7	40.1	100.0	53.9	9.2	46.1
#4	1.7	6.9	96.4	40.6	13.3	59.4
#8	1.7	2.8	85.0	34.7	5.9	65.3
#16	1.6	2.2	70.0	28.6	6.1	71.4
#30	1.6	2.1	50.3	20.8	7.7	79.2
#50	1.5	2.0	24.1	10.5	10.3	89.5
#100	1.3	1.9	7.1	3.8	6.7	96.2
LBW	1.0	1.6	1.5	1.4	2.4	98.6

\*Maximum % Retained must be above the 3/8" sieve.  
 \*Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation  Batch Plant Gradations  Aggregate Supplier Gradations

**Coarseness Factor:** **71**      **Workability Factor:** **35**

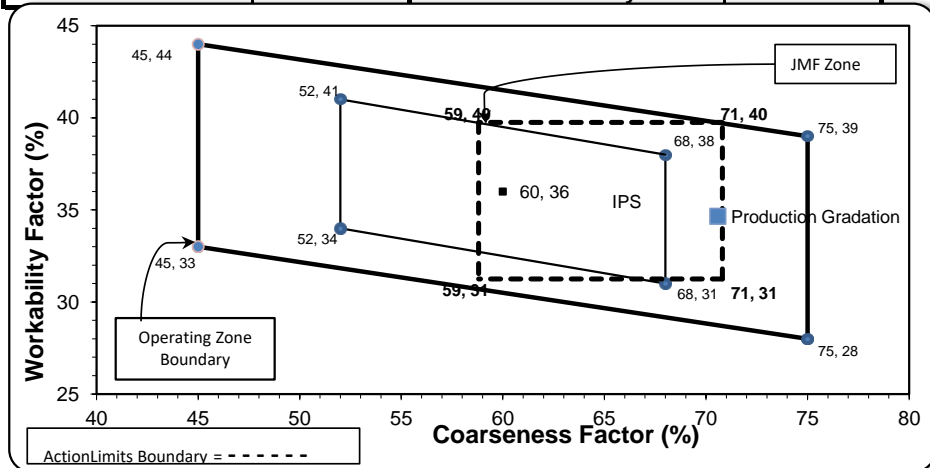

Initial Production Sample (IPS)

**Coarseness Factor:** **65**  
**Workability Factor:** **36**

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	99.0	0.6	0.6
1"	84.0	15.3	16.0
3/4"	73.5	10.5	26.5
1/2"	65.2	8.2	34.8
3/8"	58.2	7.1	41.8
#4	44.1	14.1	55.9
#8	35.5	8.6	64.5
#16	29.1	6.4	70.9
#30	21.9	7.3	78.1
#50	9.6	12.2	90.4
#100	2.6	7.1	97.4
LBW	1.0	1.6	99.0

PREPARED BY:  
 SM, LLC Technical Service

Approved By:



# Aggregate Optimization Chart

**PLANT #:** **P-35**

Sample Date: 8/28/23

Concrete Grade: **P1M, 3500HP**

Contractor: \_\_\_\_\_

Dates Test Represents: 8/29/2023 through 9/4/2023

MDOT No.: \_\_\_\_\_

Agg. Class	Pit #	Source	Weight (SSD)	ft <sup>3</sup>	Specific Gravity	% Contribution
CA	58-003	Stoneco	1370	8.16	2.69	43.9
IA	58-003	Stoneco	550	3.28	2.69	17.6
2NS	81-019	Pleasant Lake	1200	7.26	2.65	38.5
<b>Total Wt</b>			<b>3120</b>	<b>18.70</b>		<b>100.0</b>

<----- Verify this number is 100%




**Superior Materials, LLC**  
 30701 W. 10 Mile Rd.  
 Suite 500  
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	65.3	100.0	100.0	84.8	15.2	15.2
3/4"	37.5	100.0	100.0	72.6	12.2	27.4
1/2"	19.7	91.9	100.0	63.3	9.2	36.7
3/8"	13.0	73.4	100.0	57.1	6.2	42.9
#4	3.4	18.1	97.4	42.1	15.0	57.9
#8	2.0	5.5	82.3	33.5	8.6	66.5
#16	1.7	3.2	65.1	26.3	7.2	73.7
#30	1.5	2.4	46.3	18.9	7.5	81.1
#50	1.4	2.1	23.3	9.9	8.9	90.1
#100	1.3	1.9	5.9	3.2	6.8	96.8
LBW	1.0	1.6	1.0	1.1	2.1	98.9

\*Maximum % Retained must be above the 3/8" sieve.  
 \*Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation  Batch Plant Gradations  Aggregate Supplier Gradations

<b>Coarseness Factor:</b>	<b>64</b>	<b>Workability Factor:</b>	<b>34</b>
---------------------------	-----------	----------------------------	-----------

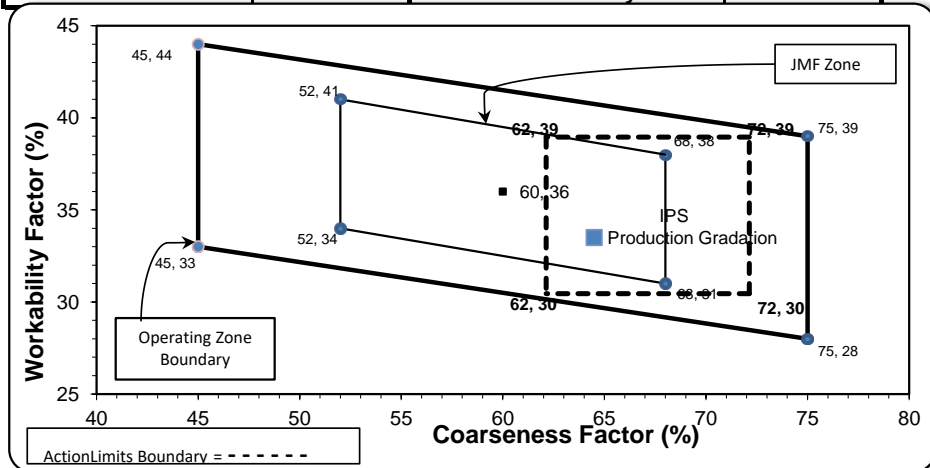

Initial Production Sample (IPS)

<b>Coarseness Factor:</b>	<b>67</b>
<b>Workability Factor:</b>	<b>35</b>

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	86.9	13.1	13.1
3/4"	76.1	10.8	23.9
1/2"	63.7	12.4	36.3
3/8"	56.2	7.5	43.8
#4	43.2	13.0	56.8
#8	34.7	8.5	65.3
#16	27.5	7.2	72.5
#30	20.6	7.0	79.4
#50	9.0	11.6	91.0
#100	2.1	6.9	97.9
LBW	1.0	1.1	99.0

PREPARED BY:  
 SM, LLC Technical Service

Approved By:

# Aggregate Optimization Chart

**PLANT #:** **P-36**

Sample Date: 8/28/23

Concrete Grade: **P1M, 3500HP**

Contractor: \_\_\_\_\_

Dates Test Represents: 8/29/2023 through 9/4/2023

MDOT No.: \_\_\_\_\_

Agg. Class	Pit #	Source	Weight (SSD)	ft <sup>3</sup>	Specific Gravity	% Contribution
CA	71-47	Presque Isle	870	5.32	2.62	28.3
IA	71-47	Presque Isle	1000	6.12	2.62	32.6
2NS	63-92	Grange Hall	1200	7.26	2.65	39.1
<b>Total Wt</b>			<b>3070</b>	<b>18.70</b>		<b>100.0</b>

<----- Verify this number is 100%




**Superior Materials, LLC**  
 30701 W. 10 Mile Rd.  
 Suite 500  
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	83.9	100.0	100.0	95.4	4.6	4.6
1"	14.8	100.0	100.0	75.9	19.6	24.1
3/4"	2.8	97.0	100.0	71.5	4.4	28.5
1/2"	1.7	65.7	100.0	61.0	10.5	39.0
3/8"	1.7	40.1	100.0	52.6	8.3	47.4
#4	1.7	6.9	97.4	40.8	11.8	59.2
#8	1.7	2.8	83.3	34.0	6.8	66.0
#16	1.6	2.2	68.5	27.9	6.0	72.1
#30	1.6	2.1	49.2	20.4	7.6	79.6
#50	1.5	2.0	20.1	8.9	11.4	91.1
#100	1.3	1.9	3.3	2.3	6.7	97.7
LBW	1.0	1.6	0.6	1.0	1.2	99.0

\*Maximum % Retained must be above the 3/8" sieve.  
 \*Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation  Batch Plant Gradations  Aggregate Supplier Gradations

<b>Coarseness Factor:</b>	<b>72</b>	<b>Workability Factor:</b>	<b>34</b>
---------------------------	-----------	----------------------------	-----------

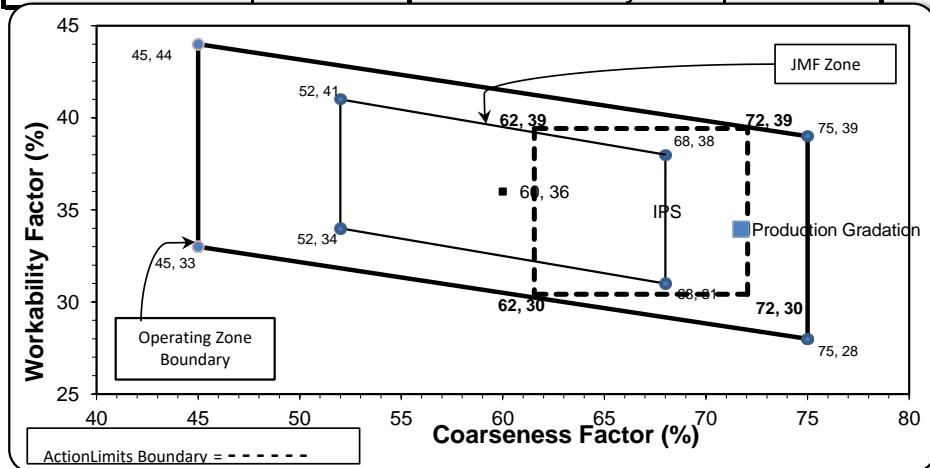

Initial Production Sample (IPS)

<b>Coarseness Factor:</b>	<b>67</b>
<b>Workability Factor:</b>	<b>35</b>

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	85.0	15.0	15.0
3/4"	72.1	12.9	27.9
1/2"	64.5	7.6	35.5
3/8"	56.5	8.0	43.5
#4	42.7	13.8	57.3
#8	34.9	7.8	65.1
#16	29.0	5.9	71.0
#30	21.0	8.0	79.0
#50	8.2	12.8	91.8
#100	1.6	6.5	98.4
LBW	0.7	0.9	99.3

PREPARED BY:  
 SM, LLC Technical Service

Approved By:

# Aggregate Optimization Chart

**PLANT #:** **P-39**

Sample Date: 8/28/23

Concrete Grade: **P1M, 3500HP**

Dates Test Represents: 8/29/2023 through 9/4/2023

Contractor: \_\_\_\_\_

MDOT No.: \_\_\_\_\_

Agg. Class	Pit #	Source	Weight (SSD)	ft <sup>3</sup>	Specific Gravity	% Contribution
CA	71-47	Presque Isle	1020	6.24	2.62	33.2
IA	71-47	Presque Isle	800	4.89	2.62	26.1
2NS	44-051	Krake Willis Rd	1250	7.56	2.65	40.7
<b>Total Wt</b>			<b>3070</b>	<b>18.69</b>		<b>100.0</b>

<----- Verify this number is 100%




**Superior Materials, LLC**  
 30701 W. 10 Mile Rd.  
 Suite 500  
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	94.8	100.0	100.0	98.3	1.7	1.7
1"	34.4	100.0	100.0	78.2	20.1	21.8
3/4"	10.8	98.5	100.0	70.0	8.2	30.0
1/2"	3.9	83.2	100.0	63.7	6.3	36.3
3/8"	3.4	63.7	100.0	58.4	5.2	41.6
#4	3.0	17.3	99.0	45.8	12.6	54.2
#8	2.8	4.5	85.0	36.7	9.1	63.3
#16	2.7	2.7	67.9	29.2	7.5	70.8
#30	2.6	2.3	50.6	22.1	7.2	77.9
#50	2.5	2.1	23.1	10.8	11.3	89.2
#100	2.2	1.9	5.8	3.6	7.2	96.4
LBW	1.8	1.7	1.0	1.4	2.1	98.6

\*Maximum % Retained must be above the 3/8" sieve.  
 \*Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation  Batch Plant Gradations  Aggregate Supplier Gradations

<b>Coarseness Factor:</b>	<b>66</b>	<b>Workability Factor:</b>	<b>37</b>
---------------------------	-----------	----------------------------	-----------

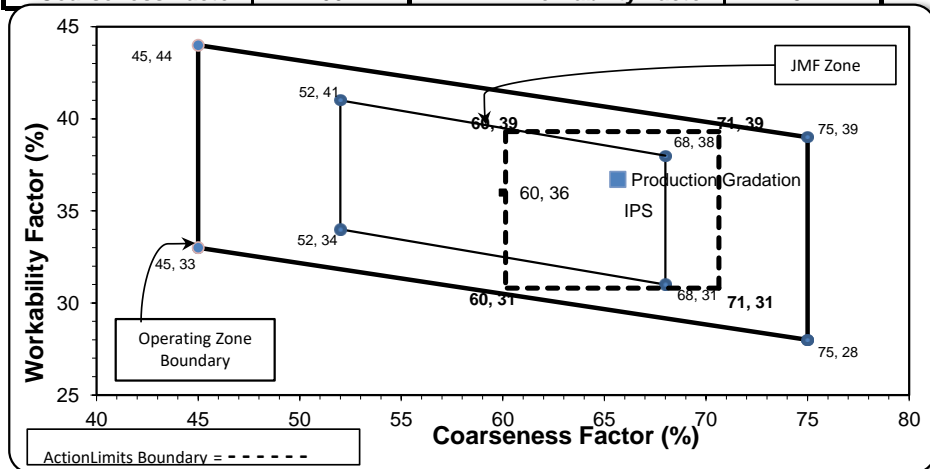

Initial Production Sample (IPS)

<b>Coarseness Factor:</b>	<b>65</b>		
<b>Workability Factor:</b>	<b>35</b>		
Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	99.6	0.4	0.4
1"	83.9	15.7	16.1
3/4"	74.1	9.8	25.9
1/2"	64.3	9.7	35.7
3/8"	57.5	6.8	42.5
#4	44.5	13.1	55.5
#8	35.1	9.4	64.9
#16	27.9	7.2	72.1
#30	21.7	6.2	78.3
#50	12.6	9.1	87.4
#100	3.5	9.1	96.5
LBW	1.2	2.4	98.8

PREPARED BY:  
 SM, LLC Technical Service

Approved By:

# Aggregate Optimization Chart

**PLANT #:** **P-02**

Sample Date: 8/28/23

Concrete Grade: **P1M, 3500HP**

Contractor: \_\_\_\_\_

Dates Test Represents: 8/29/2023 through 9/4/2023

MDOT No.: \_\_\_\_\_

Agg. Class	Pit #	Source	Weight (SSD)	ft <sup>3</sup>	Specific Gravity	% Contribution
CA	71-47	Presque Isle	870	5.32	2.62	28.3
IA	71-47	Presque Isle	1000	6.12	2.62	32.6
2NS	63-115	Ray Rd	1200	7.26	2.65	39.1
<b>Total Wt</b>			<b>3070</b>	<b>18.70</b>		<b>100.0</b>

<----- Verify this number is 100%




**Superior Materials, LLC**  
 30701 W. 10 Mile Rd.  
 Suite 500  
 Farmington Hills, MI 48336

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	83.9	100.0	100.0	95.4	4.6	4.6
1"	14.8	100.0	100.0	75.9	19.6	24.1
3/4"	2.8	97.0	100.0	71.5	4.4	28.5
1/2"	1.7	65.7	100.0	61.0	10.5	39.0
3/8"	1.7	40.1	100.0	52.6	8.3	47.4
#4	1.7	6.9	96.7	40.5	12.1	59.5
#8	1.7	2.8	83.0	33.8	6.7	66.2
#16	1.6	2.2	67.8	27.7	6.2	72.3
#30	1.6	2.1	50.4	20.8	6.8	79.2
#50	1.5	2.0	25.8	11.2	9.7	88.8
#100	1.3	1.9	5.1	3.0	8.2	97.0
LBW	1.0	1.6	0.7	1.1	1.9	98.9

\*Maximum % Retained must be above the 3/8" sieve.  
 \*Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.

Production Gradation  Batch Plant Gradations  Aggregate Supplier Gradations

<b>Coarseness Factor:</b>	<b>72</b>	<b>Workability Factor:</b>	<b>34</b>
---------------------------	-----------	----------------------------	-----------

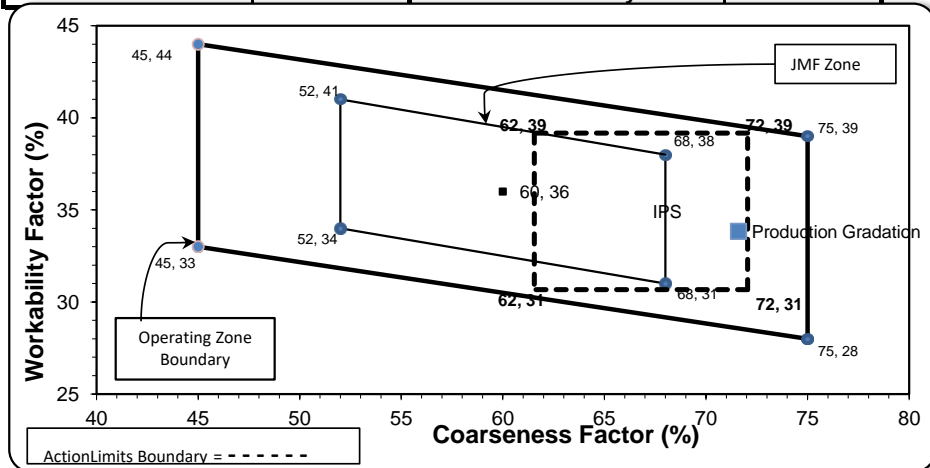

Initial Production Sample (IPS)

<b>Coarseness Factor:</b>	<b>67</b>		
<b>Workability Factor:</b>	<b>35</b>		
Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	85.0	15.0	15.0
3/4"	72.3	12.7	27.7
1/2"	64.5	7.8	35.5
3/8"	56.5	8.0	43.5
#4	42.7	13.8	57.3
#8	34.9	7.8	65.1
#16	29.0	5.9	71.0
#30	21.0	8.0	79.0
#50	8.2	12.8	91.8
#100	1.6	6.5	98.4
LBW	0.7	0.9	99.3

PREPARED BY:  
 SM, LLC Technical Service

Approved By: