

# Aggregate Optimization Chart

# Production Gradation Report

**PLANT #:** P-102

Sample Date: 7/14/25

Concrete Grade: DM, 4500HP

Contractor: \_\_\_\_\_

Dates Test Represents: 7/15/2025 through 7/21/2025

MDOT No.: \_\_\_\_\_

Agg. Class	Pit #	Source	Weight (SSD)	ft <sup>3</sup>	Specific Gravity	% Contribution
6AA	58-003	Stoneco	1550	9.23	2.69	52.5
26A	58-003	Stoneco	250	1.49	2.69	8.5
2NS	63-114	Highland	1150	6.95	2.65	39.0
<b>Total Wt</b>			<b>2950</b>	<b>17.68</b>		<b>100.0</b>

<----- Verify this number is 100%



**Superior Materials, LLC**  
 30701 W. 10 Mile Rd.  
 Suite 500  
 Farmington Hills, MI 48336

Sieve	6AA	26A	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	100.0	100.0	100.0	100.0	0.0	0.0
3/4"	85.3	100.0	100.0	92.3	7.7	7.7
1/2"	40.2	99.0	100.0	68.5	23.8	31.5
3/8"	20.9	90.4	100.0	57.6	10.9	42.4
#4	2.9	19.2	98.9	41.7	15.9	58.3
#8	1.2	7.0	84.0	34.0	7.7	66.0
#16	0.9	2.8	68.6	27.5	6.5	72.5
#30	0.8	2.2	50.0	20.1	7.4	79.9
#50	0.8	1.9	21.0	8.8	11.3	91.2
#100	0.8	1.8	3.9	2.1	6.7	97.9
LBW	0.7	1.8	0.9	0.9	1.2	99.1


\*Maximum % Retained must be above the 3/8" sieve.  
 \*Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 4% for the 3/4" sieve when a 1.5" max. size (nom. Max. 1.0") aggregate is used.

Production Gradation  Batch Plant Gradations  Aggregate Supplier Gradations  Adjusted WF Initial Production Sample (IPS)

**Coarseness Factor:** **64**      **Workability Factor:** **34**      **36.5**

**Coarseness Factor:** **61**

**Workability Factor:** **36**

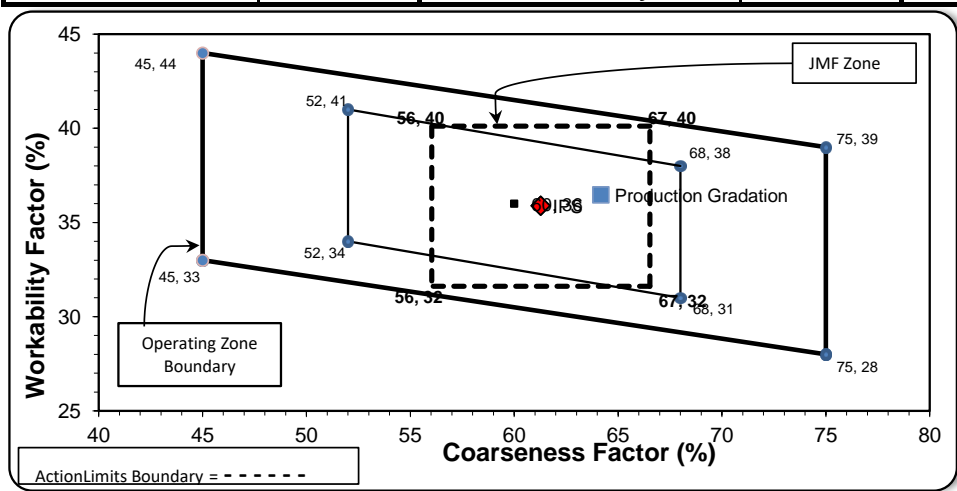

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	99.3	0.7	0.7
3/4"	89.2	10.1	10.8
1/2"	70.7	18.5	29.3
3/8"	60.7	10.0	39.3
#4	44.4	16.3	55.6
#8	35.9	8.5	64.1
#16	27.3	8.6	72.7
#30	19.1	8.2	80.9
#50	7.4	11.7	92.6
#100	1.9	5.6	98.1
LBW	0.7	1.2	99.3

PREPARED BY:  
 SM, LLC Technical Service

Approved By:



# Daily Summary Report

Date Thursday, July 17, 2025

	Sample Id -847327128	-674976874	-1989634181
Plant	S102 Superior Novi	S102 Superior Novi	S102 Superior Novi
Product	1051 6AA LS	1022 2NS GR	1067 26A Mod LS
Specification	6AA LS	2NS GR Spec	26A Mod LS Spec
Sample Type	QA	QA	QA
<hr/>			
2" (50mm)	100.0		100.0
1 1/2" (37.5mm)	100.0		100.0
1" (25mm)	100.0		100.0
3/4" (19mm)	85.3		100.0
1/2" (12.5mm)	40.2		99.0
3/8" (9.5mm)	20.9	100.0	90.4
#4 (4.75mm)	2.9	98.9	19.2
#8 (2.36mm)	1.2	84.0	7.0
#16 (1.18mm)	0.9	68.6	2.8
#30 (.6mm)	0.8	50.0	2.2
#50 (.3mm)	0.8	21.0	1.9
#100 (.15mm)	0.8	3.9	1.8
#200 (75µm)	0.76	1.1	1.8
Pan	0.00	0.0	0.0
FM		2.74	
Wash Loss (#200/75um)	0.7	0.9	1.8
Total Moisture	3.72	3.78	4.40

# Aggregate Optimization Chart

# Production Gradation Report

**PLANT #:** P-103

Sample Date: 7/14/25

Concrete Grade: DM, 4500HP

Contractor: \_\_\_\_\_

Dates Test Represents: 7/15/2025 through 7/21/2025

MDOT No.: \_\_\_\_\_

Agg. Class	Pit #	Source	Weight (SSD)	ft <sup>3</sup>	Specific Gravity	% Contribution
6AA	58-003	Stoneco	1550	9.23	2.69	52.5
26A	58-003	Stoneco	250	1.49	2.69	8.5
2NS	63-114	Highland	1150	6.95	2.65	39.0
<b>Total Wt</b>			<b>2950</b>	<b>17.68</b>		<b>100.0</b>

<----- Verify this number is 100%



**Superior Materials, LLC**  
 30701 W. 10 Mile Rd.  
 Suite 500  
 Farmington Hills, MI 48336

Sieve	6AA	26A	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	100.0	100.0	100.0	100.0	0.0	0.0
3/4"	87.2	100.0	100.0	93.3	6.7	6.7
1/2"	47.9	98.9	100.0	72.5	20.7	27.5
3/8"	24.1	86.2	100.0	59.0	13.6	41.0
#4	5.1	12.0	99.2	42.4	16.6	57.6
#8	2.5	2.6	84.4	34.4	7.9	65.6
#16	2.1	1.8	67.3	27.5	6.9	72.5
#30	2.0	1.6	48.1	19.9	7.6	80.1
#50	1.9	1.4	17.8	8.1	11.9	91.9
#100	1.8	1.3	3.7	2.5	5.6	97.5
LBW	1.6	1.2	0.5	1.1	1.4	98.9


\*Maximum % Retained must be above the 3/8" sieve.  
 \*Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 4% for the 3/4" sieve when a 1.5" max. size (nom. Max. 1.0") aggregate is used.

Production Gradation  Batch Plant Gradations  Aggregate Supplier Gradations  Adjusted WF Initial Production Sample (IPS)

**Coarseness Factor:** **63**      **Workability Factor:** **34**      **36.9**

**Coarseness Factor:** **61**

**Workability Factor:** **36**

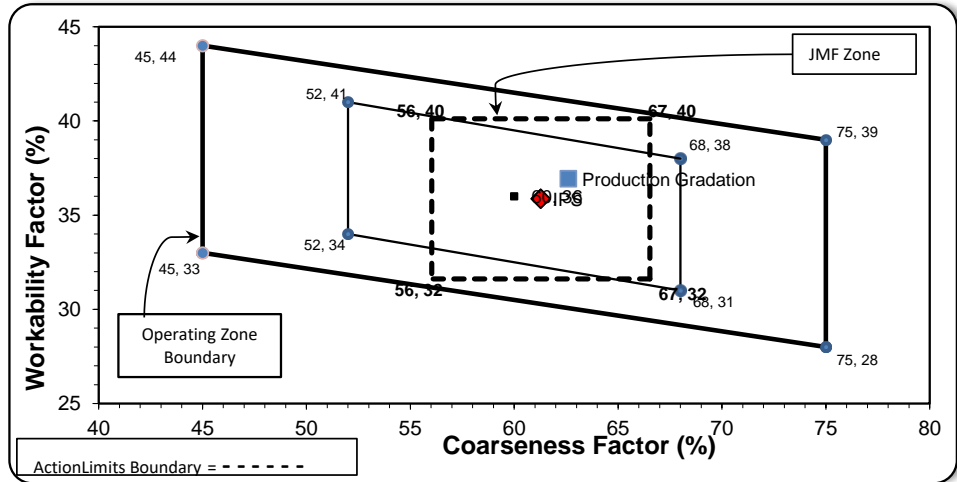

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	99.3	0.7	0.7
3/4"	89.2	10.1	10.8
1/2"	70.7	18.5	29.3
3/8"	60.7	10.0	39.3
#4	44.4	16.3	55.6
#8	35.9	8.5	64.1
#16	27.3	8.6	72.7
#30	19.1	8.2	80.9
#50	7.4	11.7	92.6
#100	1.9	5.6	98.1
LBW	0.7	1.2	99.3

PREPARED BY:  
 SM, LLC Technical Service

Approved BY:



# Daily Summary Report

Date Tuesday, July 15, 2025

Sample Id	-1989628960	-674920514	-1989629001	-674987314	-674960777
Plant	S103 Superior Brighton	S103 Superior Brighton	S103 Superior Brighton	S103 Superior Brighton	S103 Superior Brighton
Product	7920 INTERMED AGG P1M LS	7919 COARSE AGG P1M LS	1051 6AA LS	1067 26A Mod LS	1022 2NS GR
Specification	Intermed Agg P1M LS Target	Coarse Agg P1M LS Target	6AA LS	26A Mod LS Spec	2NS GR Spec
Sample Type	QA	QA	QA	QA	QA
2" (50mm)	100.0	100.0	100.0	100.0	
1 1/2" (37.5mm)	100.0	97.3	100.0	100.0	
1" (25mm)	100.0	37.7	100.0	100.0	
3/4" (19mm)	100.0	11.9	87.2	100.0	
1/2" (12.5mm)	83.7	5.2	47.9	98.9	
3/8" (9.5mm)	54.5	3.4	24.1	86.2	100.0
#4 (4.75mm)	4.7	1.6	5.1	12.0	99.2
#8 (2.36mm)	2.4	1.3	2.5	2.6	84.4
#16 (1.18mm)	2.2	1.2	2.1	1.8	67.3
#30 (.6mm)	2.2	1.2	2.0	1.6	48.1
#50 (.3mm)	1.9	1.2	1.9	1.4	17.8
#100 (.15mm)	1.9	1.1	1.8	1.3	3.7
#200 (75µm)	1.9	1.1	1.68	1.3	0.7
Pan	0.0	0.0	0.00	0.0	0.0
FM					2.80
Wash Loss (#200/75um)	1.8	1.0	1.6	1.2	0.5
Total Moisture	1.90	0.67	2.00	3.49	3.85

# Aggregate Optimization Chart

**PLANT #:** p11

Contractor: \_\_\_\_\_

Sample Date: 7/14/25

Concrete Grade: DM, 4500HP

Dates Test Represents: 7/15/2025 through 7/21/2025

MDOT No.: \_\_\_\_\_

Agg. Class	Pit #	Source	Weight (SSD)	ft <sup>3</sup>	Specific Gravity	% Contribution
6AA	71-47	Presque Isle	1450	8.87	2.62	49.9
26A	71-47	Presque Isle	305	1.87	2.62	10.5
2NS	63-115	Ray Rd	1150	6.95	2.65	39.6
<b>Total Wt</b>			<b>2905</b>	<b>17.69</b>		<b>100.0</b>

<----- Verify this number is 100%



**Superior Materials, LLC**  
 30701 W. 10 Mile Rd.  
 Suite 500  
 Farmington Hills, MI 48336


Sieve	6AA	26A	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	97.4	100.0	100.0	98.7	1.3	1.3
3/4"	84.2	100.0	100.0	92.1	6.6	7.9
1/2"	51.9	96.5	100.0	75.6	16.5	24.4
3/8"	28.9	82.2	100.0	62.6	13.0	37.4
#4	3.0	22.3	96.9	42.2	20.4	57.8
#8	2.7	8.9	81.6	34.6	7.6	65.4
#16	2.2	5.4	65.7	27.7	6.9	72.3
#30	2.1	4.4	48.4	20.7	7.0	79.3
#50	2.0	4.0	24.8	11.2	9.4	88.8
#100	1.9	3.6	5.7	3.6	7.7	96.4
LBW	1.7	3.0	1.0	1.6	2.0	98.4

\*Maximum % Retained must be above the 3/8" sieve.  
 \*Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.  
 \*% Retained must be at least 4% for the 3/4" sieve when a 1.5" max. size (nom. Max. 1.0") aggregate is used.

Production Gradation  Batch Plant Gradations  Aggregate Supplier Gradations

Adjusted WF Initial Production Sample (IPS)

<b>Coarseness Factor:</b>	<b>57</b>	<b>Workability Factor:</b>	<b>35</b>	<b>Adjusted WF</b>	<b>37.1</b>	<b>Coarseness Factor:</b>	<b>62</b>
---------------------------	-----------	----------------------------	-----------	--------------------	-------------	---------------------------	-----------

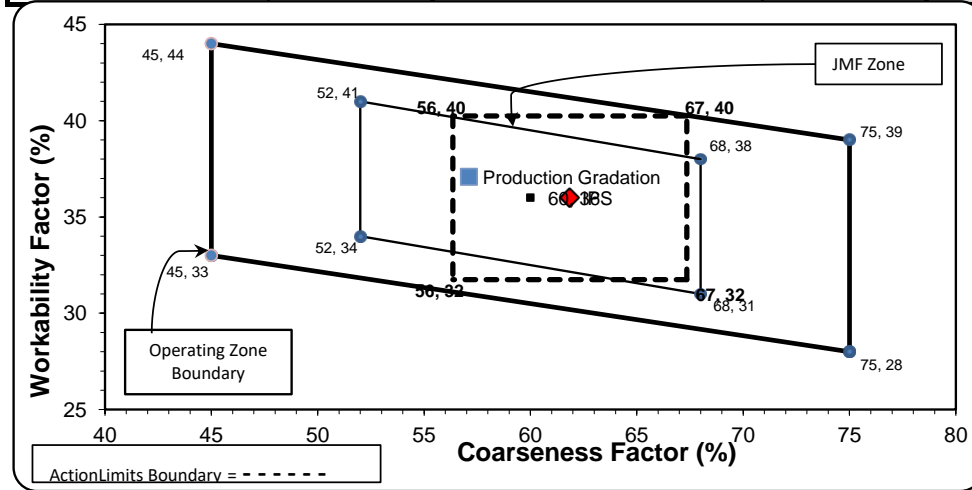

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	100.0	0.0	0.0
3/4"	95.0	5.0	5.0
1/2"	72.3	22.8	27.7
3/8"	60.4	11.8	39.6
#4	42.6	17.8	57.4
#8	36.0	6.6	64.0
#16	29.5	6.5	70.5
#30	20.3	9.2	79.7
#50	9.5	10.8	90.5
#100	3.4	6.1	96.6
LBW	1.3	2.1	98.7

PREPARED BY:  
 SM, LLC Technical Service

Approved By:

## Daily Summary Report

Date Tuesday, July 15, 2025

Sample Id	-674982272	-674902453	-1989637426	-674970028	-674935404
Plant	S000 Superior Onsite	S000 Superior Onsite	S000 Superior Onsite	S000 Superior Onsite	S000 Superior Onsite
Product	1067 26A Mod LS	7919 COARSE AGG P1M LS	1051 6AA LS	7920 INTERMED AGG P1M LS	1022 2NS GR
Specification	26A Mod LS Spec	Coarse Agg P1M LS Target		Intermed Agg P1M LS Target	2NS GR Spec
Sample Type	QA	QA	QA	QA	QA
2" (50mm)	100.0	100.0	100.0	100.0	
1 1/2" (37.5mm)	100.0	97.7	100.0	100.0	
1" (25mm)	100.0	33.7	97.4	100.0	
3/4" (19mm)	100.0	9.1	84.2	93.7	
1/2" (12.5mm)	96.5	2.8	51.9	59.8	
3/8" (9.5mm)	82.2	2.1	28.9	32.5	100.0
#4 (4.75mm)	22.3	1.8	3.0	5.5	96.9
#8 (2.36mm)	8.9	1.8	2.7	2.5	81.6
#16 (1.18mm)	5.4	1.7	2.2	1.9	65.7
#30 (.6mm)	4.4	1.7	2.1	1.8	48.4
#50 (.3mm)	4.0	1.6	2.0	1.7	24.8
#100 (.15mm)	3.6	1.5	1.9	1.6	5.7
#200 (75µm)	3.2	1.3	1.73	1.5	1.4
Pan	0.0	0.0	0.00	0.0	0.0
FM					2.77
-#200 (75um)					1.4
Wash Loss (#200/75um)	3.0	1.2	1.7	1.5	1.0
Total Moisture	2.6	1.8	2.5	2.0	4.3