

Aggregate Optimization Chart

Production Gradation Report

PLANT #: **P-101**

Contractor: _____

Sample Date: 8/11/25

Concrete Grade: **P1M, 3500HP, 4000HP**

Dates Test Represents: 8/12/2025 through 8/18/2025

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
CA	71-47	Presque Isle	970	5.93	2.62	31.6
IA	71-47	Presque Isle	900	5.50	2.62	29.3
2NS	75-051	Mid Michigan	1200	7.23	2.66	39.1
Total Wt			3070	18.67		100.0

<----- Verify this number is 100%

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	94.7	100.0	100.0	98.3	1.7	1.7
1"	46.1	100.0	100.0	83.0	15.4	17.0
3/4"	13.6	98.0	100.0	72.1	10.9	27.9
1/2"	5.0	81.1	100.0	64.4	7.7	35.6
3/8"	4.2	56.3	100.0	56.9	7.5	43.1
#4	3.5	14.9	97.5	43.6	13.3	56.4
#8	3.3	6.4	84.1	35.8	7.8	64.2
#16	3.2	5.1	70.5	30.1	5.7	69.9
#30	3.1	4.7	55.1	23.9	6.2	76.1
#50	2.9	4.2	29.0	13.5	10.4	86.5
#100	2.7	3.3	7.4	4.7	8.8	95.3
LBW	2.1	2.5	0.5	1.6	3.1	98.4

*Maximum % Retained must be above the 3/8" sieve.

*Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.

*% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.

*% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.




Superior Materials, LLC

30701 W. 10 Mile Rd.
Suite 500
Farmington Hills, MI 48336

Production Gradation ☒ Batch Plant Gradations ☐ Aggregate Supplier Gradations

Coarseness Factor:	67	Workability Factor:	36
---------------------------	-----------	----------------------------	-----------

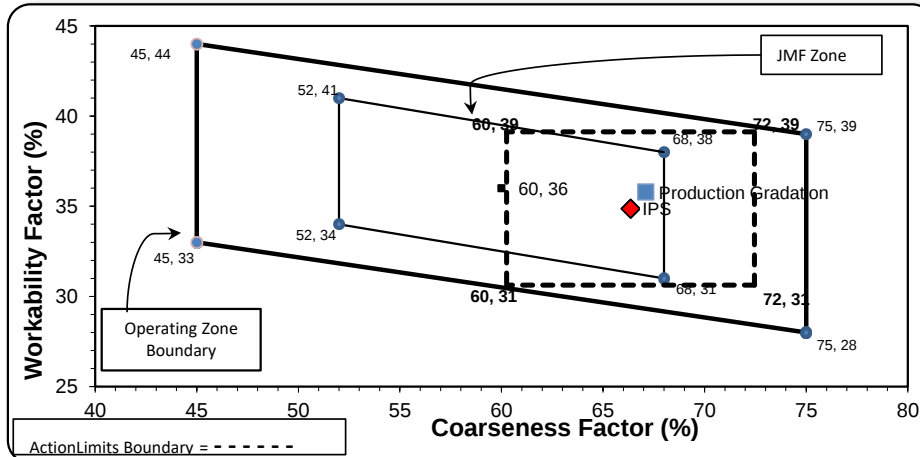

Initial Production Sample (IPS)

Coarseness Factor:		66	
Workability Factor:		35	
Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	99.6	0.4	0.4
1"	84.3	15.3	15.7
3/4"	74.8	9.6	25.2
1/2"	64.3	10.4	35.7
3/8"	56.8	7.5	43.2
#4	43.0	13.8	57.0
#8	34.9	8.1	65.1
#16	26.4	8.5	73.6
#30	19.9	6.5	80.1
#50	10.4	9.5	89.6
#100	3.4	7.0	96.6
LBW	1.2	2.2	98.8

PREPARED BY:
SM, LLC Technical Service

Approved By:



Daily Summary Report

Date Friday, August 15, 2025

Sample Id	-674891463	-674963896	-674956761
Plant	S101	S101	S101
Product	Superior Mount Clemens 1022 2NS GR	Superior Mount Clemens 7919 COARSE AGG P1M LS	Superior Mount Clemens 7920 INTERMED AGG P1M LS
Specification	2NS GR Spec	Coarse Agg P1M LS Target	Intermed Agg P1M LS Target
Sample Type	QA	QA	QA
2" (50mm)		100.0	100.0
1 1/2" (37.5mm)		94.7	100.0
1" (25mm)		46.1	100.0
3/4" (19mm)		13.6	98.0
1/2" (12.5mm)		5.0	81.1
3/8" (9.5mm)	100.0	4.2	56.3
#4 (4.75mm)	97.5	3.5	14.9
#8 (2.36mm)	84.1	3.3	6.4
#16 (1.18mm)	70.5	3.2	5.1
#30 (.6mm)	55.1	3.1	4.7
#50 (.3mm)	29.0	2.9	4.2
#100 (.15mm)	7.4	2.7	3.3
#200 (75µm)	0.9	2.3	2.7
Pan	0.0	0.0	0.0
FM	2.56		
Wash Loss (#200/75um)	0.5	2.1	2.5
Total Moisture	4.50	1.86	2.81

Aggregate Optimization Chart

Production Gradation Report

PLANT #: **P-102**

Contractor: _____

Sample Date: 8/11/25

Concrete Grade: **P1M, 3500HP, 4000HP**

Dates Test Represents: 8/12/2025 through 8/18/2025

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
CA	58-003	Stoneco	1350	8.04	2.69	43.3
IA	58-003	Stoneco	570	3.40	2.69	18.3
2NS	63-114	Highland	1200	7.26	2.65	38.5
Total Wt			3120	18.70		100.0

<----- Verify this number is 100%

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	66.5	100.0	100.0	85.5	14.5	14.5
3/4"	35.7	100.0	100.0	72.2	13.3	27.8
1/2"	12.0	95.5	100.0	61.1	11.1	38.9
3/8"	5.6	73.4	100.0	54.3	6.8	45.7
#4	1.5	13.3	99.5	41.3	12.9	58.7
#8	1.3	4.5	84.8	34.0	7.3	66.0
#16	1.3	2.7	67.6	27.1	6.9	72.9
#30	1.3	2.3	48.7	19.7	7.3	80.3
#50	1.3	2.1	21.4	9.2	10.5	90.8
#100	1.2	2.1	4.2	2.5	6.7	97.5
LBW	1.1	2.0	1.0	1.2	1.3	98.8

*Maximum % Retained must be above the 3/8" sieve.

*Any two adjacent sieves must equal 10% except max.,

nom. max., #100 and #200 sieves.

*% Retained must be at least 4% for each sieve except max.,

nom. max., #100 and #200 sieves.

*% Retained must be at least 8% for the 1" sieve when

a 2" max. size (nom. Max. 1.5") aggregate is used.



Superior Materials, LLC


30701 W. 10 Mile Rd.

Suite 500

Farmington Hills, MI 48336

Production Gradation ☒ Batch Plant Gradations ☐ Aggregate Supplier Gradations

Coarseness Factor:	69	Workability Factor:	34
---------------------------	-----------	----------------------------	-----------

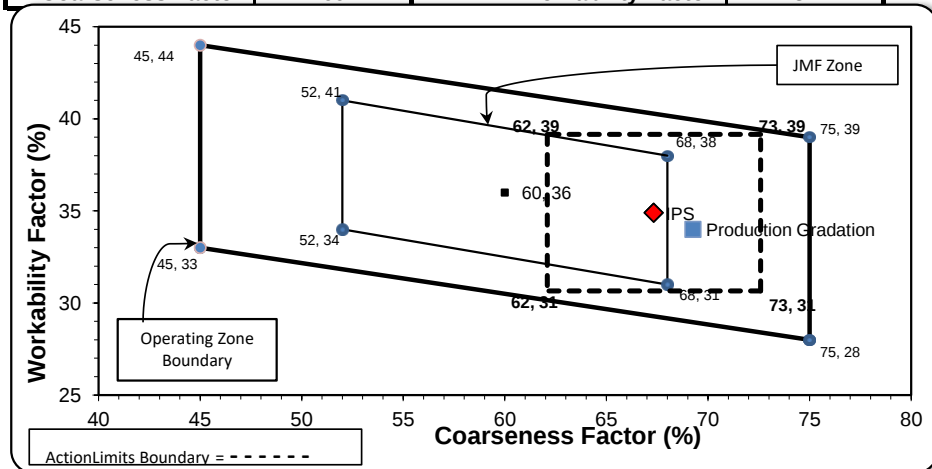

Initial Production Sample (IPS)

Coarseness Factor:		67	
Workability Factor:		35	
Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	85.5	14.5	14.5
3/4"	73.4	12.1	26.6
1/2"	61.0	12.4	39.0
3/8"	56.2	4.8	43.8
#4	43.1	13.1	56.9
#8	34.9	8.2	65.1
#16	29.4	5.5	70.6
#30	21.6	7.8	78.4
#50	8.1	13.4	91.9
#100	2.2	5.9	97.8
LBW	1.4	0.8	98.6

PREPARED BY:
SM, LLC Technical Service

Approved By:



Daily Summary Report

Date Tuesday, August 12, 2025

Sample Id	-674940200	-674934631	-674966187
Plant	S102 Superior Novi	S102 Superior Novi	S102 Superior Novi
Product	1022 2NS GR	7919 COARSE AGG P1M LS	7920 INTERMED AGG P1M LS
Specification	2NS GR Spec	Coarse Agg P1M LS Target	Intermed Agg P1M LS Target
Sample Type	QA	QA	QA
2" (50mm)		100.0	100.0
1 1/2" (37.5mm)		100.0	100.0
1" (25mm)		66.5	100.0
3/4" (19mm)		35.7	100.0
1/2" (12.5mm)		12.0	95.5
3/8" (9.5mm)	100.0	5.6	73.4
#4 (4.75mm)	99.5	1.5	13.3
#8 (2.36mm)	84.8	1.3	4.5
#16 (1.18mm)	67.6	1.3	2.7
#30 (.6mm)	48.7	1.3	2.3
#50 (.3mm)	21.4	1.3	2.1
#100 (.15mm)	4.2	1.2	2.1
#200 (75µm)	1.1	1.2	2.0
Pan	0.0	0.0	0.0
FM	2.74		
Wash Loss (#200/75um)	1.0	1.1	2.0
Total Moisture	2.91	1.75	2.77

Aggregate Optimization Chart

Production Gradation Report

PLANT #: **P-103**

Sample Date: 8/11/25

Dates Test Represents: 8/12/2025 through 8/18/2025

Concrete Grade: **P1M, 3500HP, 4000HP**

Contractor: _____

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
CA	58-003	Stoneco	1350	8.04	2.69	43.3
IA	58-003	Stoneco	570	3.40	2.69	18.3
2NS	63-114	Highland	1200	7.26	2.65	38.5
Total Wt			3120	18.70		100.0

<----- Verify this number is 100%

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	58.7	100.0	100.0	82.1	17.9	17.9
3/4"	19.6	100.0	100.0	65.2	16.9	34.8
1/2"	7.6	87.4	100.0	57.7	7.5	42.3
3/8"	4.7	66.1	100.0	52.6	5.1	47.4
#4	2.4	10.7	98.8	41.0	11.6	59.0
#8	2.2	3.8	84.7	34.2	6.8	65.8
#16	2.1	2.3	69.7	28.1	6.1	71.9
#30	2.0	1.8	51.9	21.2	7.0	78.8
#50	1.9	1.5	24.2	10.4	10.8	89.6
#100	1.7	1.4	4.2	2.6	7.8	97.4
LBW	1.5	1.3	0.5	1.1	1.5	98.9

*Maximum % Retained must be above the 3/8" sieve.

*Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.

*% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.

*% Retained must be at least 8% for the 1" sieve when a 2" max. size (nom. Max. 1.5") aggregate is used.




Superior Materials, LLC

30701 W. 10 Mile Rd.
Suite 500
Farmington Hills, MI 48336

Production Gradation ☒ Batch Plant Gradations ☐ Aggregate Supplier Gradations

Coarseness Factor: **72** **Workability Factor:** **34**

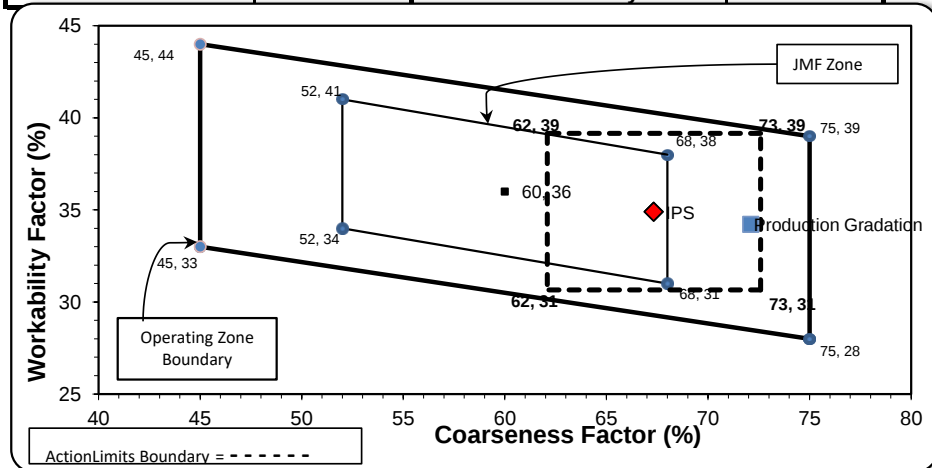

Initial Production Sample (IPS)

Coarseness Factor:		67	
Workability Factor:		35	
Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	85.5	14.5	14.5
3/4"	73.4	12.1	26.6
1/2"	61.0	12.4	39.0
3/8"	56.2	4.8	43.8
#4	43.1	13.1	56.9
#8	34.9	8.2	65.1
#16	29.4	5.5	70.6
#30	21.6	7.8	78.4
#50	8.1	13.4	91.9
#100	2.2	5.9	97.8
LBW	1.4	0.8	98.6

PREPARED BY:
SM, LLC Technical Service

Approved BY:



Daily Summary Report

Date Friday, August 15, 2025

Sample Id	-320370079	-1376933356	-1376934220	-1989638597	-674908945
Plant	S103 Superior Brighton	S103 Superior Brighton	S103 Superior Brighton	S103 Superior Brighton	S103 Superior Brighton
Product	1051 6AA LS	1067 26A Mod LS	1022 2NS GR	7920 INTERMED AGG P1M LS	7919 COARSE AGG P1M LS
Specification	6AA LS	26A Mod LS Spec	2NS GR Spec	Intermed Agg P1M LS Target	Coarse Agg P1M LS Target
Sample Type	QA	QA	QA	QA	QA
2" (50mm)	100.0	100.0		100.0	100.0
1 1/2" (37.5mm)	100.0	100.0		100.0	100.0
1" (25mm)	100.0	100.0		100.0	58.7
3/4" (19mm)	85.0	100.0		100.0	19.6
1/2" (12.5mm)	39.4	98.4		87.4	7.6
3/8" (9.5mm)	20.4	86.2	100.0	66.1	4.7
#4 (4.75mm)	2.2	14.7	98.8	10.7	2.4
#8 (2.36mm)	1.5	4.1	84.7	3.8	2.2
#16 (1.18mm)	1.3	2.2	69.7	2.3	2.1
#30 (.6mm)	1.2	1.6	51.9	1.8	2.0
#50 (.3mm)	1.2	1.5	24.2	1.5	1.9
#100 (.15mm)	1.1	1.4	4.2	1.4	1.7
#200 (75µm)	1.08	1.4	0.7	1.4	1.6
Pan	0.00	0.0	0.0	0.0	0.0
FM			2.66		
Wash Loss (#200/75um)	1.0	1.4	0.5	1.3	1.5
Total Moisture	2.65	3.63	5.72	3.01	2.69

Aggregate Optimization Chart

Production Gradation Report

PLANT #: **P11**

Contractor: _____

Sample Date: 8/11/25

Concrete Grade: **P1M, 3500HP, 4000HP**

Dates Test Represents: 8/12/2025 through 8/18/2025

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
CA	71-47	Presque Isle	900	5.50	2.62	29.3
IA	71-47	Presque Isle	970	5.93	2.62	31.6
2NS	63-115	Ray Rd	1200	7.26	2.65	39.1
Total Wt			3070	18.70		100.0

<----- Verify this number is 100%

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	98.1	100.0	100.0	99.4	0.6	0.6
1"	35.7	100.0	100.0	81.1	18.3	18.9
3/4"	7.0	96.4	100.0	71.6	9.6	28.4
1/2"	3.1	75.9	100.0	64.0	7.6	36.0
3/8"	2.7	50.8	100.0	55.9	8.0	44.1
#4	2.6	12.5	96.3	42.4	13.6	57.6
#8	2.5	5.9	80.6	34.1	8.3	65.9
#16	2.4	4.3	64.1	27.1	7.0	72.9
#30	2.3	3.8	48.2	20.7	6.4	79.3
#50	2.2	3.5	24.9	11.5	9.2	88.5
#100	2.0	3.3	6.6	4.2	7.3	95.8
LBW	1.6	2.9	1.2	1.9	2.4	98.1

*Maximum % Retained must be above the 3/8" sieve.

*Any two adjacent sieves must equal 10% except max.,

nom. max., #100 and #200 sieves.

*% Retained must be at least 4% for each sieve except max.,

nom. max., #100 and #200 sieves.

*% Retained must be at least 8% for the 1" sieve when

a 2" max. size (nom. Max. 1.5") aggregate is used.



Superior Materials, LLC


30701 W. 10 Mile Rd.

Suite 500

Farmington Hills, MI 48336

Production Gradation ☒ Batch Plant Gradations ☐ Aggregate Supplier Gradations

Coarseness Factor: **67** **Workability Factor:** **34**

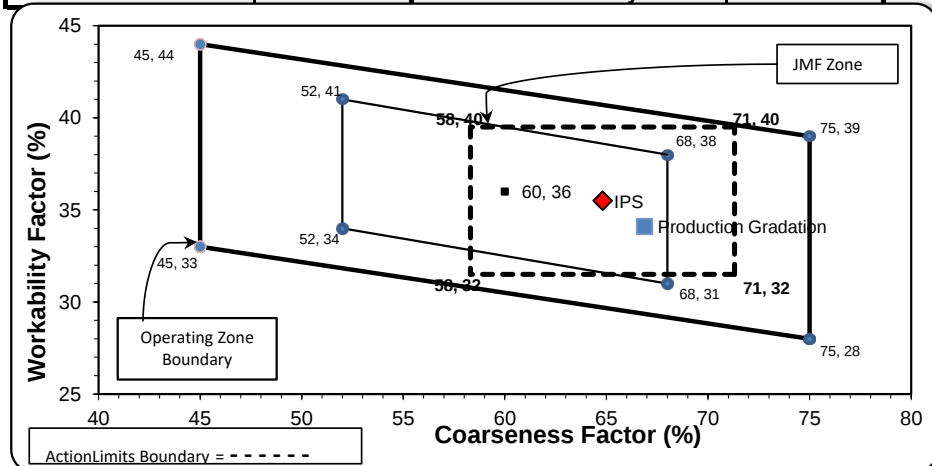

Initial Production Sample (IPS)

Coarseness Factor:		65	
Workability Factor:		36	
Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	99.0	0.6	0.6
1"	84.0	15.3	16.0
3/4"	73.5	10.5	26.5
1/2"	65.2	8.2	34.8
3/8"	58.2	7.1	41.8
#4	44.1	14.1	55.9
#8	35.5	8.6	64.5
#16	29.1	6.4	70.9
#30	21.9	7.3	78.1
#50	9.6	12.2	90.4
#100	2.6	7.1	97.4
LBW	1.0	1.6	99.0

PREPARED BY:
SM, LLC Technical Service

Approved By:

Daily Summary Report

Date Wednesday, August 13, 2025

Sample Id	-1989629434	-674926225	-674907676	-674940643	-674973969
Plant	S000 Onsite Jefferson	S000 Onsite Jefferson	S000 Onsite Jefferson	S000 Onsite Jefferson	S000 Onsite Jefferson
Product	1022 2NS GR	7919 COARSE AGG P1M LS	1051 6AA LS	7920 INTERMED AGG P1M LS	1067 26A Mod LS
Specification	2NS GR Spec	Coarse Agg P1M LS Target		Intermed Agg P1M LS Target	26A Mod LS Spec
Sample Type	QA	QA	QA	QA	QA
2" (50mm)		100.0	100.0	100.0	100.0
1 1/2" (37.5mm)		98.1	100.0	100.0	100.0
1" (25mm)		35.7	96.9	100.0	100.0
3/4" (19mm)		7.0	85.1	96.4	100.0
1/2" (12.5mm)		3.1	48.5	75.9	99.1
3/8" (9.5mm)	100.0	2.7	25.1	50.8	87.4
#4 (4.75mm)	96.3	2.6	3.4	12.5	23.8
#8 (2.36mm)	80.6	2.5	2.6	5.9	8.4
#16 (1.18mm)	64.1	2.4	2.4	4.3	4.4
#30 (.6mm)	48.2	2.3	2.3	3.8	3.5
#50 (.3mm)	24.9	2.2	2.2	3.5	3.1
#100 (.15mm)	6.6	2.0	2.1	3.3	2.9
#200 (75µm)	1.5	1.7	1.94	3.0	2.7
Pan	0.0	0.0	0.00	0.0	0.0
FM	2.79				
-#200 (75um)	1.5				
Wash Loss (#200/75um)	1.2	1.6	1.8	2.9	2.5
Total Moisture	3.8	0.2	1.9	1.1	2.9

Aggregate Optimization Chart

Production Gradation Report

PLANT #: **P-36**

Contractor: _____

Sample Date: **8/11/25**

Concrete Grade: **P1M, 3500HP, 4000HP**

Dates Test Represents: **8/12/2025** through **8/18/2025**

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
CA	71-47	Presque Isle	900	5.50	2.62	29.3
IA	71-47	Presque Isle	970	5.93	2.62	31.6
2NS	63-92	Grange Hall	1200	7.26	2.65	39.1
Total Wt			3070	18.70		100.0

<----- Verify this number is 100%

Sieve	CA	IA	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	95.7	100.0	100.0	98.7	1.3	1.3
1"	39.4	100.0	100.0	82.2	16.5	17.8
3/4"	7.1	95.0	100.0	71.2	11.0	28.8
1/2"	2.0	55.7	100.0	57.3	13.9	42.7
3/8"	1.5	27.9	100.0	48.3	8.9	51.7
#4	1.3	3.5	98.1	39.8	8.5	60.2
#8	1.2	2.2	84.8	34.2	5.6	65.8
#16	1.1	1.8	71.1	28.7	5.5	71.3
#30	1.1	1.7	54.5	22.2	6.5	77.8
#50	1.0	1.6	24.6	10.4	11.7	89.6
#100	0.9	1.5	3.8	2.2	8.2	97.8
LBW	0.7	1.2	0.3	0.7	1.5	99.3

*Maximum % Retained must be above the 3/8" sieve.

*Any two adjacent sieves must equal 10% except max.,

nom. max., #100 and #200 sieves.

*% Retained must be at least 4% for each sieve except max.,

nom. max., #100 and #200 sieves.

*% Retained must be at least 8% for the 1" sieve when

a 2" max. size (nom. Max. 1.5") aggregate is used.



Superior Materials, LLC


30701 W. 10 Mile Rd.

Suite 500

Farmington Hills, MI 48336

Production Gradation ☒ Batch Plant Gradations ☐ Aggregate Supplier Gradations

Coarseness Factor:	78	Workability Factor:	34
---------------------------	-----------	----------------------------	-----------

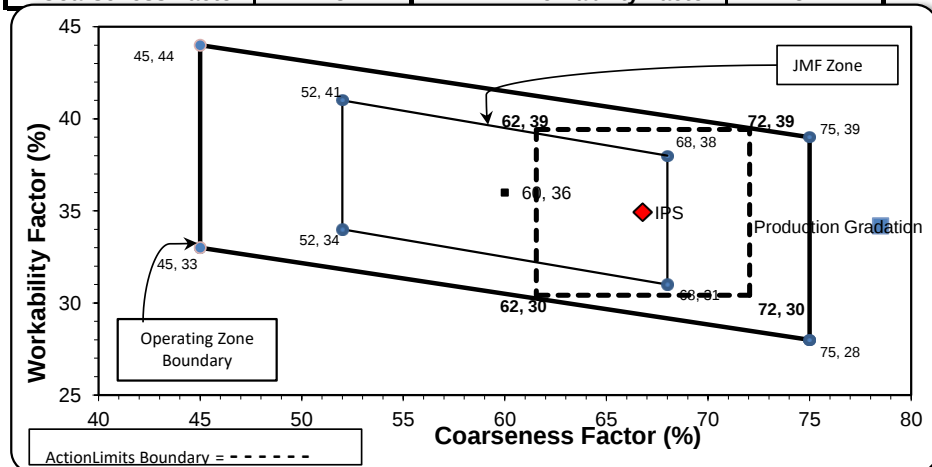

Initial Production Sample (IPS)

Coarseness Factor:		67	
Workability Factor:		35	
Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	85.0	15.0	15.0
3/4"	72.1	12.9	27.9
1/2"	64.5	7.6	35.5
3/8"	56.5	8.0	43.5
#4	42.7	13.8	57.3
#8	34.9	7.8	65.1
#16	29.0	5.9	71.0
#30	21.0	8.0	79.0
#50	8.2	12.8	91.8
#100	1.6	6.5	98.4
LBW	0.7	0.9	99.3

PREPARED BY:
SM, LLC Technical Service

Approved By:



Daily Summary Report

Date Thursday, August 14, 2025

Sample Id	-674909323	-674973220	-1989619869
Plant	S36	S36	S36
Product	Superior Auburn Hills 7919 COARSE AGG P1M LS	Superior Auburn Hills 7920 INTERMED AGG P1M LS	Superior Auburn Hills 1022 2NS GR
Specification	Coarse Agg P1M LS Target	Intermed Agg P1M LS Target	2NS GR Spec
Sample Type	QA	QA	QA
2" (50mm)	100.0	100.0	
1 1/2" (37.5mm)	95.7	100.0	
1" (25mm)	39.4	100.0	
3/4" (19mm)	7.1	95.0	
1/2" (12.5mm)	2.0	55.7	
3/8" (9.5mm)	1.5	27.9	100.0
#4 (4.75mm)	1.3	3.5	98.1
#8 (2.36mm)	1.2	2.2	84.8
#16 (1.18mm)	1.1	1.8	71.1
#30 (.6mm)	1.1	1.7	54.5
#50 (.3mm)	1.0	1.6	24.6
#100 (.15mm)	0.9	1.5	3.8
#200 (75µm)	0.8	1.4	0.5
Pan	0.0	0.0	0.0
FM			2.63
Wash Loss (#200/75µm)	0.7	1.2	0.3
Total Moisture	0.69	1.51	3.59