

Aggregate Optimization Chart

Production Gradation Report

PLANT #: **P-102**

Sample Date: 11/17/25

Concrete Grade: **DM, 4500HP**

Contractor: _____

Dates Test Represents: 11/18/2025 through 11/24/2025

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
6AA	58-003	Stoneco	1500	8.94	2.69	50.8
26A	58-003	Stoneco	300	1.79	2.69	10.2
2NS	63-114	Highland	1150	6.95	2.65	39.0
Total Wt			2950	17.68		100.0

<----- Verify this number is 100%

Sieve	6AA	26A	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	100.0	100.0	100.0	100.0	0.0	0.0
3/4"	86.3	100.0	100.0	93.0	7.0	7.0
1/2"	43.4	99.8	100.0	71.2	21.8	28.8
3/8"	20.0	84.6	100.0	57.8	13.4	42.2
#4	2.8	8.8	99.2	41.0	16.8	59.0
#8	1.4	2.4	85.4	34.2	6.7	65.8
#16	1.4	2.0	68.4	27.6	6.7	72.4
#30	1.4	1.7	49.6	20.2	7.4	79.8
#50	1.3	1.3	22.4	9.5	10.7	90.5
#100	1.3	1.2	3.7	2.2	7.3	97.8
LBW	1.0	1.0	0.6	0.8	1.4	99.2

*Maximum % Retained must be above the 3/8" sieve.

*Any two adjacent sieves must equal 10% except max.,

nom. max., #100 and #200 sieves.

*% Retained must be at least 4% for each sieve except max.,

nom. max., #100 and #200 sieves.

*% Retained must be at least 4% for the 3/4" sieve when

a 1.5" max. size (nom. Max. 1.0") aggregate is used.




Superior Materials, LLC
30701 W. 10 Mile Rd.
Suite 500
Farmington Hills, MI 48336

Production Gradation ☐ Batch Plant Gradations ☒ Aggregate Supplier Gradations

Adjusted WF Initial Production Sample (IPS)

Coarseness Factor:	64	Workability Factor:	34	36.7
---------------------------	-----------	----------------------------	-----------	-------------

Coarseness Factor:		61	
Workability Factor:		36	
Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	99.3	0.7	0.7
3/4"	89.2	10.1	10.8
1/2"	70.7	18.5	29.3
3/8"	60.7	10.0	39.3
#4	44.4	16.3	55.6
#8	35.9	8.5	64.1
#16	27.3	8.6	72.7
#30	19.1	8.2	80.9
#50	7.4	11.7	92.6
#100	1.9	5.6	98.1
LBW	0.7	1.2	99.3

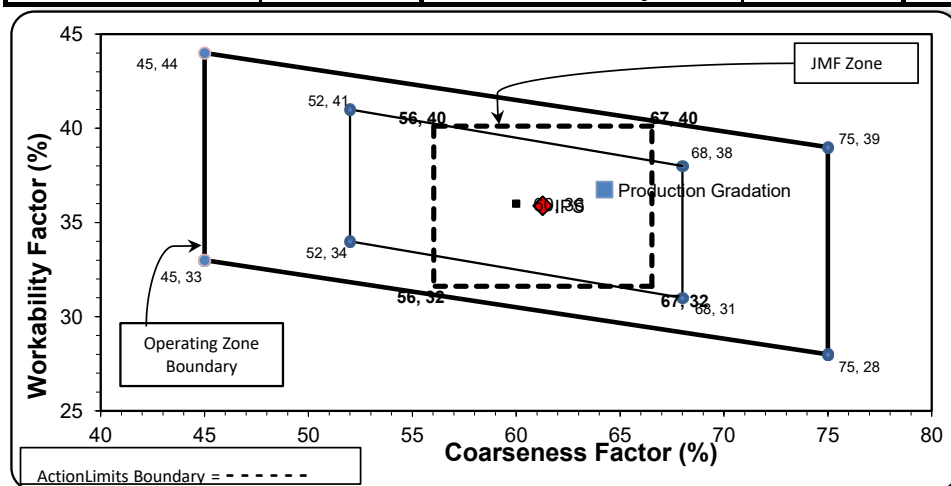

PREPARED BY:
SM, LLC Technical Service

Approved By:

[Signature]

Aggregate Optimization Chart

Production Gradation Report

PLANT #: **P-103**

Sample Date: 11/17/25

Concrete Grade: **DM, 4500HP**

Contractor: _____

Dates Test Represents: 11/18/2025 through 11/24/2025

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
6AA	58-003	Stoneco	1500	8.94	2.69	50.8
26A	58-003	Stoneco	300	1.79	2.69	10.2
2NS	63-114	Highland	1150	6.95	2.65	39.0
Total Wt			2950	17.68		100.0

<----- Verify this number is 100%

Sieve	6AA	26A	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	100.0	100.0	100.0	100.0	0.0	0.0
3/4"	86.3	100.0	100.0	93.0	7.0	7.0
1/2"	43.4	99.8	100.0	71.2	21.8	28.8
3/8"	20.0	84.6	100.0	57.8	13.4	42.2
#4	2.8	8.8	99.2	41.0	16.8	59.0
#8	1.4	2.4	85.4	34.2	6.7	65.8
#16	1.4	2.0	68.4	27.6	6.7	72.4
#30	1.4	1.7	49.6	20.2	7.4	79.8
#50	1.3	1.3	22.4	9.5	10.7	90.5
#100	1.3	1.2	3.7	2.2	7.3	97.8
LBW	1.0	1.0	0.6	0.8	1.4	99.2

*Maximum % Retained must be above the 3/8" sieve.

*Any two adjacent sieves must equal 10% except max.,

nom. max., #100 and #200 sieves.

*% Retained must be at least 4% for each sieve except max.,

nom. max., #100 and #200 sieves.

*% Retained must be at least 4% for the 3/4" sieve when

a 1.5" max. size (nom. Max. 1.0") aggregate is used.



Superior Materials, LLC
30701 W. 10 Mile Rd.
Suite 500
Farmington Hills, MI 48336


Production Gradation ☐ Batch Plant Gradations ☒ Aggregate Supplier Gradations

Adjusted WF Initial Production Sample (IPS)

Coarseness Factor:	64	Workability Factor:	34	36.7
---------------------------	-----------	----------------------------	-----------	-------------

Coarseness Factor:	61
---------------------------	-----------

Workability Factor:	36
----------------------------	-----------

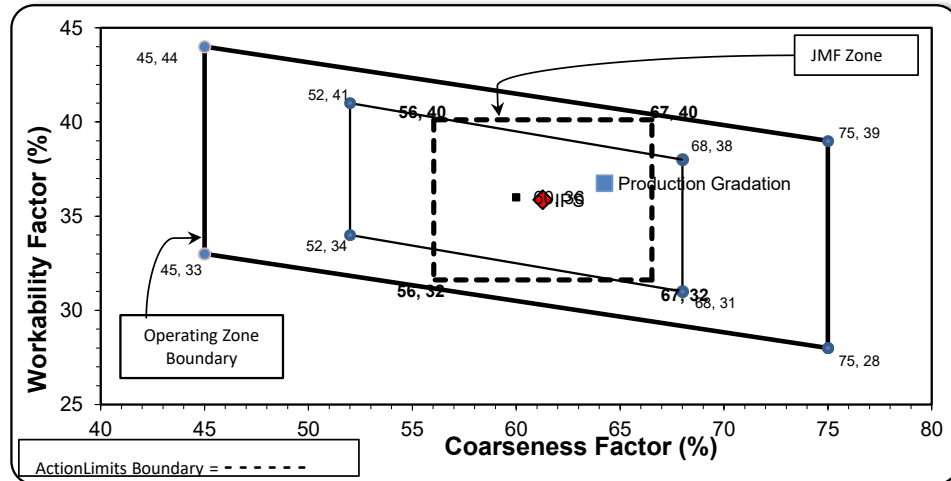

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	99.3	0.7	0.7
3/4"	89.2	10.1	10.8
1/2"	70.7	18.5	29.3
3/8"	60.7	10.0	39.3
#4	44.4	16.3	55.6
#8	35.9	8.5	64.1
#16	27.3	8.6	72.7
#30	19.1	8.2	80.9
#50	7.4	11.7	92.6
#100	1.9	5.6	98.1
LBW	0.7	1.2	99.3

PREPARED BY:
SM, LLC Technical Service

Approved BY:

[Signature]

Aggregate Optimization Chart

Production Gradation Report

PLANT #: 12

Sample Date: 11/17/25

Dates Test Represents: 11/18/2025 through 11/24/2025

Concrete Grade: **DM, 4500HP**

Contractor: _____

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
6AA	71-47	Presque Isle	1455	8.90	2.62	50.1
26A	71-47	Presque Isle	300	1.83	2.62	10.3
2NS	63-115	Ray Rd	1150	6.95	2.65	39.6
Total Wt			2905	17.69		100.0

<----- Verify this number is 100%

Sieve	6AA	26A	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	97.8	100.0	100.0	98.9	1.1	1.1
3/4"	81.7	100.0	100.0	90.8	8.1	9.2
1/2"	39.6	99.0	100.0	69.6	21.2	30.4
3/8"	20.4	86.6	100.0	58.7	10.9	41.3
#4	3.7	18.0	97.5	42.3	16.4	57.7
#8	2.0	4.6	82.6	34.2	8.1	65.8
#16	1.8	2.5	63.2	26.2	8.0	73.8
#30	1.8	2.0	44.9	18.9	7.3	81.1
#50	1.6	1.9	22.1	9.7	9.1	90.3
#100	1.6	1.8	5.3	3.1	6.7	96.9
LBW	1.4	1.6	1.1	1.3	1.8	98.7


*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for the 3/4" sieve when a 1.5" max. size (nom. Max. 1.0") aggregate is used.



Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Production Gradation ☐ Batch Plant Gradations ☒ Aggregate Supplier Gradations

Adjusted WF Initial Production Sample (IPS)

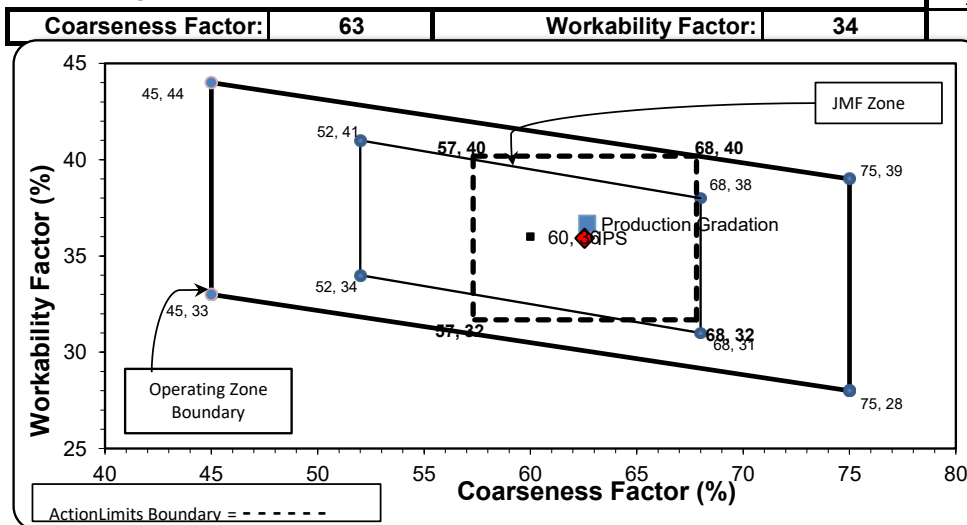

Coarseness Factor: 63		Workability Factor: 36	
Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	99.3	0.7	0.7
3/4"	89.0	10.3	11.0
1/2"	70.3	18.7	29.7
3/8"	59.9	10.4	40.1
#4	41.9	18.0	58.1
#8	35.9	6.0	64.1
#16	27.8	8.2	72.2
#30	18.9	8.8	81.1
#50	6.3	12.6	93.7
#100	1.7	4.6	98.3
LBW	1.0	0.7	99.0

PREPARED BY:
 SM, LLC Technical Service

Approved By:

Aggregate Optimization Chart

Production Gradation Report

PLANT #: **p11**

Sample Date: 11/17/25

Concrete Grade: **DM, 4500HP**

Contractor: _____

Dates Test Represents: 11/18/2025 through 11/24/2025

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
6AA	71-47	Presque Isle	1455	8.90	2.62	50.1
26A	71-47	Presque Isle	300	1.83	2.62	10.3
2NS	63-115	Ray Rd	1150	6.95	2.65	39.6
Total Wt			2905	17.69		100.0

<----- Verify this number is 100%

Sieve	6AA	26A	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	97.8	100.0	100.0	98.9	1.1	1.1
3/4"	81.7	100.0	100.0	90.8	8.1	9.2
1/2"	39.6	99.0	100.0	69.6	21.2	30.4
3/8"	20.4	86.6	100.0	58.7	10.9	41.3
#4	3.7	18.0	97.5	42.3	16.4	57.7
#8	2.0	4.6	82.6	34.2	8.1	65.8
#16	1.8	2.5	63.2	26.2	8.0	73.8
#30	1.8	2.0	44.9	18.9	7.3	81.1
#50	1.6	1.9	22.1	9.7	9.1	90.3
#100	1.6	1.8	5.3	3.1	6.7	96.9
LBW	1.4	1.6	1.1	1.3	1.8	98.7


*Maximum % Retained must be above the 3/8" sieve.
 *Any two adjacent sieves must equal 10% except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for each sieve except max., nom. max., #100 and #200 sieves.
 *% Retained must be at least 4% for the 3/4" sieve when a 1.5" max. size (nom. Max. 1.0") aggregate is used.



Superior Materials, LLC
 30701 W. 10 Mile Rd.
 Suite 500
 Farmington Hills, MI 48336

Production Gradation ☐ Batch Plant Gradations ☒ Aggregate Supplier Gradations

Adjusted WF Initial Production Sample (IPS)

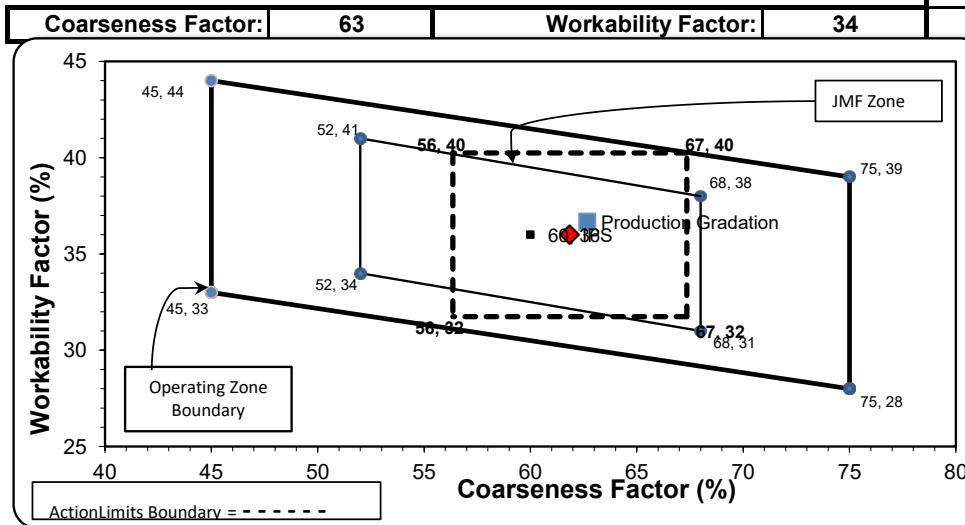

Coarseness Factor: 62		Workability Factor: 36	
Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	100.0	0.0	0.0
3/4"	95.0	5.0	5.0
1/2"	72.3	22.8	27.7
3/8"	60.4	11.8	39.6
#4	42.6	17.8	57.4
#8	36.0	6.6	64.0
#16	29.5	6.5	70.5
#30	20.3	9.2	79.7
#50	9.5	10.8	90.5
#100	3.4	6.1	96.6
LBW	1.3	2.1	98.7

PREPARED BY:
 SM, LLC Technical Service

Approved By:

Aggregate Optimization Chart

Production Gradation Report

PLANT #: **P-02**

Sample Date: 11/17/25

Concrete Grade: **DM, 4500HP**

Contractor: _____

Dates Test Represents: 11/18/2025 through 11/24/2025

MDOT No.: _____

Agg. Class	Pit #	Source	Weight (SSD)	ft ³	Specific Gravity	% Contribution
6AA	71-47	Presque Isle	1455	8.90	2.62	50.1
26A	71-47	Presque Isle	300	1.83	2.62	10.3
2NS	63-115	Ray Rd	1150	6.95	2.65	39.6
Total Wt			2905	17.69		100.0

<----- Verify this number is 100%

Sieve	6AA	26A	2NS	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	100.0	100.0	100.0	0.0	0.0
1.5"	100.0	100.0	100.0	100.0	0.0	0.0
1"	97.8	100.0	100.0	98.9	1.1	1.1
3/4"	81.7	100.0	100.0	90.8	8.1	9.2
1/2"	39.6	99.0	100.0	69.6	21.2	30.4
3/8"	20.4	86.6	100.0	58.7	10.9	41.3
#4	3.7	18.0	97.5	42.3	16.4	57.7
#8	2.0	4.6	82.6	34.2	8.1	65.8
#16	1.8	2.5	63.2	26.2	8.0	73.8
#30	1.8	2.0	44.9	18.9	7.3	81.1
#50	1.6	1.9	22.1	9.7	9.1	90.3
#100	1.6	1.8	5.3	3.1	6.7	96.9
LBW	1.4	1.6	1.1	1.3	1.8	98.7

*Maximum % Retained must be above the 3/8" sieve.

*Any two adjacent sieves must equal 10% except max.,

nom. max., #100 and #200 sieves.

*% Retained must be at least 4% for each sieve except max.,

nom. max., #100 and #200 sieves.

*% Retained must be at least 4% for the 3/4" sieve when

a 1.5" max. size (nom. Max. 1.0") aggregate is used.



Superior Materials, LLC
30701 W. 10 Mile Rd.
Suite 500
Farmington Hills, MI 48336


Production Gradation ☐ Batch Plant Gradations ☒ Aggregate Supplier Gradations

Adjusted WF Initial Production Sample (IPS)

Coarseness Factor:	63	Workability Factor:	34	36.7
--------------------	----	---------------------	----	------

Coarseness Factor:	63
--------------------	----

Workability Factor:	35
---------------------	----

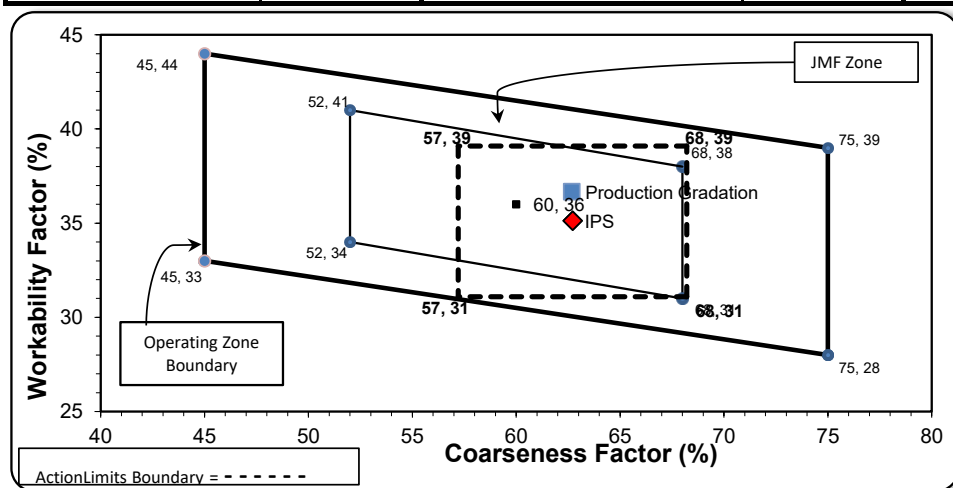

Sieve	Cumulative % Passing	% Retained	Cumulative % Retained
2"	100.0	0.0	0.0
1.5"	100.0	0.0	0.0
1"	100.0	0.0	0.0
3/4"	95.1	4.9	4.9
1/2"	74.6	20.5	25.4
3/8"	59.3	15.3	40.7
#4	42.1	17.2	57.9
#8	35.1	7.1	64.9
#16	29.2	5.9	70.8
#30	21.9	7.3	78.1
#50	9.6	12.4	90.4
#100	2.4	7.2	97.6
LBW	0.9	1.5	99.1

PREPARED BY:
SM, LLC Technical Service

Approved By:

[Signature]